

558J

COOLING ONLY/ELECTRIC HEAT PACKAGED ROOFTOP UNITS
HORIZONTAL MODELS, NOMINAL TONS 15, 17.5, 20, 25
MODEL SIZES 18, 21, 25, 29



Product Data

LEGACY™
LINE



C10538



TABLE OF CONTENTS

	PAGE		PAGE
FEATURES AND BENEFITS	3	APPLICATION/SELECTION DATA	22
MODEL NUMBER NOMENCLATURE	4	COOLING CAPACITIES	24
FACTORY OPTIONS & ACCESSORIES	5	STATIC PRESSURE ADDERS	32
AHRI RATING TABLE	8	DAMPER, BAROMETRIC RELIEF & PE PERF	33
MIN-MAX AIRFLOWS CLG & ELECT HEAT	8	FAN PERFORMANCE	34
SOUND PERFORMANCE	8	ELECTRICAL INFORMATION	38
PHYSICAL DATA	9	SEQUENCE OF OPERATION	52
DIMENSIONS	12	GUIDE SPECIFICATIONS	55
OPTIONS & ACCESSORIES WEIGHT ADDERS ...	22		



Heating & Cooling Systems

The 15 to 25 ton Legacy Line Bryant rooftop unit (RTU) was designed by customers for customers. With a newly designed cabinet that integrates “no-strip” screw collars, handled access panels, and more, we’ve made your unit easy to install, easy to maintain and easy to use and reliable.

Easy to install:

These Legacy Line units are designed for dedicated factory supplied horizontal air flow duct configurations. No special field kits are required. Designed to fit on pre-installed curbs by other another manufacturer, these units also fit on past designed Bryant installed curbs with a new certified and authorized adapter curb. This cabinet design also integrates a large control box that gives you room to work and room to mount Bryant accessory controls.

Easy to maintain:

Easy access handles by Bryant provide quick and easy access to all major, normally serviced components. Our “no-strip” screw system has superior holding power and guides screws into position while preventing the screw from stripping the unit’s metal. Take accurate pressure readings by reading condenser pressure with panels in place as compressors are strategically located to eliminate any air bypass.

Easy to use:

The newly designed, central terminal board by Bryant puts all your connections and troubleshooting points in one convenient place, standard. Most low voltage connections are made to the same board and make it easy to find what you’re looking for and easy to access it. Bryant rooftops have high and low pressure switches, a filter drier, and 2-in (51mm) filters standard.

Reliable:

Each unit comes with precision sized and tested scroll compressor that is internally protected from over temperature and pressures. In addition, each refrigerant circuit is further protected with a high pressure and low pressure switch as well as containing a liquid line filter drier. Each unit is factory tested prior to shipment to help ensure units operation once properly installed.

FEATURES AND BENEFITS

- 2-stage cooling capacity with independent circuits and control.
- High performance copper tube / aluminum plate (RTPF) fin condenser and evaporator coils with optional coating.
- EER's up to 11.0
- IEER's up to 11.2 with single speed indoor fan motor and up to 12.9 with 2-speed/VFD indoor fan motor
- Dedicated horizontal air flow duct configuration models. No field kits required.
- Utility connections through the side or bottom. Bottom connections are also in an enclosed environment to help prevent water entry. Field supplied couplings are required.
- Standardized components and control box layout. Standardized components and controls make stocking parts and service easier.
- Scroll compressors on all units. This makes service, stocking parts, replacement, and trouble-shooting easier.
- Proven TXV refrigerant metering system.
- Easy-adjust, belt-drive motor available. Motor assembly also contains a fan belt break protection system on all models and reliable pillow block bearing system that allows lubrication thru front of the unit.
- Capable of thru-the-base electrical routing.
- Full range of electric heaters and single point electric kits – pre-engineered and approved for field installation.
- Single-point electrical connection.
- Sloped, composite drain pan sheds water; and won't rust.
- Standardized controls and control box layout. Standardized components and controls make stocking parts and service easier.
- Clean, large, easy to use control box.
- Color-coded wiring.
- Large, laminated wiring and power wiring drawings which are affixed to unit make troubleshooting easy.
- Single, central terminal board for test and wiring connections.
- Fast-access, handled, panels for easy access on normally accessed service panels.
- “No-strip” screw system guides screws into the panel and captures them tightly without stripping the screw, the panel, or the unit.
- Mechanical cooling (115°F to 35°F / 46°C to 2°C) standard on all models. Low ambient controller allows operation down to -20°F / -29°C.
- 2-in (51mm) disposable filters on all units, with 4-in (102mm) filter track - field installed.
- Refrigerant filter-drier on each circuit.
- High and low pressure switches. Added reliability with high pressure switch and low pressure switch.
- Many factory-installed options ranging from air management economizers, 2 position dampers, manual outdoor air dampers, plus convenience outlets, disconnect switch and smoke detectors.
- Factory-installed Perfect Humidity System.
- Standard Parts Warranty: 10 year aluminized heat exchanger, 5 year compressor, condenser coil, 1 year others.
- Optional 2-Speed Indoor Fan Motor System utilizes a Variable Frequency Drive (VFD) to automatically adjust the indoor fan motor speed between cooling stages. Available on 2-stage cooling models 18-29 with electromechanical controls or RTU Open.

MODEL NUMBER NOMENCLATURE

Position:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
Example:	5	5	8	J	E	1	8	D	0	0	0	A	5	A	0	A	A

Unit Type

558 - Cooling RTU with optional Electric Heat

Model

J - Puron® (R-410A) Refrigerant

Voltage

E = 460-3-60
P = 208/230-3-60
T = 575-3-60

Cooling Tons

18 - 15 tons
21 - 17.5 tons
25 - 20 tons
29 - 25 tons

Refrig. System/Gas Heat Options

D = Two stage cooling model
K = Two stage cooling with Perfect Humidity™

Heat Level

(Field installed electric heaters available)
000 = No Heat

Coil Options (RTPF) (Outdoor - Indoor - Hail Guard)

A = Al/Cu - Al/Cu
B = Precoat Al/Cu - Al/Cu
C = E-coat Al/Cu - Al/Cu
D = E-coat Al/Cu - E-coat Al/Cu
E = Cu/Cu - Al/Cu
F = Cu/Cu - Cu/Cu
M = Al/Cu - Al/Cu — Louvered Hail Guard
N = Precoat Al/Cu - Al/Cu — Louvered Hail Guard
P = E-coat Al/Cu - Al/Cu — Louvered Hail Guard
Q = E-coat Al/Cu - E-coat Al/Cu — Louvered Hail Guard
R = Cu/Cu - Al/Cu — Louvered Hail Guard
S = Cu/Cu - Cu/Cu — Louvered Hail Guard

Packaging & 2-Speed Indoor Fan Motor

A = Standard Packaging
D = Standard Packaging & 2-speed indoor fan motor (Standard on 29 size models)

Factory Installed Options

0A = None

NOTE: See the 558J Horizontal Models
15 to 25 ton Price Pages for a complete list of factory installed options.

Outdoor Air Options

A = None
B = Temperature Economizer w/ Barometric Relief
E = Temperature Economizer w/ Barometric Relief and CO₂
H = Enthalpy Economizer w/ Barometric Relief
L = Enthalpy Economizer w/ Barometric Relief and CO₂
P = Manual Outdoor Air Damper
Q = 2 Position Damper
U = Temp Ultra Low Leak Economizer w/ Baro Relief
W = Enthalpy Ultra Low Leak Economizer w/ Baro Relief

Indoor Fan Options

5 = Standard Static/Horizontal Supply, Return Air Flow (except on size 29)
6 = Medium Static/Horizontal Supply, Return Air Flow
7 = High Static/Horizontal Supply, Return Air Flow
F = Medium Static High Efficiency Motor/Horizontal Supply, Return Air Flow (Standard on 29 size models)
G = High Static High Efficiency Motor/Horizontal Supply, Return Air Flow

Fig. 1 - Model Number Nomenclature (Example)

C13805

Table 1 – FACTORY-INSTALLED OPTIONS AND FIELD-INSTALLED ACCESSORIES

CATEGORY	ITEM	FACTORY INSTALLED OPTION	FIELD INSTALLED ACCESSORY
Cabinet	Hinged Access Panels	X	
Coil Options	Cu/Cu indoor & outdoor coils	X	
	E-coated indoor & outdoor coils	X	
	Pre-coated outdoor coils	X	
Humidity Control	Perfect Humidity System	X	
Condenser Protection	Condenser coil hail guard (louvered design)	X	X
Controls	Thermostats, temperature sensors, and subbases		X
	RTU Open protocol controller	X	
	Smoke detector (supply and/or return air)	X	X
	Time Guard II compressor delay control circuit		X
	Phase Monitor		X
Economizers & Outdoor Air Dampers	EconoMi\$er IV (for electro-mechanical controlled RTUs)	X	X
	EconoMi\$er2 (for DDC controlled RTUs)	X	X
	Motorized 2 position outdoor-air damper	X	X
	Manual outdoor-air damper (25%)		X
	Barometric relief ¹	X	X
	Barometric hood (Horizontal economizer)		X
	Power exhaust		X
	Ultra Low Leak EconoMi\$er X (for 2-Speed Indoor Fan Motor System only 18 to 29 sizes with 2 stages of cooling), horizontal supply and return air only.	X	X
Economizer Sensors & IAQ Devices	Single dry bulb temperature sensors ²	X	X
	Differential dry bulb temperature sensors ²		X
	Single enthalpy sensors ²	X	X
	Differential enthalpy sensors ²		X
	CO ₂ sensor (wall, duct, or unit mounted) ²	X	X
Electric Heat	Electric Resistance Heaters		X
	Single Point Kit		X
Indoor Motor & Drive	Multiple motor and drive packages	X	
	2-Speed Indoor Fan Motor System w/VFD controller (2-stage cool only with electrical mechanical and RTU Open controls)	X	
	Display Kit for 2-Speed Indoor Fan Motor System with VFD		X
Low Ambient Control	Winter start kit ³		X
	MotorMaster head pressure controller to -20°F (-29°C) ³		X
Power Options	Convenience outlet (powered)	X	
	Convenience outlet (unpowered)	X	
	Non-fused disconnect ⁴	X	
Roof Curbs	Roof curb 14-in (356mm)		X
	Roof curb 24-in (610mm)		X

NOTES:

1. Included with economizer.
2. Sensors for optimizing economizer.
3. See application data for assistance.
4. Non-fused disconnect switch cannot be used when FLA electrical rating exceeds 100 amps at 460/575 volt and 200 amps at 208/230 volt. Bryant RTUBuilder selects this automatically.

FACTORY OPTIONS AND/OR ACCESSORIES

Economizer (dry-bulb or enthalpy)

Economizers save money. They bring in fresh, outside air for ventilation; and provide cool, outside air to cool your building. This is the preferred method of low-ambient cooling. When coupled to CO₂ sensors, Economizers can provide even more savings by coupling the ventilation air to only that amount required.

Economizers are available, installed and tested by the factory, with either enthalpy or dry-bulb temperature inputs. There are also models for electromechanical as well as direct digital controllers. Additional sensors are available as accessories to optimize the economizers.

Economizers include gravity controlled, barometric relief equalizes building pressure and ambient air pressures. This can be a cost effective solution to prevent building pressurization. If further control of exhaust air is required, a dual centrifugal fan power exhaust system is also available.

CO₂ Sensor

Improves productivity and saves money by working with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill your building, the CO₂ sensor detects their presence through increasing CO₂ levels, and opens the economizer appropriately.

When the occupants leave, the CO₂ levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called Demand Control Ventilation (DCV) reduces the overall load on the rooftop, saving money.

Smoke Detectors

Trust the experts. Smoke detectors make your application safer and your job easier. Bryant smoke detectors immediately shut down the rooftop unit when smoke is detected. They are available, installed by the factory, for supply air, return air, or both.

Louvered Hail Guards

Sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact.

Convenience Outlet (powered or un-powered)

Reduce service and/or installation costs by including a convenience outlet in your specification. Bryant will install this service feature at our factory. Provides a convenient, 15 amp, 115v GFCI receptacle with "Wet in Use" cover. The "powered" option allows the installer to power the outlet from the line side of the disconnect as required by code. The "unpowered" option is to be powered from a separate 115/120v power source.

Non-Fused Disconnect

This OSHA-compliant, factory-installed, safety switch allows a service technician to locally secure power to the rooftop.

Power Exhaust with Barometric Relief

Superior internal building pressure control. This field-installed accessory or factory-installed option may eliminate the need for costly, external pressure control fans.

RTU Open Protocol Controller

Connect the rooftop to an existing BAS without needing complicated translators or adapter modules using the RTU Open controller. This new controller speaks the 4 most common building automation system languages (Bacnet, Modbus, N2, and Lonworks). Use this controller when you have an existing BAS.

Time Guard II Control Circuit

This accessory protects your compressor by preventing short-cycling in the event of some other failure, prevents the compressor from restarting for 30 seconds after stopping. Not required with PremierLink®, RTU Open, or authorized commercial thermostats.

Filter or Fan Status Switches

Use these differential pressure switches to detect a filter clog or indoor fan motor failure. When used in conjunction with a compatible unit controller/thermostat, the switches will activate an alarm to warn the appropriate personnel.

Motorized 2-Position Damper

The new Bryant 2-position, motorized outdoor air damper admits up to 100% outside air. Using reliable, gear-driven technology, the 2-position damper opens to allow ventilation air and closes when the rooftop stops, stopping unwanted infiltration.

Manual OA Damper

Manual outdoor air dampers are an economical way to bring in ventilation air. The dampers are available in 25% versions.

Optional Perfect Humidity System

Bryant's Perfect Humidity System is an all-inclusive factory installed option that can be ordered with any Legacy Line 558J 18-29 rooftop unit.

This system expands the envelope of operation of Bryant's Legacy Line rooftop products to provide unprecedented flexibility to meet year round comfort conditions.

The Perfect Humidity System has the industry's only dual dehumidification mode setting. The Perfect Humidity system includes two new modes of operation.

The Legacy Line 558J 18-29 rooftop coupled with the Perfect Humidity system is capable of operating in normal design cooling mode, subcooling mode, and hot gas reheat mode. Normal design cooling mode is when the unit will operate under its normal sequence of operation by cycling compressors to maintain comfort conditions.

FACTORY OPTIONS AND/OR ACCESSORIES (cont.)

Optional Perfect Humidity System (cont.)

Subcooling mode will operate to satisfy part load type conditions when the space requires combined sensible and a higher proportion of latent load control. Hot Gas Reheat mode will operate when outdoor temperatures diminish and the need for latent capacity is required for sole humidity control. Hot Gas Reheat mode will provide neutral air for maximum dehumidification operation.

2-Speed Indoor Fan Motor System

Bryant's 2-Speed Indoor Fan Motor System saves energy and installation time by utilizing a Variable Frequency Drive (VFD) to automatically adjust the indoor fan motor speed in sequence with the units cooling operation. Per ASHRAE 90.1 2010 standard section 6.4.3.10.b, during the first stage of cooling operation the VFD will adjust the fan motor to provide 2/3rd of the total cfm established for the unit. When a call for the second stage of cooling is required, the VFD will allow the total cfm for the unit established (100%). During the heating mode the VFD will allow total design cfm (100%) operation and during the ventilation mode the VFD will allow operation to 2/3rd of total cfm.

Compared to single speed indoor fan motor systems, Bryant's 2-Speed Indoor Fan Motor System can save substantial energy, 25%+*, versus single speed indoor fan motor systems.

The VFD used in Bryant's 2-Speed Indoor Fan Motor System has soft start capabilities to slowly ramp up the speeds, thus eliminating any high inrush air volume during initial start-up. It also has internal over current protection for the fan motor and a field installed display kit that allows adjustment and in depth diagnostics of the VFD.

This 2-Speed Indoor Fan Motor System is available on models with 2-stage cooling operation with electrical mechanical or RTU Open, Multi Protocol controls. Both space sensor and conventional thermostats controls can be used to provide accurate control in any application.

The 2-Speed Indoor Fan Motor System is very flexible for initial fan performance set up and adjustment. The standard factory shipped VFD is pre-programmed to automatically stage the fan speed between the first and second stage of cooling. The unit fan performance static pressure and cfm can be easily adjusted using the traditional means of pulley adjustments. The other means to adjust the unit static and cfm performance is to utilize the field installed Display Kit and adjust the frequency and voltage in the VFD to required performance requirements. In either case, once set up, the VFD will automatically adjust the speed between the cooling stage operations.

*Data based on .10 (\$/kWh) in an office application utilizing Bryant's HAP 4.6 simulation software program.

Motormaster Head Pressure Controller

The Motormaster motor controller is a low ambient, head pressure controller kit that is designed to maintain the unit's condenser head pressure during periods of low ambient cooling operation. This device should be used as an alternative to economizer free cooling not when economizer usage is either not appropriate or desired. The Motormaster will either cycle the outdoor-fan motors or operate them at reduced speed to maintain the unit operation, depending on the model.

MotorMaster allows cooling operation down to -20°F (-29°C) ambient conditions.

Winter Start Kit

The winter start kit by Bryant extends the low ambient limit of your rooftop to 25°F (-4°C). The kit bypasses the low pressure switch, preventing nuisance tripping of the low pressure switch. Other low ambient precautions may still be prudent.

Alternate Motors and Drives

Some applications need larger horsepower motors, some need more airflow, and some need both. Regardless of the case, your Bryant expert has a factory installed combination to meet your application. A wide selection of motors and pulleys (drives) are available, factory installed, to handle nearly any application.

Thru-the-Base Connections

Thru-the-base provisions/connection points are available as standard with every unit. When bottom connections are required, field furnished couplings are required.

Hinged Access Panels

Allows access to unit's major components with specifically designed hinged access panels. Panels are: filter, control box and fan motor.

Electric Heaters / Single Point Kit

Bryant offers a full-line of field-installed accessory heaters and single point kits when required. The heaters are very easy to use, install and are all pre-engineered and certified.

Barometric Hood

For Horizontal Economizer applications where relief damper is installed in duct work. This kit provides the needed protection.

Table 2 – AHRI COOLING RATING TABLE 2-STAGE COOLING

UNIT	COOLING STAGES	NOM. CAPACITY (TONS)	NET COOLING CAPACITY (MBH)	TOTAL POWER (kW)	EER	IEER WITH SINGLE SPEED INDOOR MOTOR	IEER WITH 2-SPEED INDOOR MOTOR
18	2	15	174.0	15.8	11.0	11.2	12.9
21	2	17.5	202.0	18.4	11.0	11.2	12.9
25	2	20	232.0	21.1	11.0	11.2	12.9
29	2	25	282.0	28.2	10.0	N/A*	11.2

LEGEND

- AHRI – Air Conditioning, Heating and Refrigeration Institute Test Standard
- ASHRAE – American Society of Heating, Refrigerating and Air Conditioning, Inc.
- EER – Energy Efficiency Ratio
- IEER – Integrated Energy Efficiency Ratio
- * – Model only available with 2-Speed indoor Fan Motor



NOTES

1. Rated and certified under AHRI Standard 340/360, as appropriate.
2. Ratings are based on:
Cooling Standard: 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 95°F db outdoor air temp.
3. All 558J units comply with ASHRAE 90.1 Energy Standard for minimum EER and IEER requirements.
4. Where appropriate, 558J units comply with US Energy Policy Act. Refer to state and local codes or visit the following website: <http://bcap-energy.org> to determine if compliance with this standard pertains to your state, territory, or municipality.

Table 3 – MINIMUM - MAXIMUM AIRFLOWS (CFM) COOLING AND ELECTRIC HEAT

Model Size	Nominal kW	COOLING				ELECTRIC HEATERS	
		Minimum Single Speed Fan Motor	Minimum 2-Speed Fan Motor (at high speed)	Minimum 2-Speed Fan Motor (at low speed)	Maximum	Minimum	Maximum
18	25	4500	5070	3346	7500	4500	7500
	50						
	75						
21	25	5250	5915	3904	9000	5200	9000
	50						
	75						
25	25	6000	7500	4950	10000	6000	10000
	50						
	75						
29	25	7500	8450	5577	12500	7000	12500
	50						
	75						

Table 4 – SOUND PERFORMANCE TABLE

MODEL SIZE	CLG STAGES	OUTDOOR SOUND (dB)									
		A-Wgt	AHRI 370 Rating	63	125	250	500	1000	2000	4000	8000
18	2	84.1	84	92.2	83.9	80.4	81.8	78.7	76.5	72.2	65.4
21	2	84.1	84	92.2	83.9	80.4	81.8	78.7	76.5	72.2	65.4
25	2	86.5	87	95.6	87.5	84.2	84.2	81.7	77.9	73.2	66.3
29	2	85.9	86	97.1	88.3	84.4	83.3	80.7	77.4	73.4	67.3

LEGEND

dB – Decibel



NOTES:

1. Outdoor sound data is measured in accordance with AHRI standard 270–2008.
2. Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environmental factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
3. A-weighted sound ratings filter out very high and very low frequencies, to better approximate the response of "average" human ear. A-weighted measurements for Bryant units are taken in accordance with AHRI standard 270–2008.

Table 5 – PHYSICAL DATA
RTPF (Round Tube/Plate Fin Coil Design)

(COOLING)

15-25 TONS

		558J*18D	558J*18K	558J*21D	558J*21K
Refrigeration System					
# Circuits / # Comp. / Type		2 / 2 / Scroll	2 / 2 / Scroll	2 / 2 / Scroll	2 / 2 / Scroll
R-410a charge A/B (lbs)		17/16.4	24.5/25.7	17.5/16.8	25.5/25.5
Metering device		TXV	TXV	TXV	TXV
High-press. Trip / Reset (psig)		630 / 505	630 / 505	630 / 505	630 / 505
Low-press. Trip / Reset (psig)		54 / 117	27 / 44	54 / 117	27 / 44
Material		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Tube Diameter		3/8" RTPF	3/8" RTPF	3/8" RTPF	3/8" RTPF
Rows / FPI		4 / 15	4 / 15	4 / 15	4 / 15
total face area (ft ²)		22	22	22	22
Condensate drain conn. size		3/4"	3/4"	3/4"	3/4"
Perfect Humidity Coil					
Material		n/a	Cu / Al	n/a	Cu / Al
Tube Diameter		n/a	3/8" RTPF	n/a	3/8" RTPF
Rows / FPI		n/a	1 / 17	n/a	1 / 17
total face area (ft ²)		n/a	22	n/a	22
Evap. fan and motor					
Standard Static	Motor Qty / Belt Qty / Driver Type	1/1/ Belt	1/1/ Belt	1/1/ Belt	1/1/ Belt
	Max BHP	2.2	2.2	3.3	3.3
	RPM range	514–680	514–680	622–822	622–822
	motor frame size	56	56	56	56
	Fan Qty / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
Medium Static	Fan Diameter (in)	18 x 15/15 X 11	18 x 15/15 X 11	18 x 15/15 X 11	18 x 15/15 X 11
	Motor Qty / Belt Qty / Driver Type	1/1/ Belt	1/1/ Belt	1/1/ Belt	1/1/ Belt
	Max BHP	3.3	3.3	4.9	4.9
	RPM range	614–780	614–780	713–879	713–879
	motor frame size	56	56	56	56
High Static	Fan Qty / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in)	18 x 15/15 X 11	18 x 15/15 X 11	18 x 15/15 X 11	18 x 15/15 X 11
	Motor Qty / Belt Qty / Driver Type	1/1/ Belt	1/1/ Belt	n/a	n/a
	Max BHP	4.9	4.9	n/a	n/a
	RPM range	746–912	746–912	n/a	n/a
High Static – High Eff	motor frame size	56	56	n/a	n/a
	Fan Qty / Type	2 / Centrifugal	2 / Centrifugal	n/a	n/a
	Fan Diameter (in)	18 x 15/15 X 11	18 x 15/15 X 11	n/a	n/a
	Motor Qty / Belt Qty / Driver Type	n/a	n/a	1/1/ Belt	1/1/ Belt
	Max BHP	n/a	n/a	6.5/ 6.9/ 7.0/ 8.3	6.5/ 6.9/ 7.0/ 8.3
	RPM range	n/a	n/a	882–1078	882–1078
	motor frame size	n/a	n/a	184T	184T
	Fan Qty / Type	n/a	n/a	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in)	n/a	n/a	18 x 15/15 X 11	18 x 15/15 X 11

Table 5 PHYSICAL DATA (cont.)
RTPF (Round Tube/Plate Fin Coil Design)

(COOLING)

15-25 TONS

		558J*25D	558J*25K	558J*29D	558J*29K
Refrigeration System					
# Circuits / # Comp. / Type		2 / 2 / Scroll			
R-410a charge A/B (lbs)		23.8/23.1	30.0/30.7	24.9/27.7	35.1/35.4
Metering device		TXV	TXV	TXV	TXV
High-press. Trip / Reset (psig)		630 / 505	630 / 505	630 / 505	630 / 505
Low-press. Trip / Reset (psig)		54 / 117	27 / 44	54 / 117	27 / 44
Material		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Tube Diameter		3/8" RTPF	3/8" RTPF	3/8" RTPF	3/8" RTPF
Rows / FPI		4 / 15	4 / 15	4 / 15	4 / 15
total face area (ft ²)		26	26	26	26
Condensate drain conn. size		3/4"	3/4"	3/4"	3/4"
Perfect Humidity Coil					
Material		n/a	Cu / Al	n/a	Cu / Al
Tube Diameter		n/a	3/8" RTPF	n/a	3/8" RTPF
Rows / FPI		n/a	1 / 17	n/a	1 / 17
total face area (ft ²)		n/a	26	n/a	26
Evap. fan and motor					
Standard Static	Motor Qty / Belt Qty / Driver Type	1/1/ Belt	1/1/ Belt	1/1/ Belt	1/1/ Belt
	Max BHP	4.9	4.9	4.9	4.9
	RPM range	690–863	690–863	647–791	647–791
	motor frame size	56	56	56	56
	Fan Qty / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
Medium Static – High Eff.	Fan Diameter (in)	18 x 15/15 X 11			
	Motor Qty / Belt Qty / Driver Type	1/1/ Belt	1/1/ Belt	1/1/ Belt	1/1/ Belt
	Max BHP	6.5/ 6.9/ 7.0/ 8.3	6.5/ 6.9/ 7.0/ 8.3	6.5/ 6.9/ 7.0/ 8.3	6.5/ 6.9/ 7.0/ 8.3
	RPM range	835–1021	835–1021	814–1009	814–1009
	motor frame size	184T	184T	184T	184T
High Static– High Eff.	Fan Qty / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in)	18 x 15/15 X 11			
	Motor Qty / Belt Qty / Driver Type	1/1/ Belt	1/1/ Belt	1/1/ Belt	1/1/ Belt
	Max BHP	10.5/11.9/11.9/11	10.5/11.9/11.9/11	10.5/11.9/11.9/11	10.5/11.9/11.9/11
	RPM range	941–1176	941–1176	965–1171	965–1171
	motor frame size	213T	213T	213T	213T
	Fan Qty / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in)	18 x 15/15 X 11			

Table 5 PHYSICAL DATA (cont.)
RTPF (Round Tube/Plate Fin Coil Design)

(COOLING)

15-25 TONS

	558J*18D	558J*18K	558J*21D	558J*21K	558J*25D	558J*25K	558J*29D	558J*29K
Cond. Coil (Circuit A)								
Coil type	RTPF							
Coil Length (in)	70	70	72	72	82	82	95	95
Coil Height (in)	44	44	44	44	52	52	52	52
Rows / FPI	2 /17	2 /17	2 /17	2 /17	2 /17	2 /17	2 /17	2 /17
total face area (ft2)	21.4	21.4	22.0	22.0	29.6	29.6	34.3	34.3
Cond. Coil (Circuit B)								
Coil type	RTPF							
Coil Length (in)	70	70	64	64	80	80	95	95
Coil Height (in)	44	44	44	44	52	52	52	52
Rows / FPI	2 /17	2 /17	2 /17	2 /17	2 /17	2 /17	2 /17	2 /17
total face area (ft2)	21.4	21.4	19.5	19.5	29.6	29.6	34.3	34.3
Cond. fan / motor								
Qty / Motor drive type	3 / direct	3 / direct	4 / direct	4 / direct	4/ direct	4/ direct	6 / direct	6 / direct
Motor HP / RPM	1/4 / 1100	1/4 / 1100	1/4 / 1100	1/4 / 1100	1/4 / 1100	1/4 / 1100	1/4 / 1100	1/4 / 1100
Fan diameter (in)	22	22	22	22	22	22	22	22
Filters								
RA Filter # / size (in)	6 / 20 x 25 x 2	9 / 16 x 25 x 2						
OA inlet screen # / size (in)	4 / 16 x 25 x 1							

DIMENSIONS

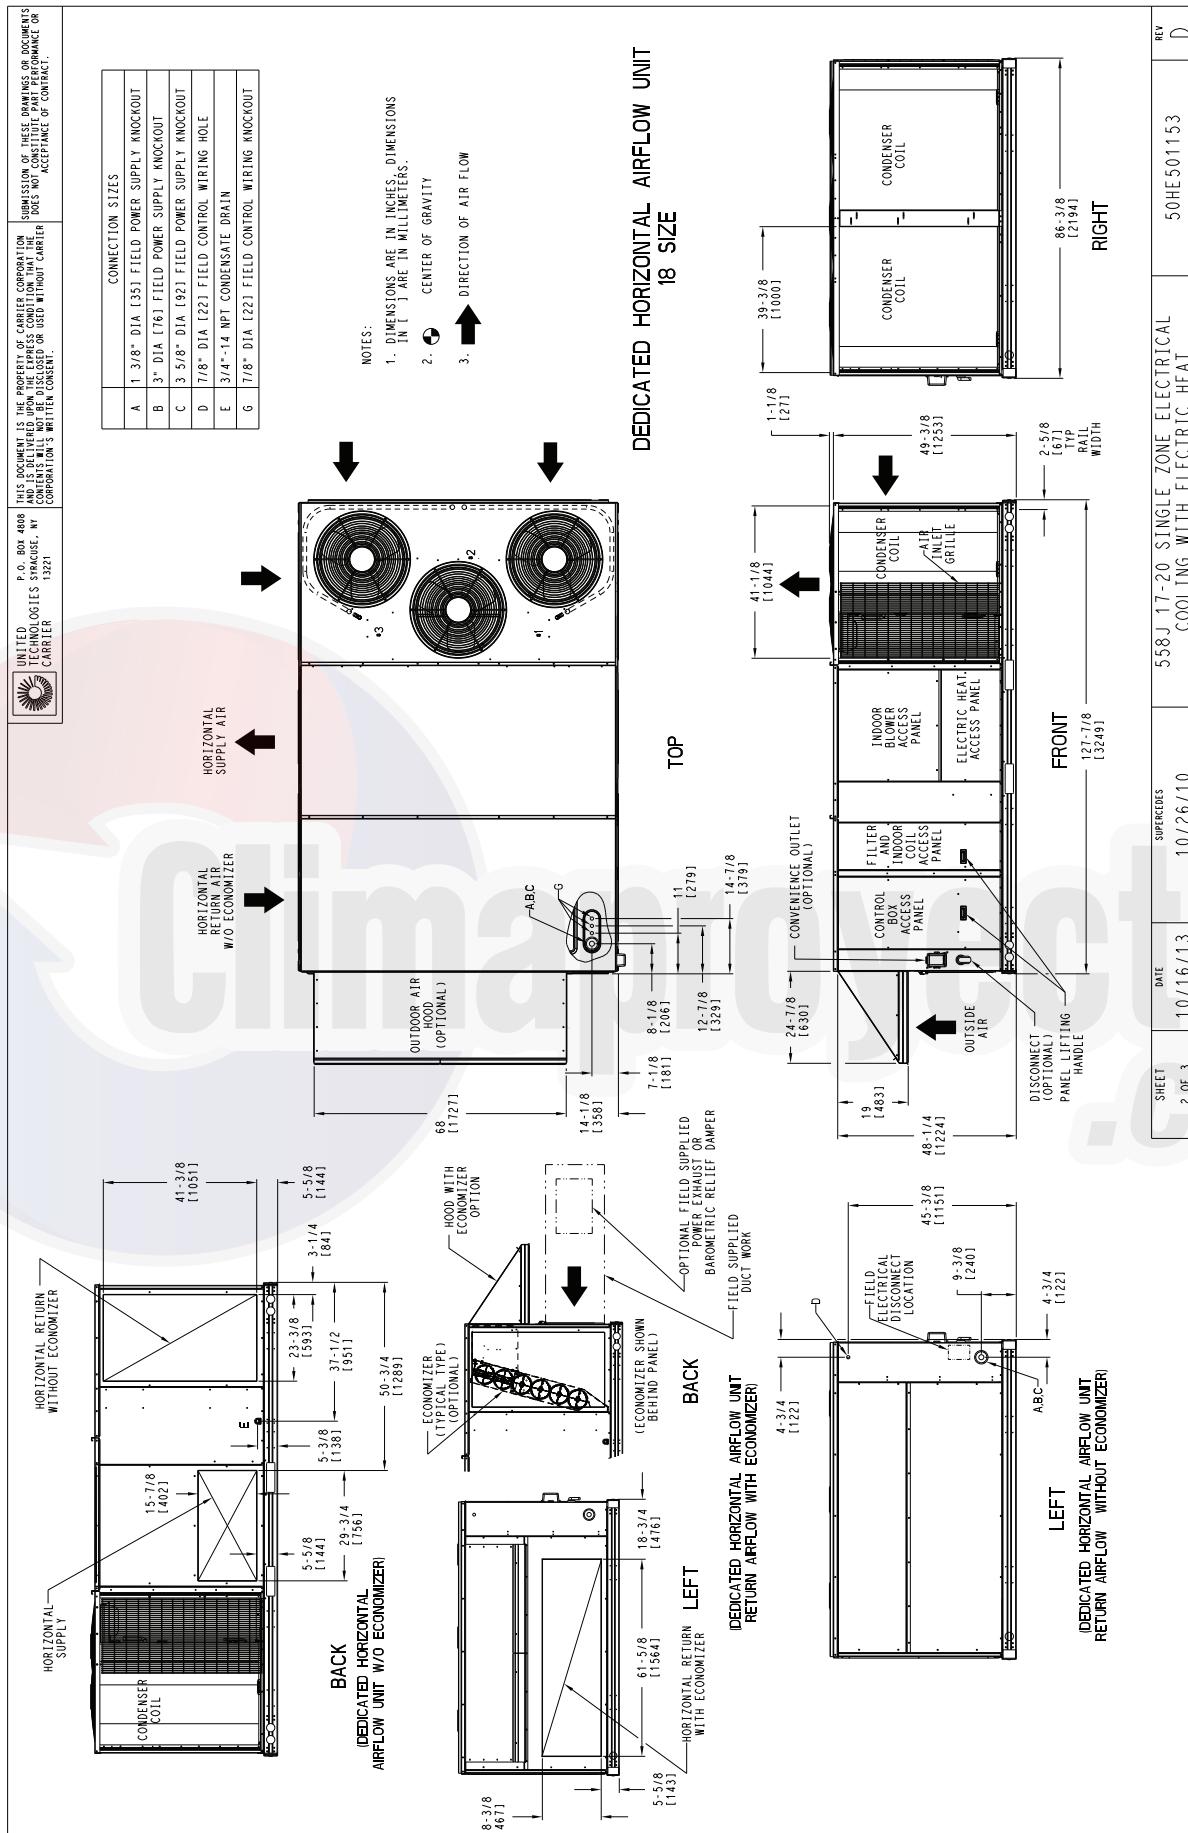


Fig. 2 - Unit Dimensional Drawing – 18 Size Unit

DIMENSIONS (cont.)

UNIT										UNIT										UNIT									
OUTDOOR COIL TYPE	STD. UNIT WEIGHT *	CORNER A WEIGHT (A)	CORNER B WEIGHT (B)	CORNER C WEIGHT (C)	CORNER D WEIGHT (D)	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.						
MCIX	16977	771	403	183	412	1.87	446	203	436	198	443	1.94	11371	64	314	116451	16	112	419	116451	16	112	419	116451	16	112	419		
MCIX	17112	778	407	185	415	1.89	450	204	440	200	443	1.94	11371	64	314	116451	16	112	419	116451	16	112	419	116451	16	112	419		
RIPF	1808	822	415	189	432	2.24	488	222	412	187	423	2.32	119901	69	1.4	117591	16	112	419	117591	16	112	419	117591	16	112	419		
RIPF	1793	815	375	170	419	1.91	528	240	412	214	468	2.19	11711	67	3.8	11711	16	112	419	11711	16	112	419	11711	16	112	419		
RIPF	1823	829	419	190	436	2.26	493	224	415	189	423	2.32	119901	69	1.4	117591	16	112	419	117591	16	112	419	117591	16	112	419		
RIPF - ROUND TUBE PLATE (IN COPPER/ALUM) MCIX - NOVATION (ALUM/ALUM)																													
* STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT AND WITHOUT PACKAGING. FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.																													

UNIT TECHNOLOGIES INC., P.O. BOX 4848, YONKERS, NY 10598
THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS HELD UPON THE EXPRESS CONDITION THAT THE SAME WILL NOT BE COPIED OR REPRODUCED IN WHOLE OR IN PART, OR USED WITHOUT CARRIER'S WRITTEN CONSENT.

Fig. 2 - Unit Dimensional Drawing – 18 Size Unit (cont.)

C13750

SHEET 3 OF 3	DATE 10/16/13	SUPERSEDES 10/26/10	558J 17-20 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50H501153	REV D
--------------	---------------	---------------------	--------------------------------------------------------------	-----------	-------

DIMENSIONS (cont.)

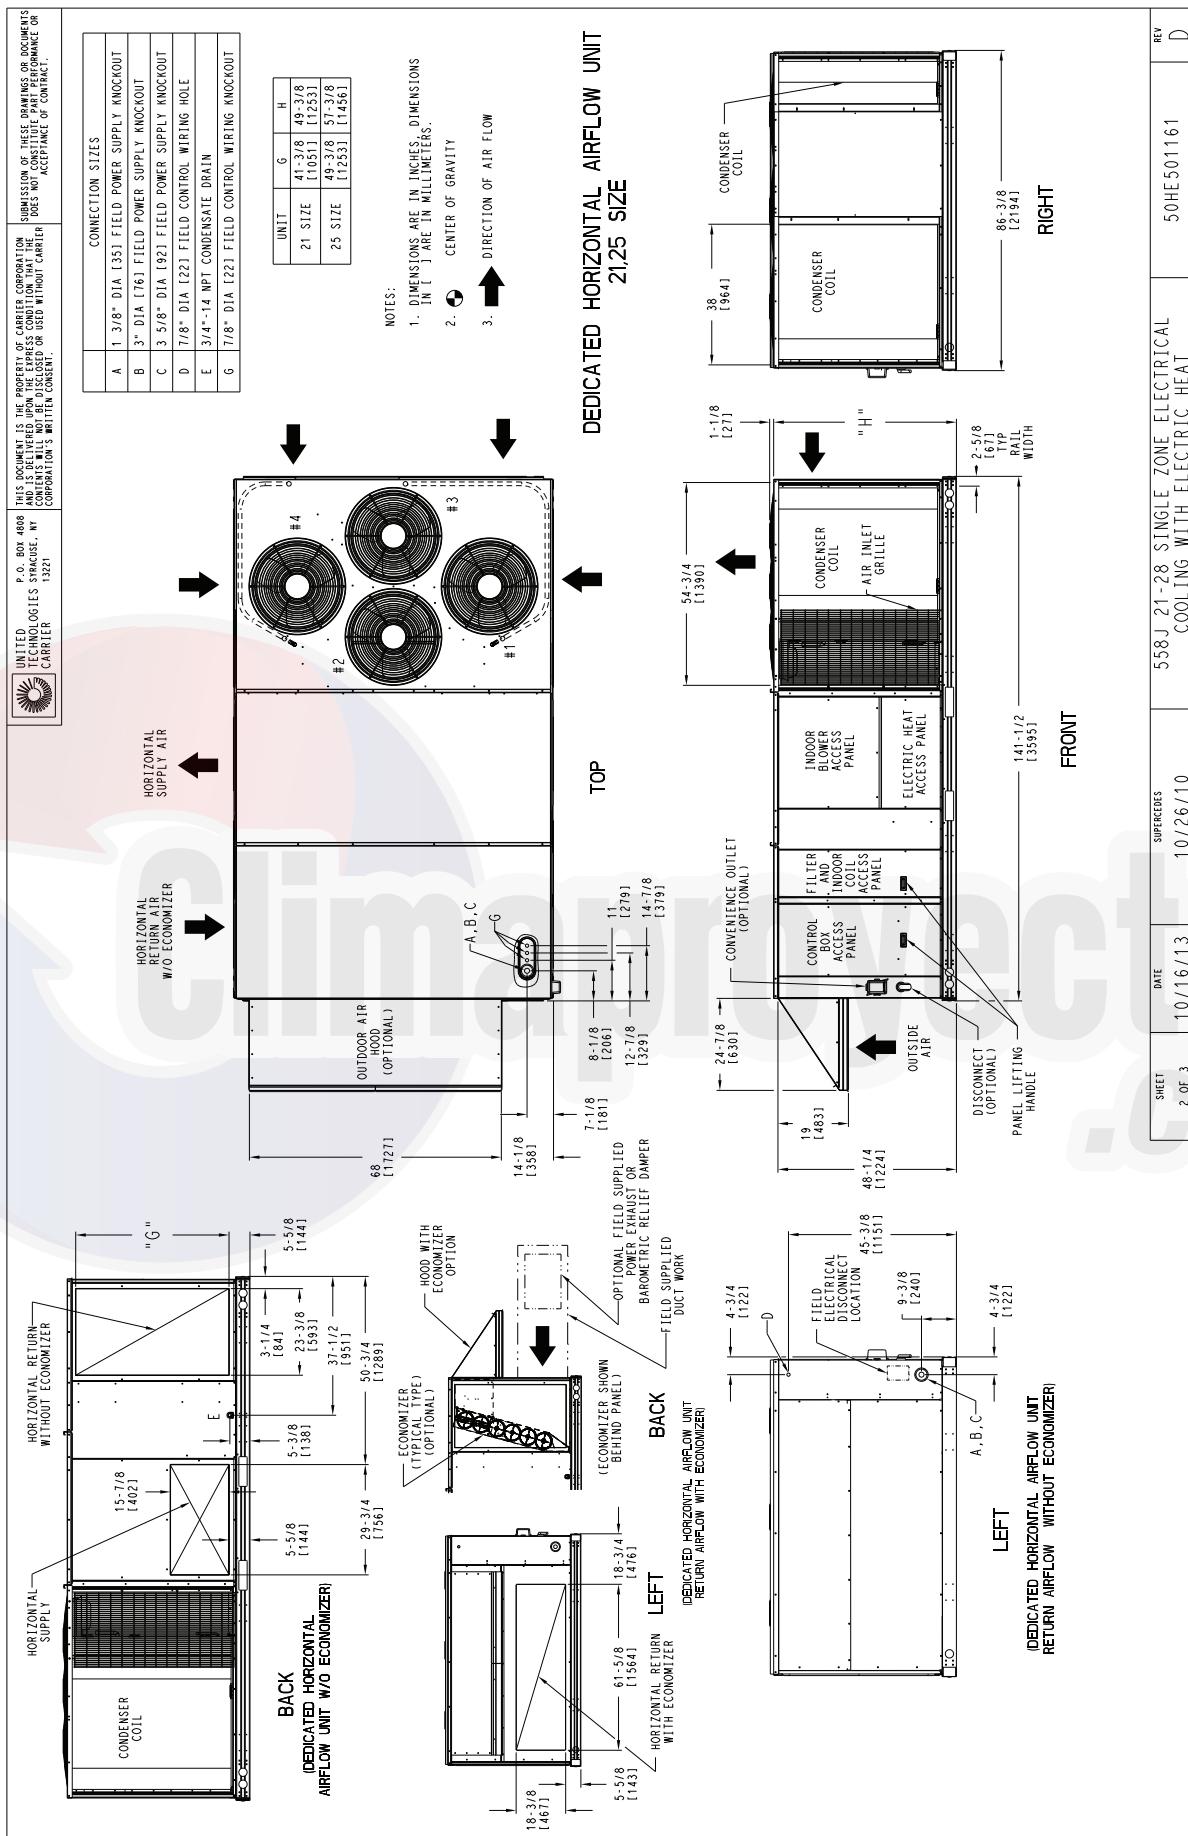


Fig. 3 - Unit Dimensional Drawing – 21 and 25 Size Units

C13755

DIMENSIONS (cont.)

UNITED TECHNOLOGIES CORPORATION P.O. BOX 4868 1321 CARRIER SACRAMENTO, CA 95821-4868										SUBMISSION OF THESE DRAWINGS OR DOCUMENTS AND SUBMISSION UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER'S ACCEPTANCE OF CONTRACT.		
UNIT	OUTDOOR COIL TYPE	STD. UNIT WEIGHT *	CORNER WEIGHT (A)	CORNER WEIGHT (B)	CORNER WEIGHT (C)	CORNER WEIGHT (D)	WEIGHT (E)	WEIGHT (F)	WEIGHT (G)	X	Y	Z
LBS.	KGS.	LBS.	KGS.	LBS.	KGS.	LBS.	KGS.	LBS.	KGS.			
558J-24	MCHX	846	384	174	541	246	624	284	443	201	46.78 [11172]	82.778 [2105]
558J-28	MCHX	1862	846	359	163	506	230	583	265	414	188	46.78 [11172]
558J-24	RTFF	1991	905	384	174	541	246	624	284	443	201	46.78 [11172]
558J-24	RTFF	2013	911	391	174	545	202	361	161	551	233	54.7 [1205]
558J-24	RTFF	1973	897	332	242	522	231	456	207	464	211	40.532 [11020]
558J-25	RTFF	2148	916	510	232	525	238	564	251	549	250	44.78 [11133]
558J-28	RTFF	2038	954	545	248	539	245	504	229	510	232	41.2132 [11058]
RTFF - ROUND TUBE, PLATE FIN COPPER/ALUMINUM										70	14 [1784]	19 [483]

* STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT AND WITHOUT PACKAGING.
FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

NCHX - NOVATION (ALUM/ALUM)

imaprojects.com

Fig. 3 - Unit Dimensional Drawing – 21 and 25 Size Units (cont.)

C13756

DIMENSIONS (cont.)

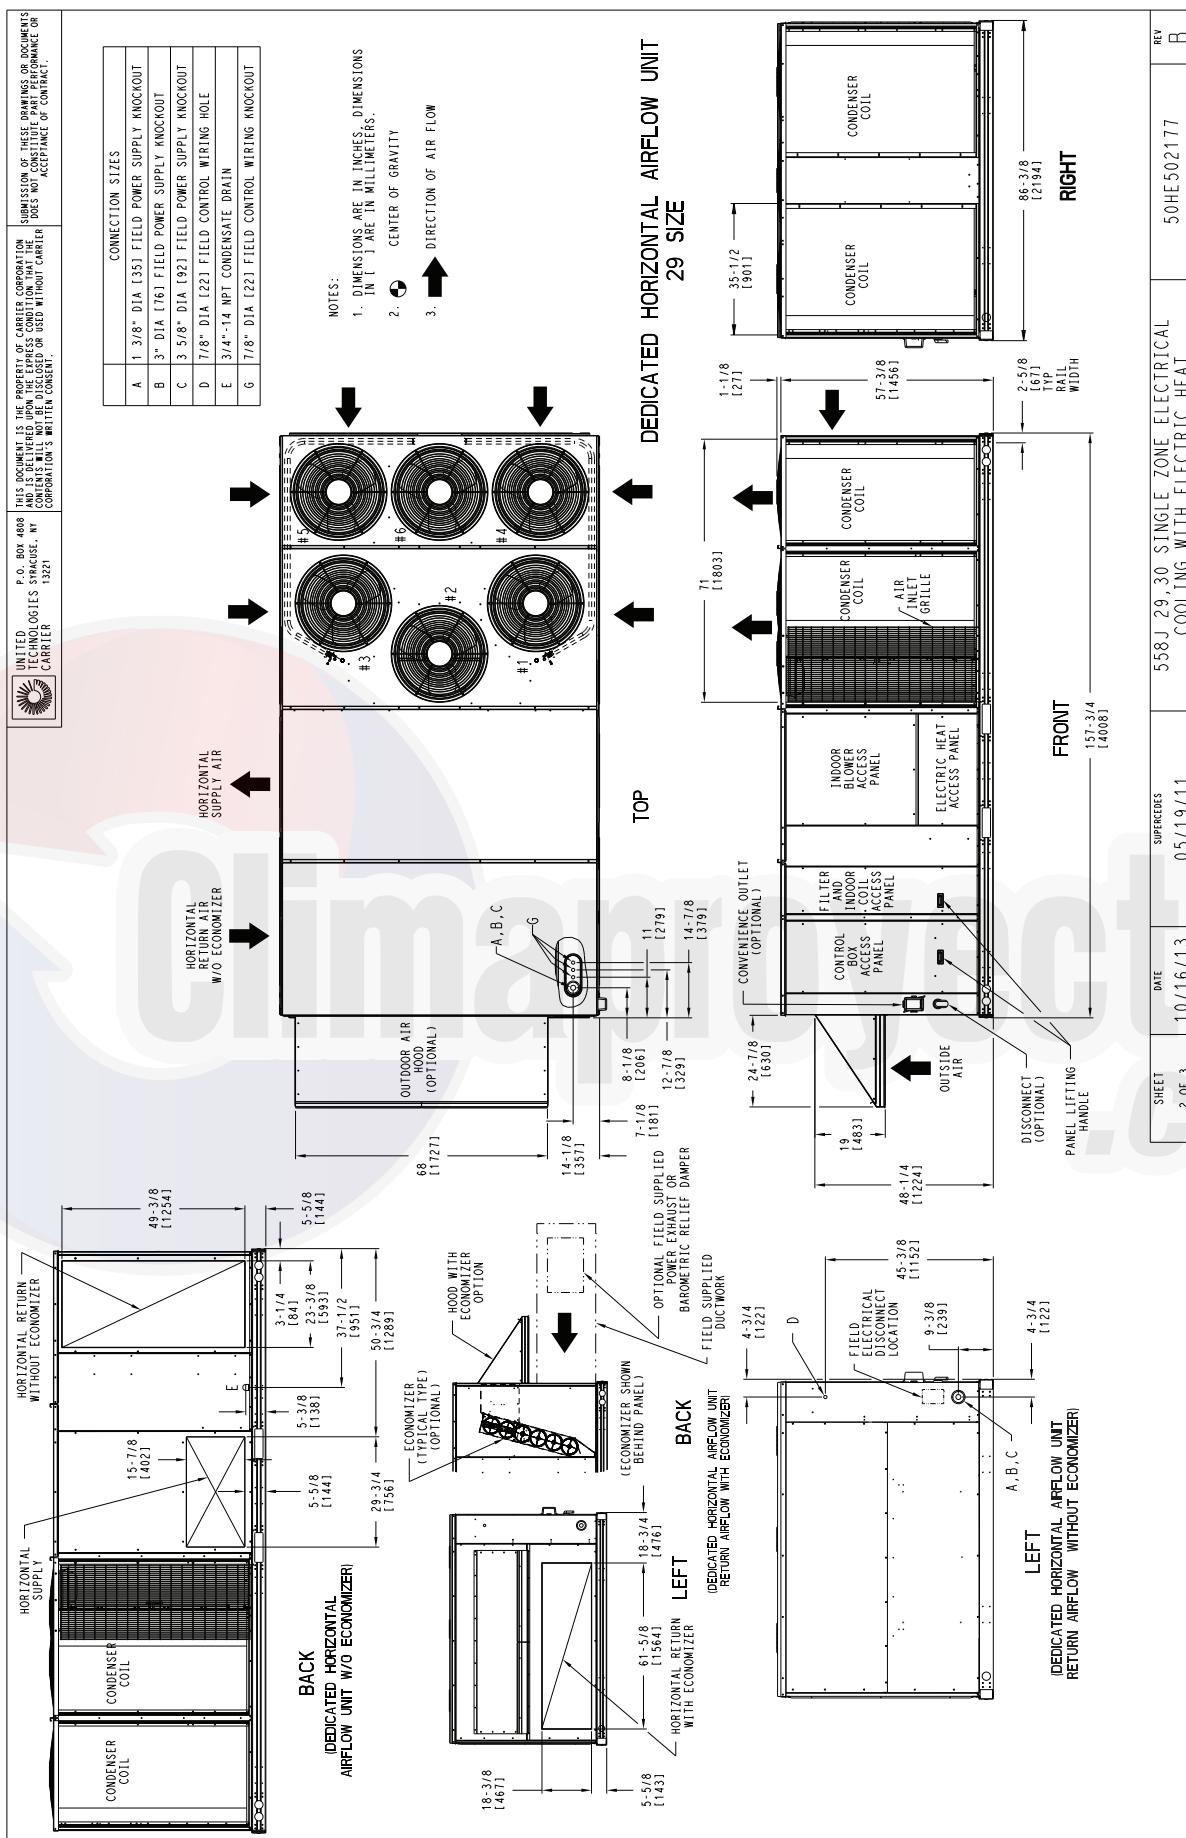


Fig. 4 - Unit Dimensional Drawing – 29 Size Unit

C13761

SHEET	DATE	SUPERSEDES	558J 29-30 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	REV
2 OF 3	10/16/13	05/19/11	50H502177	B

DIMENSIONS (cont.)


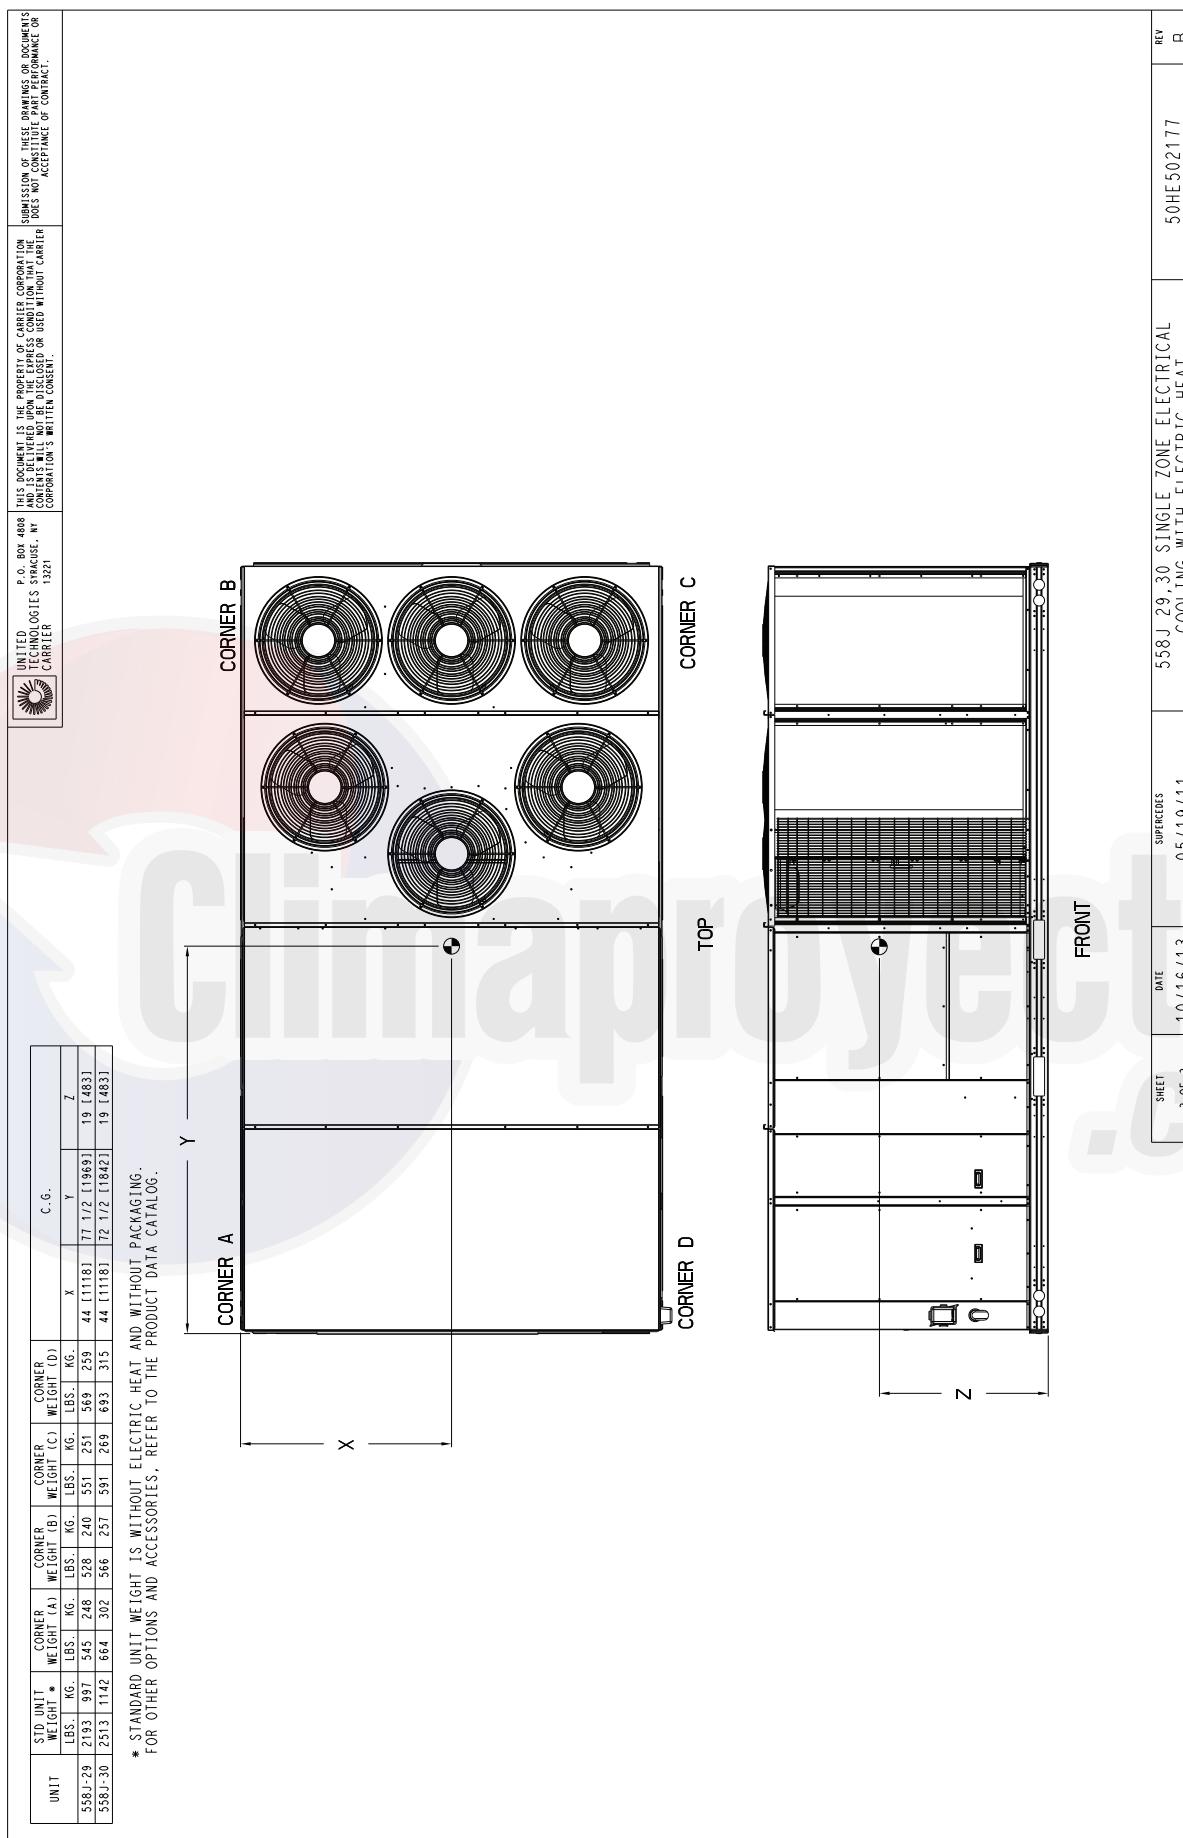


Fig. 4 - Unit Dimensional Drawing – 29 Size Unit (cont.)

C13762

DIMENSIONS (cont.)

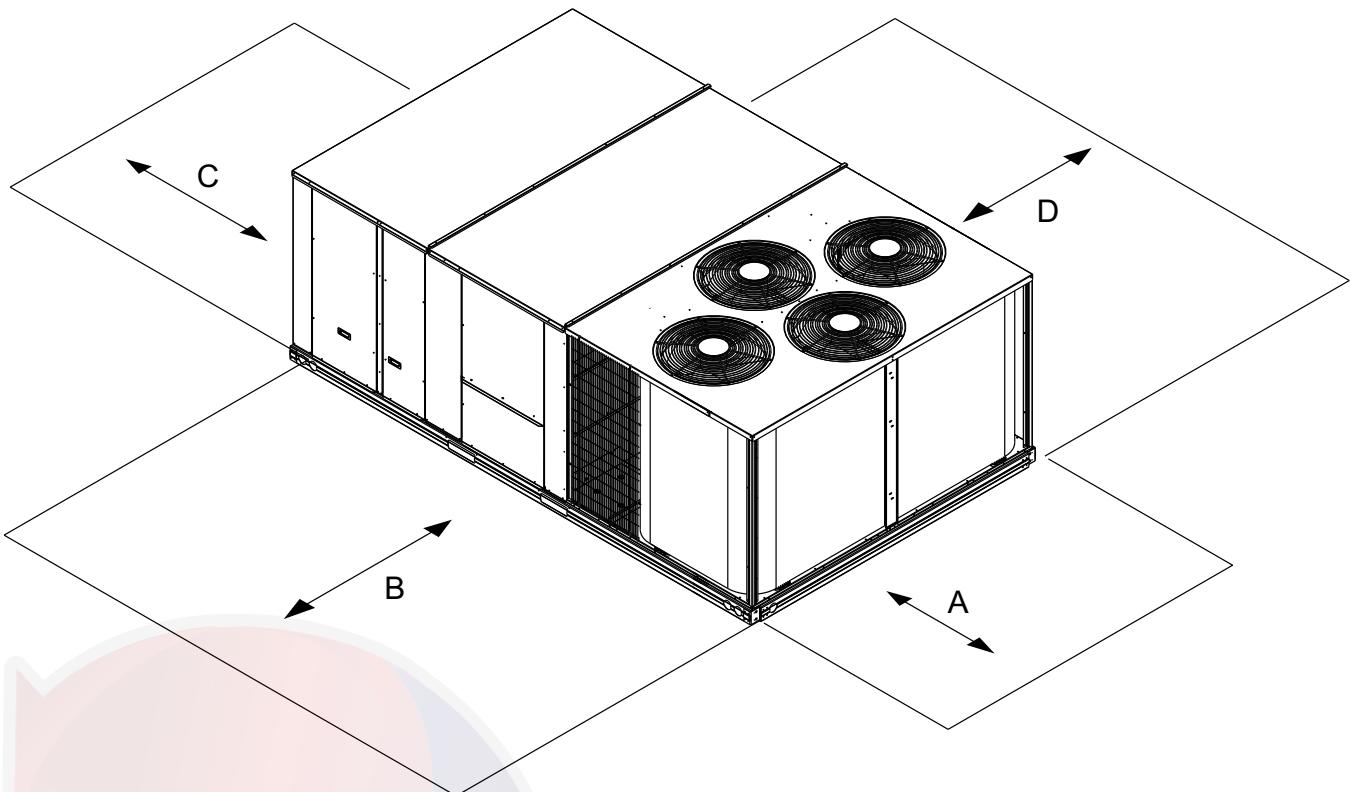

C12392

LOCATION	DIMENSION	CONDITION
A	36-in (914 mm)	<ul style="list-style-type: none"> Recommended clearance for air flow and service
B	42-in (1067 mm)	<ul style="list-style-type: none"> Recommended clearance for air flow and service
C	18-in (457 mm)	<ul style="list-style-type: none"> No Convenience Outlet No Economizer No field installed disconnect on economizer hood side (Factory-installed disconnect installed).
	36-in (914 mm)	<ul style="list-style-type: none"> Convenience Outlet installed. Vertical surface behind servicer is electrically non-conductive (e.g.: wood, fiberglass).
	42-in (1067 mm)	<ul style="list-style-type: none"> Convenience Outlet installed. Vertical surface behind servicer is electrically conductive (e.g.: metal, masonry).
	96-in (2438 mm)	<ul style="list-style-type: none"> Economizer and/or Power Exhaust installed. Check for sources of flue products with 10 feet (3 meters) of economizer fresh air intake.
D	42-in (1067 mm)	<ul style="list-style-type: none"> Recommended clearance for service.

NOTE: Unit not designed to have overhead obstruction. Contact Application Engineering for guidance on any application planning overhead obstruction or for vertical clearances.



Fig. 5 - Service Clearance Dimensional Drawing

Table 6 – Operating Weights

558J*	UNIT LB (KG)			
	18	21	25	29
Base Unit	1793 (815)	2003 (911)	2148 (976)	2193 (997)
Economizer	246 (112)	246 (112)	246 (112)	246 (112)
Powered Outlet	35 (16)	35 (16)	35 (16)	35 (16)
Perfect Humidity System	110 (50)	120 (54)	120 (54)	120 (54)
Curb				
14-in/356 mm	240 (109)	255 (116)	255 (116)	255 (116)
24-in/610 mm	340 (154)	355 (161)	355 (161)	355 (161)


DIMENSIONS (cont.)

UNIT SIZE	"A"	ROOF CURB ACCESSORY
18	1'-2" [356.0] 2'-0" [610.0]	CRRFCURB045A00 CRRFCURB046A00

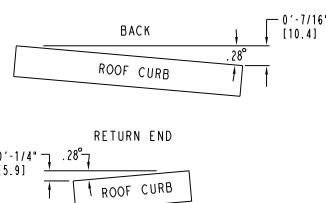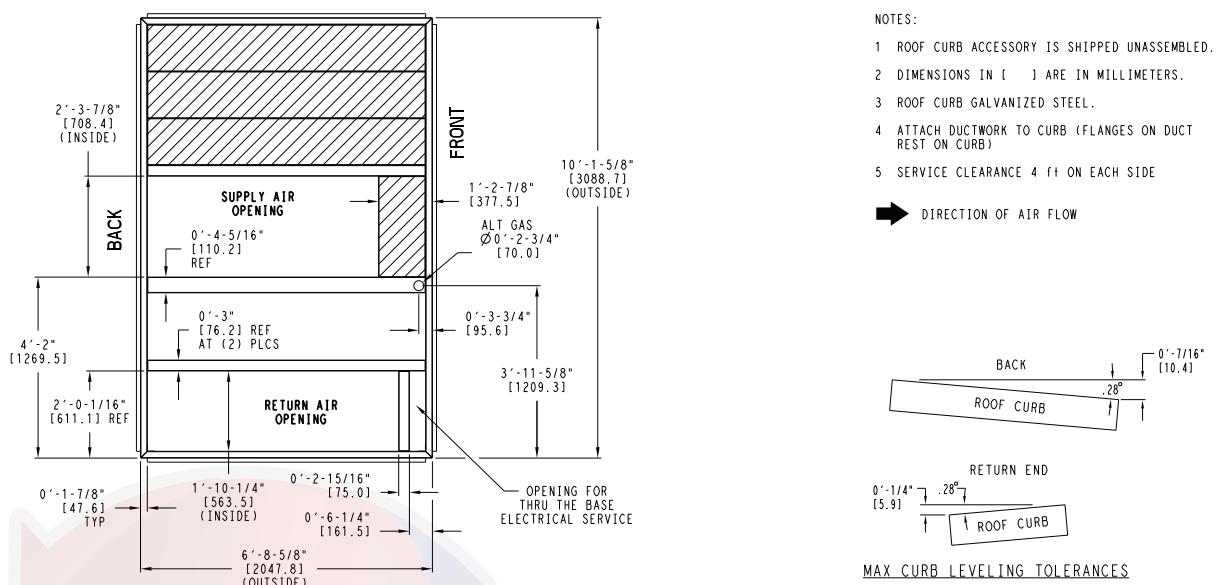

RETURN END
0'-1/4" [5.9] .28°
ROOF CURB

MAX CURB LEVELING TOLERANCES

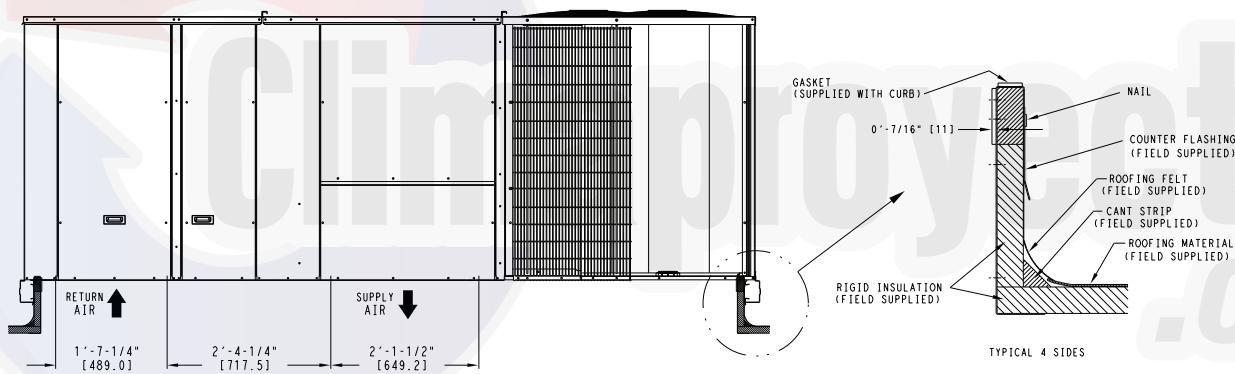

TYPICAL 4 SIDES



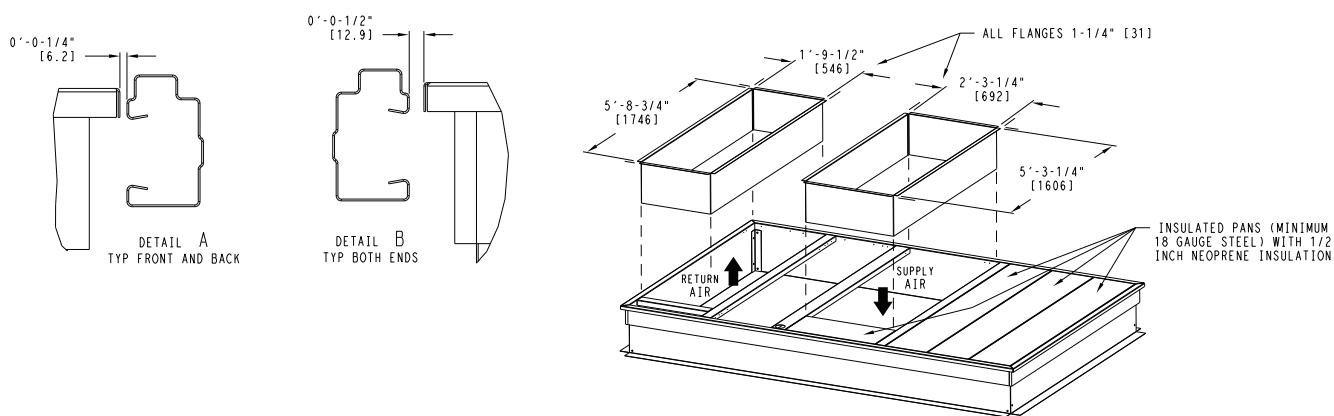


Fig. 6 - Roof Curb Details – 18 Size Unit

C13780


DIMENSIONS (cont.)

UNIT SIZE	"A"	ROOF CURB ACCESSORY
21,25	1'-2" [356.0] 2'-0" [610.0]	CRRFCURB047A00 CRRFCURB048A00

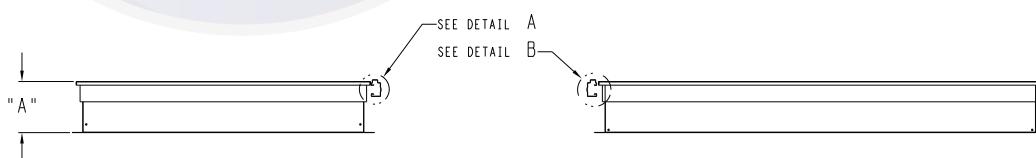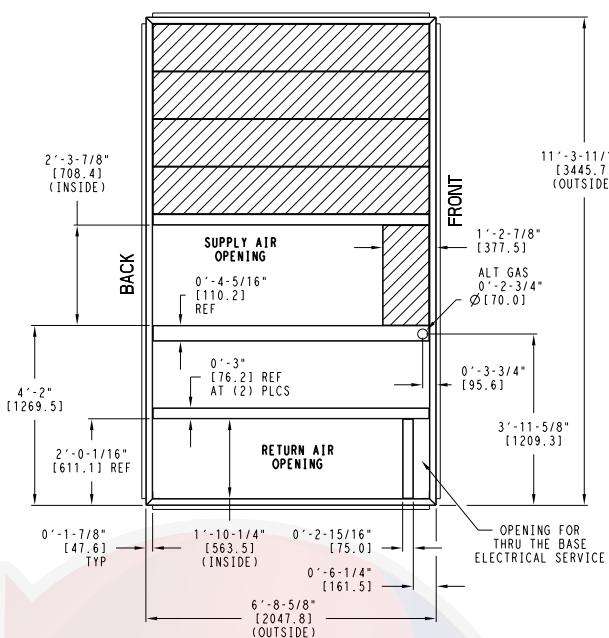

NOTES:
 1. ROOF CURB ACCESSORY IS SHIPPED UNASSEMBLED.
 2. DIMENSIONS IN [] ARE IN MILLIMETERS.
 3. ROOF CURB GALVANIZED STEEL.
 4. ATTACH DUCTWORK TO CURB (FLANGES ON DUCT REST ON CURB)
 5. SERVICE CLEARANCE 4 ft ON EACH SIDE

→ DIRECTION OF AIR FLOW

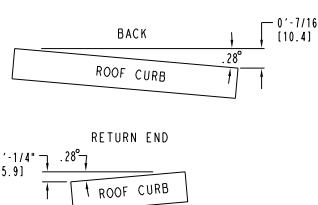

MAX CURB LEVELING TOLERANCES






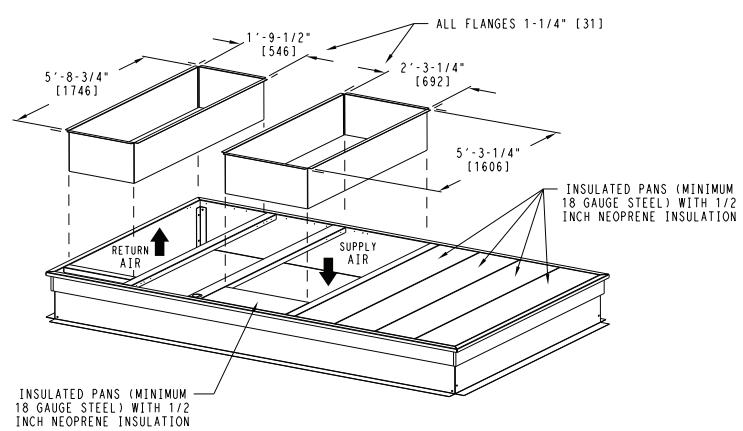


Fig. 7 - Roof Curb Details – 21 and 25 Size Units

DIMENSIONS (cont.)

UNIT SIZE	"A"	ROOF CURB ACCESSORY
29	1'-2" [356.0] 2'-0" [610.0]	CRRFCURB049A00 CRRFCURB050A00

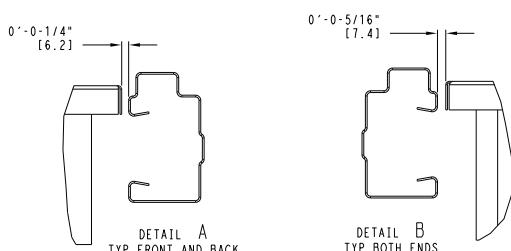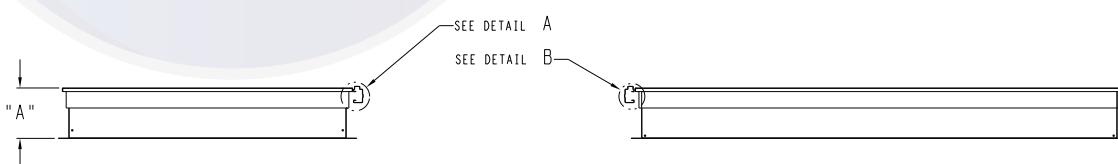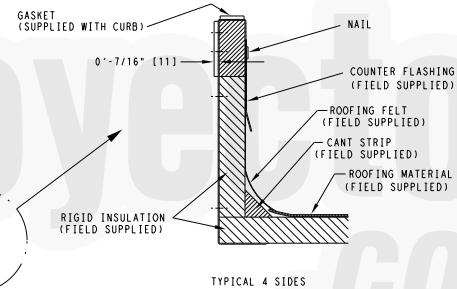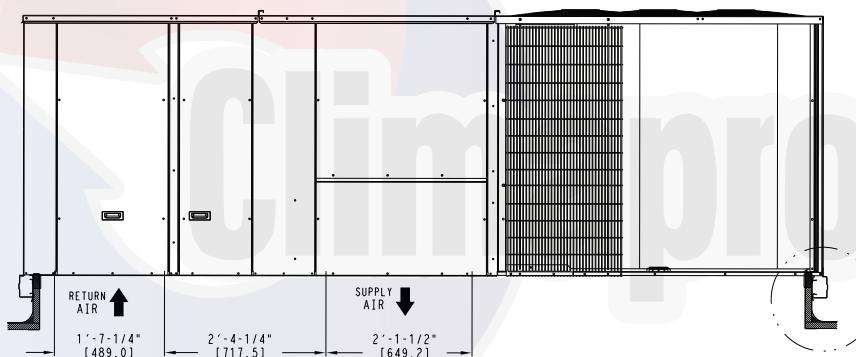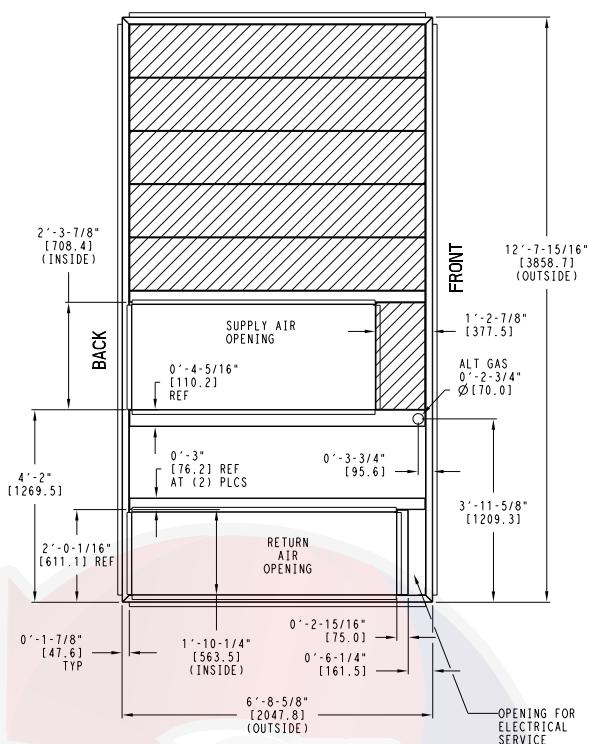

NOTES:
1 ROOF CURB ACCESSORY IS SHIPPED UNASSEMBLED.

2 BOLT HEADS TO BE ON INSIDE OF FLANGE.
CLEARANCE IS [11] 0-0-7/16" TYP ALL CORNERS.

3 DIMENSIONS IN [] ARE IN MILLIMETERS.

4 ROOF CURB GALVANIZED STEEL.



5 ATTACH DUCTWORK TO CURB (FLANGES ON DUCT
REST ON CURB)

6 SERVICE CLEARANCE 4 ft ON EACH SIDE




7 GAS SERVICE PLATE IS PART OF A SEPARATELY
SHIPPED ACCESSORY PACKAGE.

8 GAS SERVICE PLATE CAN BE USED WITH EITHER
ACCESSORY ROOFCURB.

► DIRECTION OF AIR FLOW



MAX CURB LEVELING TOLERANCES

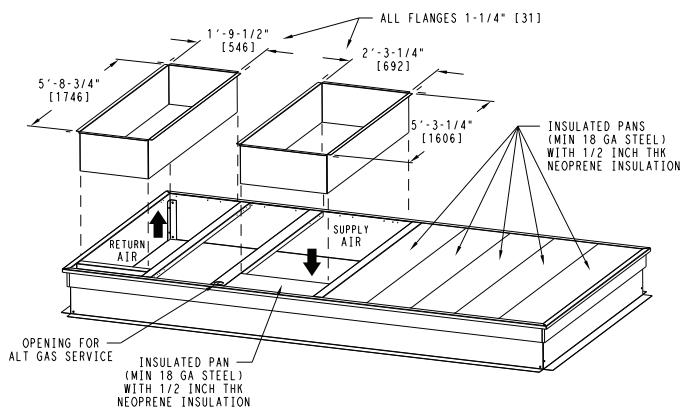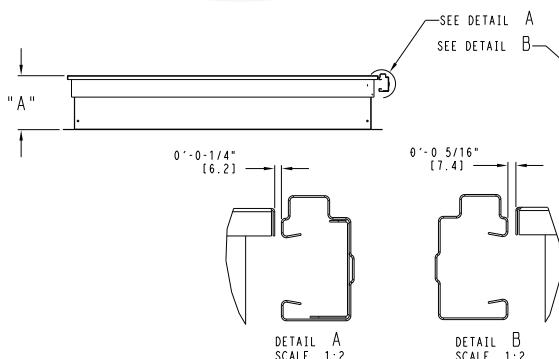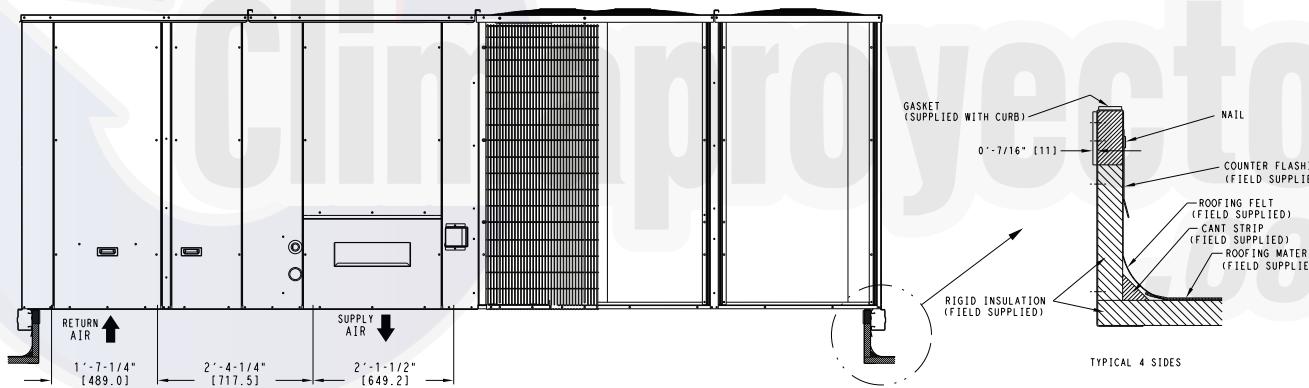

C13782

Fig. 8 - Roof Curb Details – 29 Size Unit

OPTIONS AND ACCESSORIES WEIGHT ADDERS

BASE UNIT WITH OPTIONS AND ACCESSORIES (Weight Adders)	MAX WEIGHT ADD							
	558J*18		558J*21		558J*25		558J*29	
	lb	kg	lb	kg	lb	kg	lb	kg
Perfect Humidity*	110	50	120	55	120	55	120	55
Base Unit Operating Weight	1793	813	2003	909	2148	974	2193	975
Power Exhaust	125	57	125	57	125	57	125	57
Economizer	246	112	246	112	246	112	246	112
Copper Tube/Fin Evaporator Coil	53	24	58	26	64	29	64	29
Electric Heater	85	39	85	39	85	39	85	39
Single Point Kit	15	7	15	7	15	7	15	7
Roof Curb 14-in (356mm)	240	109	255	116	255	116	255	116
Roof Curb 24-in (610mm)	340	154	355	161	355	161	355	161
Louvered Hail Guard	60	27	60	27	120	54	150	68
CO ₂ sensor	5	2	5	2	5	2	5	2
Return Smoke Detector	5	2	5	2	5	2	5	2
Supply Smoke Detector	5	2	5	2	5	2	5	2
Fan/Filter Status Switch	2	1	2	1	2	1	2	1
Non-Fused Disconnect	15	7	15	7	15	7	15	7
Powered Convenience Outlet	35	16	35	16	35	16	35	16
Non-Powered Convenience Outlet	5	2	5	2	5	2	5	2
Enthalpy Sensor	2	1	2	1	2	1	2	1
Differential Enthalpy Sensor	3	1	3	1	3	1	3	1
Two Position Motorized Damper	50	23	50	23	50	23	65	29
Manual Damper	35	16	35	16	35	16	40	18
Field Filter Track 4-in (102mm)	12	5	12	5	12	5	12	5
MotorMaster Controller	39	18	39	18	39	18	39	18
Standard Static Motor/Drive	0	0	0	0	0	0	0	0
Medium Static Motor/Drive	5	2	6	3	6	3	6	3
High Static Motor/Drive	11	5	12	5	16	7	16	7
Barometric Relief Hood (Horizontal)	25	11	25	11	25	11	25	11
2-Speed Indoor Fan Motor System with VFD	20	9	20	9	20	9	20	9

* For Perfect Humidity add MotorMaster Controller

APPLICATION/SELECTION DATA

Min operating ambient temp (cooling):

In mechanical cooling mode, your Bryant rooftop can safely operate down to an outdoor ambient temperature of 35°F (2°C). It is possible to provide cooling at lower outdoor ambient temperatures by using less outside air, economizers, and/or accessory low ambient kits.

Max operating ambient temp (cooling):

The maximum operating ambient temperature for cooling mode is 115°F (46°C). While cooling operation above 115°F (46°C) may be possible, it could cause either a reduction in performance, reliability, or a protective action by the unit's internal safety devices.

Min and max airflow (cooling mode):

To maintain safe and reliable operation of your rooftop, operate within the cooling airflow limits. Operating above the max may cause blow-off, undesired airflow noise, or airflow related problems with the rooftop unit. Operating below the min may cause problems with coil freeze-up.

Airflow:

All units are draw-through in cooling mode.

Outdoor air application strategies:

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match application changing needs. In fact, they should be considered for most applications. Also, consider the various economizer control methods and their benefits, as well as sensors required to accomplish your application goals. Please contact your local Bryant representative for assistance.

Motor limits, break horsepower (BHP):

Due to Bryant's internal unit design, air path, and specially designed motors, the full horsepower (maximum continuous BHP) band, as listed in Table 5, can be used with the utmost confidence. There is no need for extra safety factors, as Bryant's motors are designed and rigorously tested to use the entire, listed BHP range without either nuisance tripping or premature motor failure.

APPLICATION/SELECTION DATA (cont.)

Sizing a rooftop

Bigger isn't necessarily better. While an air conditioner needs to have enough capacity to meet the load, it doesn't need excess capacity. In fact, having excess capacity typically results in very poor part load performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location, adding "safety factors" to the calculated load, and rounding up to the next largest unit, are all signs of oversizing air conditioners. Oversizing can cause short-cycling, and short cycling leads to poor humidity control, reduced efficiency, higher utility bills, drastic indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, wise contractors and engineers "right-size" or even slightly undersize air conditioners. Correctly sizing an air conditioner controls humidity better; promotes efficiency; reduces utility bills; extends equipment life, and maintains even, comfortable temperatures.

Low ambient applications

When equipped with a Bryant economizer, your rooftop unit can cool your space by bringing in fresh, cool outside air. In fact, when so equipped, accessory low-ambient kit may not be necessary. In low ambient conditions, unless the outdoor air is excessively humid or contaminated, economizer-based "free cooling" is the preferred less costly and energy conscious method.

In low ambient applications where outside air might not be desired (such as contaminated or excessively humid outdoor environments), your Bryant rooftop can operate to ambient temperatures down to -20°F (-29°C) using the recommended accessory Motormaster low ambient controller.

Winter start

Bryant's winter start kit extends the low ambient limit of your rooftop to 25°F (-4°C). The kit bypasses the low pressure switch, preventing nuisance tripping of the low pressure switch. Other low ambient precautions may still be prudent.

Application/Selection Option

Selection software by Bryant saves time by performing many of the steps above. Contact your Bryant sales representative for assistance.

2-Speed Indoor Fan Motor with Variable Frequency Drive (VFD)

Bryant's 2-Speed Indoor Fan Motor System utilizes a Variable Frequency Drive (VFD) to automatically adjust the indoor fan motor speed in sequence with the units cooling operation. Per ASHRAE 90.1 2010 standard section 6.4.3.10.b, during the first stage of cooling operation the VFD will adjust the fan motor to provide 2/3rd of the total cfm established for the unit. When a call for the second stage of cooling is required, the VFD will allow the total cfm for the unit established (100%). During the heating mode, the VFD will allow total design cfm (100%) operation and during the ventilation mode the VFD will allow operation to 2/3rd of total cfm.

The VFD used in Bryant's 2-Speed Indoor Fan Motor System has soft start capabilities to slowly ramp up the speeds, thus eliminating any high inrush air volume during initial start-up. It also has internal over current protection for the fan motor and a field installed display kit that allows adjustment and in depth diagnostics of the VFD.

This 2-Speed Indoor Fan Motor System is available on models with 2-stage cooling operation with electrical mechanical or RTU Open (multi Protocol) controls. Both space sensor and conventional thermostats controls can be used to provide accurate control in any application.

The 2-Speed Indoor Fan Motor System is very flexible for initial fan performance set up and adjustment. The standard factory shipped VFD is pre programmed to automatically stage the fan speed between the first and second stage of cooling. The unit fan performance static pressure and cfm can be easily adjusted using the traditional means of pulley adjustments. The other means to adjust the unit static and cfm performance is to utilize the field installed display module and adjust the frequency and voltage in the VFD to required performance requirements. In either case, once set up the VFD will automatically adjust the speed between the cooling stage operation.

Table 8 – COOLING CAPACITIES

2-STAGE COOLING

15 TONS (cont.)

558J*18K (15 TONS) – UNIT WITH PERFECT HUMIDITY IN SUBCOOLING MODE										
Temp (F) Air Entering Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		4,500			6,000			7,500		
		Air Entering Evaporator -- Ewb (F)								
75	TC	202.9	184.6	166.2	213.7	194.6	175.4	222.3	202.5	182.7
	SHC	91.9	112.4	132.9	106.1	126.4	146.8	117.5	137.7	158.0
	kW	10.19	10.12	9.78	10.51	10.19	9.95	10.61	10.36	10.12
85	TC	189.8	171.8	153.8	201.0	182.2	163.3	209.9	190.4	170.8
	SHC	75.9	101.0	126.2	91.2	116.3	141.3	103.4	128.4	153.5
	kW	11.57	11.49	11.15	11.88	11.56	11.32	11.98	11.73	11.49
95	TC	176.7	159.1	141.4	188.3	169.7	151.2	197.5	178.2	159.0
	SHC	59.8	89.7	119.6	76.2	106.1	135.9	89.4	119.2	149.0
	kW	12.87	12.81	12.47	13.20	12.88	12.64	13.30	13.05	12.81
105	TC	163.6	146.3	129.0	175.6	157.3	139.1	185.1	166.1	147.1
	SHC	43.8	78.4	112.9	61.3	95.9	130.4	75.3	109.9	144.4
	kW	14.05	14.00	13.65	14.39	14.07	13.82	14.40	14.24	14.00
115	TC	150.5	133.5	116.5	162.9	144.9	127.0	172.7	154.0	135.3
	SHC	27.7	67.0	106.3	46.4	85.7	125.0	61.3	100.6	133.4
	kW	15.44	15.36	15.02	15.75	15.43	15.19	15.85	15.60	15.36

558J*18K (15 TONS) – UNIT WITH PERFECT HUMIDITY IN HOT GAS REHEAT MODE										
Temp (F) Air Entering Condenser (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb		
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb		
		(50% Relative)			(56% Relative)			(60% Relative)		
Air Entering Evaporator – Cfm										
		4,500	6,000	7,500	4,500	6,000	7,500	4,500	6,000	7,500
80	TC	64.50	71.00	73.30	68.40	74.50	77.30	71.20	79.70	80.60
	SHC	12.60	24.90	36.80	6.80	13.70	23.90	-0.80	5.50	13.80
	kW	10.10	10.26	10.42	10.18	10.40	10.56	10.33	10.47	10.67
75	TC	66.60	73.10	75.60	70.50	76.60	79.50	73.20	80.80	82.90
	SHC	14.30	26.70	38.50	8.10	14.90	25.70	0.70	7.00	15.00
	kW	10.05	10.22	10.36	10.14	10.36	10.52	10.28	10.43	10.62
70	TC	68.70	75.10	77.40	72.50	78.60	81.40	75.20	82.80	84.90
	SHC	15.40	27.80	40.00	9.50	16.20	26.80	2.10	8.40	16.30
	kW	10.00	10.18	10.33	10.10	10.31	10.47	10.23	10.40	10.58
60	TC	72.80	79.30	81.60	76.70	82.80	85.70	79.40	86.90	88.80
	SHC	19.00	31.10	43.20	12.70	19.90	30.10	5.30	11.60	20.00
	kW	9.92	10.09	10.24	10.01	10.22	10.37	10.14	10.31	10.49
50	TC	76.80	83.40	85.70	80.80	86.90	89.70	83.50	90.90	92.80
	SHC	21.70	34.20	46.20	15.80	22.70	33.20	8.40	14.70	22.80
	kW	9.83	10.00	10.15	9.92	10.13	10.29	10.05	10.21	10.39
40	TC	80.90	87.30	89.60	84.90	90.80	93.60	87.40	94.80	96.70
	SHC	24.90	37.10	49.30	19.00	26.00	36.10	11.60	17.90	26.20
	kW	9.74	9.91	10.06	9.83	10.04	10.20	9.96	10.12	10.30

LEGEND

- Edb** – Entering Dry-Bulb
Ewb – Entering Wet-Bulb
kW – Compressor Motor Power Input
ldb – Leaving Dry-Bulb
lwb – Leaving Wet-Bulb
SHC – Sensible Heat Capacity (1000 Btuh) Gross
TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.

2. The following formulas may be used:

$$t_{\text{ldb}} = t_{\text{edb}} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

$t_{\text{lwb}} = \text{Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (}h_{\text{lwb}}\text{)}$

$$h_{\text{lwb}} = h_{\text{ewb}} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 10 – COOLING CAPACITIES

2-STAGE COOLING

17.5 TONS (cont.)

558J*21K (17.5 TONS) – UNIT WITH PERFECT HUMIDITY IN SUBCOOLING MODE										
Temp (F) Air Entering Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		5,250			7,000			8,750		
		Air Entering Evaporator – Ewb (F)								
72	67	62	72	67	62	72	67	62		
75	TC	232.0	211.3	190.6	242.4	221.0	199.7	250.7	228.9	207.0
	SHC	110.9	133.7	156.4	127.6	150.3	173.0	141.1	163.7	186.4
	kW	12.45	12.16	11.81	12.74	12.41	12.02	12.93	12.51	12.18
85	TC	215.9	195.7	175.5	226.0	205.2	184.4	234.2	212.8	191.5
	SHC	90.6	118.8	147.0	108.4	136.6	164.9	122.7	151.0	179.2
	kW	13.48	13.20	12.88	13.77	13.47	13.07	13.96	13.58	13.23
95	TC	199.7	180.0	160.3	209.7	189.4	169.1	217.6	196.8	176.1
	SHC	70.3	104.0	137.7	89.2	123.0	156.7	104.4	138.2	172.1
	kW	14.60	14.25	13.94	14.89	14.51	14.15	15.08	14.63	14.31
105	TC	183.6	164.5	145.2	193.3	173.5	153.8	201.0	180.8	160.6
	SHC	50.0	89.1	128.3	70.0	109.3	148.6	86.0	125.5	158.6
	kW	15.64	15.36	15.-01	15.93	15.60	15.21	16.12	15.72	15.37
115	TC	167.5	148.8	130.1	176.9	157.7	138.5	184.5	164.8	145.1
	SHC	29.7	74.3	118.9	50.7	95.6	138.1	67.7	112.7	145.1
	kW	16.70	16.38	15.82	16.98	16.63	16.03	17.17	16.75	16.19

558J*21K (17.5 TONS) – UNIT WITH PERFECT HUMIDITY IN HOT GAS REHEAT MODE										
Temp (F) Air Entering Condenser (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb		
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb		
		(50% Relative)			(56% Relative)			(60% Relative)		
		Air Entering Evaporator – Cfm								
80		5,250	7,000	8,750	5,250	7,000	8,750	5,250	7,000	8,750
	TC	67.80	71.30	74.10	70.50	74.80	79.80	73.30	78.20	82.40
	SHC	9.00	26.50	41.70	2.20	13.20	26.90	-5.20	2.90	13.80
	kW	11.65	11.75	11.87	11.82	11.90	11.98	11.93	12.10	12.19
75	TC	72.50	76.00	78.80	75.00	79.20	84.30	78.00	83.00	86.90
	SHC	13.40	30.90	46.10	6.50	18.00	31.30	-2.10	7.20	17.90
	kW	11.44	11.54	11.66	11.61	11.68	11.75	11.70	11.86	11.95
70	TC	77.10	80.60	83.40	79.50	83.90	88.90	82.40	87.30	91.10
	SHC	17.60	34.70	49.90	10.80	22.20	35.10	3.20	11.50	22.20
	kW	11.22	11.33	11.45	11.40	11.46	11.54	11.49	11.64	11.75
60	TC	86.30	89.90	92.70	88.80	93.20	98.20	91.70	96.60	100.50
	SHC	26.20	43.20	58.40	19.40	30.80	43.60	11.60	20.10	30.70
	kW	10.76	10.86	10.98	10.93	11.00	11.07	11.03	11.18	11.28
50	TC	95.50	99.10	101.90	98.00	102.40	107.40	101.00	106.00	109.80
	SHC	34.80	51.80	67.00	28.00	39.40	52.20	20.10	28.70	39.40
	kW	10.33	10.43	10.55	10.50	10.52	10.63	10.59	10.74	10.85
40	TC	104.80	108.40	111.20	107.30	111.70	116.60	110.30	115.30	119.10
	SHC	43.40	60.40	75.60	36.60	48.00	60.80	28.80	37.30	47.90
	kW	9.87	9.97	10.09	10.04	10.11	10.18	10.14	10.28	10.40

LEGEND

Edb – Entering Dry-Bulb

Ewb – Entering Wet-Bulb

kW – Compressor Motor Power Input

Idb – Leaving Dry-Bulb

Iwb – Leaving Wet-Bulb

SHC – Sensible Heat Capacity (1000 Btu/h) Gross

TC – Total Capacity (1000 Btu/h) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.

2. The following formulas may be used:

$$t_{edb} = t_{ewb} - \frac{\text{sensible capacity (Btu/h)}}{1.10 \times \text{cfm}}$$

t_{ewb} = Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{wb})

$$h_{ewb} = h_{ewb} - \frac{\text{total capacity (Btu/h)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 12 – COOLING CAPACITIES

2-STAGE COOLING

20 TONS (cont.)

558J*25K (20 TONS) – UNIT WITH PERFECT HUMIDITY IN SUBCOOLING MODE										
Temp (F) Air Entering Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		6,000			8,000			10,000		
		Air Entering Evaporator -- Ewb (F)								
72	67	62	72	67	62	72	67	62		
75	TC	281.6	256.5	231.3	293.1	267.0	240.9	302.3	275.4	248.6
	SHC	114.7	141.0	167.4	140.6	166.6	192.6	161.6	187.3	212.9
	kW	13.52	13.25	12.95	13.82	13.46	13.21	13.97	13.60	13.31
85	TC	261.3	236.9	212.4	272.1	247.7	221.3	280.7	254.6	228.5
	SHC	90.9	123.5	156.1	118.8	151.1	183.3	141.4	173.4	205.4
	kW	14.95	14.68	14.48	15.25	14.89	14.64	15.40	15.03	14.74
95	TC	241.1	217.2	193.4	251.1	226.4	201.7	259.2	233.8	208.4
	SHC	67.2	106.0	144.8	97.1	120.1	174.1	121.2	159.5	197.8
	kW	16.52	16.25	15.95	16.82	16.46	16.21	16.97	16.60	16.31
105	TC	220.8	197.5	174.4	230.2	206.2	182.2	237.7	213.0	188.4
	SHC	43.4	88.4	133.5	75.3	120.1	164.9	101.0	145.7	178.9
	kW	18.09	17.82	17.52	18.39	18.03	17.78	18.54	18.17	17.88
115	TC	200.5	178.0	155.5	209.2	185.9	162.6	216.2	192.2	168.7
	SHC	19.7	70.9	122.2	53.5	104.6	155.7	80.9	131.8	161.2
	kW	19.65	19.38	19.08	19.95	19.59	19.34	20.10	19.73	19.44

558J*25K (20 TONS) – UNIT WITH PERFECT HUMIDITY IN HOT GAS REHEAT MODE										
Temp (F) Air Entering Condenser (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb		
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb		
		(50% Relative)			(56% Relative)			(60% Relative)		
		Air Entering Evaporator – Cfm								
6,000	8,000	10,000	6,000	8,000	10,000	6,000	8,000	10,000		
80	TC	115.20	123.30	130.60	120.40	129.30	138.20	122.80	135.00	143.70
	SHC	40.80	58.30	76.10	32.30	45.50	60.40	20.10	34.30	48.00
	kW	13.24	13.32	13.39	13.43	13.57	13.65	13.49	13.68	13.74
75	TC	119.80	128.60	135.90	125.50	135.30	143.20	128.00	139.50	148.40
	SHC	45.60	62.80	82.10	37.00	49.80	65.20	24.30	38.70	52.60
	kW	13.05	13.10	13.17	13.21	13.35	13.43	13.27	13.46	13.52
70	TC	122.50	133.10	140.20	129.80	140.70	147.60	132.40	144.40	153.20
	SHC	49.80	76.00	86.10	41.10	54.30	69.20	28.80	41.40	56.80
	kW	12.80	12.87	12.94	12.98	13.12	13.20	13.04	13.23	13.29
60	TC	133.80	142.50	149.60	139.30	150.40	157.40	141.50	154.20	163.00
	SHC	58.60	76.00	95.00	50.20	63.50	78.10	37.80	52.10	65.90
	kW	12.34	12.42	12.49	12.53	12.67	12.75	12.59	12.78	12.84
50	TC	143.50	151.80	159.30	149.00	160.00	167.00	151.30	163.60	172.50
	SHC	67.70	84.80	103.80	59.10	72.40	87.00	46.70	61.00	74.90
	kW	11.88	11.95	12.03	12.07	12.21	12.29	12.13	12.32	12.38
40	TC	153.20	161.30	168.70	158.60	169.20	176.60	160.80	173.10	182.00
	SHC	76.50	93.60	111.60	68.00	81.50	95.80	55.80	69.80	84.00
	kW	11.42	11.49	11.56	11.60	11.74	11.82	11.66	11.85	11.91

LEGEND

- Edb** – Entering Dry-Bulb
Ewb – Entering Wet-Bulb
kW – Compressor Motor Power Input
ldb – Leaving Dry-Bulb
lwb – Leaving Wet-Bulb
SHC – Sensible Heat Capacity (1000 Btuh) Gross
TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{edb} = t_{ewb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{ewb} = Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{ewb})

$$h_{ewb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 14 – COOLING CAPACITIES

2-STAGE COOLING

25 TONS (cont.)

558J*29K (25 TONS) – UNIT WITH PERFECT HUMIDITY IN SUBCOOLING MODE										
Temp (F) Air Entering Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		7,500			10,000			12,500		
		Air Entering Evaporator -- Ewb (F)								
72	67	62	72	67	62	72	67	62		
75	TC	351.3	319.5	287.8	370.4	337.3	304.1	385.8	351.5	317.2
	SHC	166.5	199.4	232.3	191.2	245.6	258.5	211.4	245.6	279.9
	kW	16.75	16.55	15.20	17.30	16.75	15.85	17.80	17.50	16.50
85	TC	327.5	296.4	265.3	346.1	313.6	281.2	361.1	327.5	294.0
	SHC	137.4	178.2	219.0	162.6	204.5	246.4	183.3	226.0	268.7
	kW	18.65	18.45	17.25	19.20	18.65	17.80	19.45	19.15	18.15
95	TC	303.7	273.3	242.9	321.8	290.0	258.3	336.4	303.5	270.7
	SHC	108.2	157.0	205.8	134.0	184.1	234.3	155.1	206.4	257.6
	kW	20.60	20.40	19.34	21.15	20.60	19.95	21.60	21.30	20.30
105	TC	279.9	250.2	220.4	297.5	266.4	235.3	311.7	279.5	247.4
	SHC	79.0	135.8	192.5	105.4	163.8	222.2	127.1	186.7	246.4
	kW	22.85	22.65	21.45	23.40	22.85	22.05	23.70	23.40	22.40
115	TC	256.2	227.1	198.0	273.2	242.8	212.4	287.0	255.5	224.1
	SHC	49.9	114.5	179.2	76.8	143.4	210.1	98.9	167.1	223.8
	kW	25.05	24.85	23.65	25.60	25.05	24.25	25.90	25.60	24.60

558J*29K (25 TONS) – UNIT WITH PERFECT HUMIDITY IN HOT GAS REHEAT MODE										
Temp (F) Air Entering Condenser (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb		
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb		
		(50% Relative)			(56% Relative)			(60% Relative)		
		Air Entering Evaporator – Cfm								
7,500	10,000	12,500	7,500	10,000	12,500	7,500	10,000	12,500		
80	TC	124.40	133.90	139.00	132.00	142.10	145.10	135.60	149.10	151.50
	SHC	37.60	60.70	82.20	27.80	45.40	65.80	17.50	34.20	50.10
	kW	15.83	15.90	16.00	15.97	16.13	16.16	16.11	16.31	16.38
75	TC	129.00	138.50	144.60	136.60	147.60	150.10	140.60	154.00	156.30
	SHC	47.10	70.60	92.10	37.30	55.30	75.70	27.00	43.70	60.00
	kW	15.77	15.83	15.94	15.91	16.07	16.10	16.05	16.25	16.32
70	TC	133.60	143.10	149.20	141.20	152.30	154.80	145.30	158.80	161.10
	SHC	57.30	80.70	102.20	47.50	65.40	85.80	37.20	53.90	70.10
	kW	15.68	15.75	15.86	15.83	16.00	16.04	15.88	16.08	16.15
60	TC	142.80	158.40	158.40	150.40	161.40	163.90	153.90	167.40	169.70
	SHC	76.50	121.40	121.40	66.70	84.60	105.00	56.40	73.10	89.30
	kW	15.54	15.60	15.71	15.68	15.84	15.87	15.82	16.02	16.09
50	TC	151.80	161.30	167.40	159.40	170.50	173.20	162.80	176.20	178.80
	SHC	94.10	117.50	139.00	84.30	102.20	122.60	74.00	90.70	106.90
	kW	15.40	15.47	15.58	15.54	15.68	15.71	15.66	15.86	15.93
40	TC	161.20	170.70	176.80	168.80	179.80	182.50	172.20	185.70	188.20
	SHC	114.10	137.60	159.10	104.30	122.30	142.70	94.00	110.70	127.00
	kW	15.24	15.31	15.42	15.39	15.55	15.58	15.53	15.73	15.80

LEGEND

Edb – Entering Dry-Bulb

Ewb – Entering Wet-Bulb

kW – Compressor Motor Power Input

lDb – Leaving Dry-Bulb

lwb – Leaving Wet-Bulb

SHC – Sensible Heat Capacity (1000 Btu/h) Gross

TC – Total Capacity (1000 Btu/h) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.

2. The following formulas may be used:

$$t_{lDb} = t_{edb} - \frac{\text{sensible capacity (Btu/h)}}{1.10 \times \text{cfm}}$$


t_{lwb} = Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btu/h)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 15 – STATIC PRESSURE ADDERS (IN. WG) - FACTORY OPTIONS AND/OR ACCESSORIES

Perfect Humidity

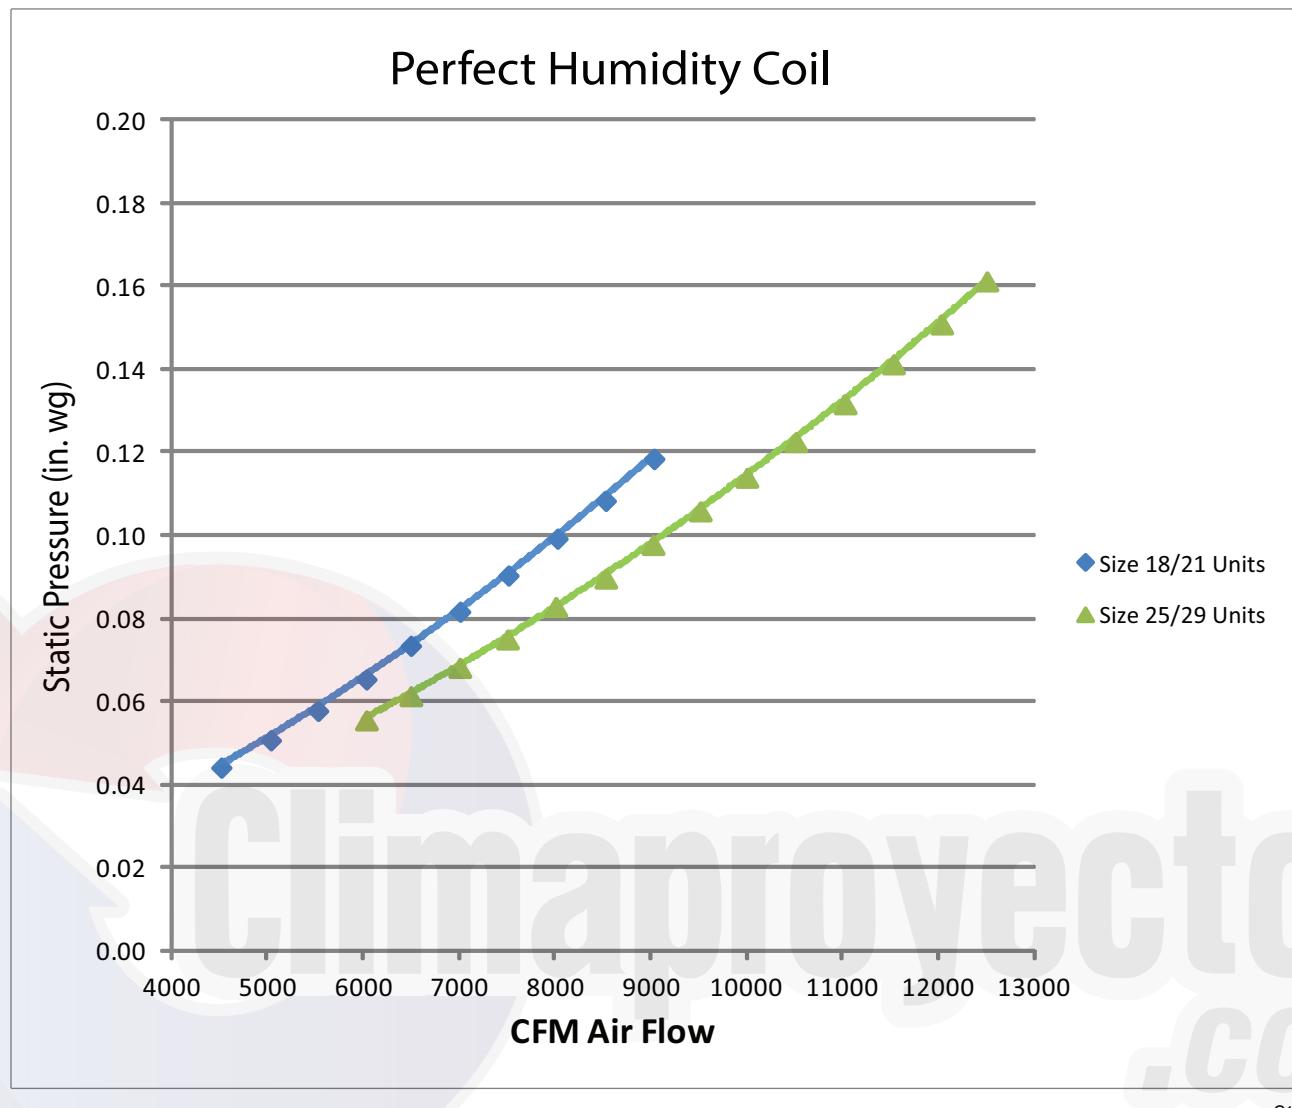

C13858

Economizer - Horizontal Duct Configuration

MODEL SIZES 18–29								
CFM	4500	5000	5500	6000	6500	7000	7500	8000
Static Pressure Adder (in. wg)	0.047	0.052	0.057	0.062	0.067	0.072	0.077	0.082

MODEL SIZES 18–29								
CFM	8500	9000	9500	10000	10500	11000	11500	12000
Static Pressure Adder (in. wg)	0.088	0.093	0.098	0.103	0.109	0.114	0.119	0.125

Electric Heaters - Horizontal Duct Configuration

MODEL SIZES 18–29								
CFM	4800	5000	6000	7000	8000	9000	10000	11500
25 kW Heater	0.010	0.010	0.020	0.030	0.040	0.050	0.060	0.090
50 kW Heater	0.020	0.020	0.040	0.060	0.080	0.100	0.130	0.180
75 kW Heater	0.030	0.040	0.060	0.080	0.120	0.150	0.200	0.270

DAMPER, BAROMETRIC RELIEF AND PE PERFORMANCE

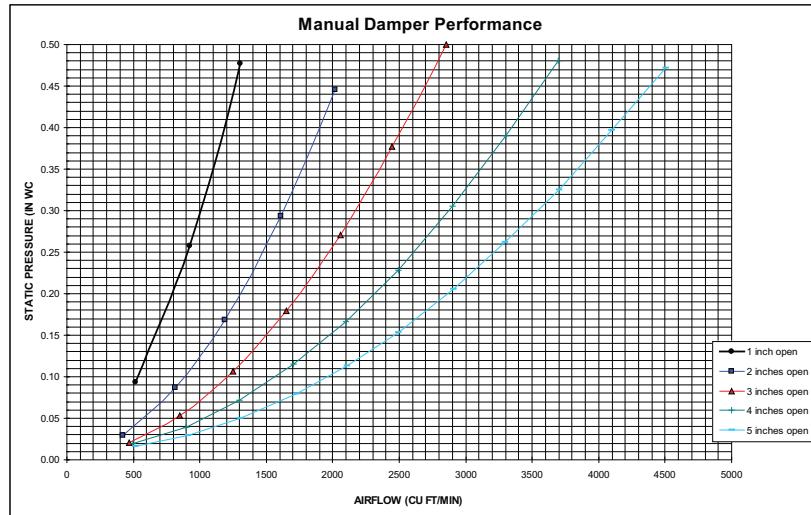


Fig. 9 - Manual Damper Performance

C09264

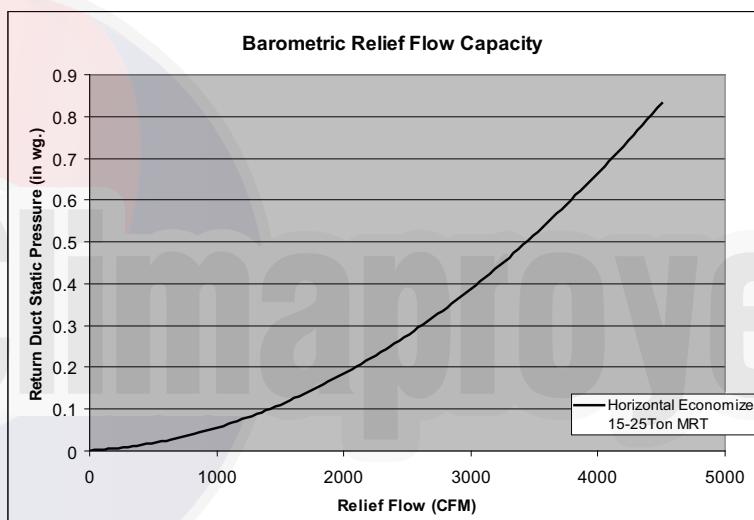


Fig. 10 - Barometric Relief Flow Capacity

C13850

Power Exhaust Fan Performance

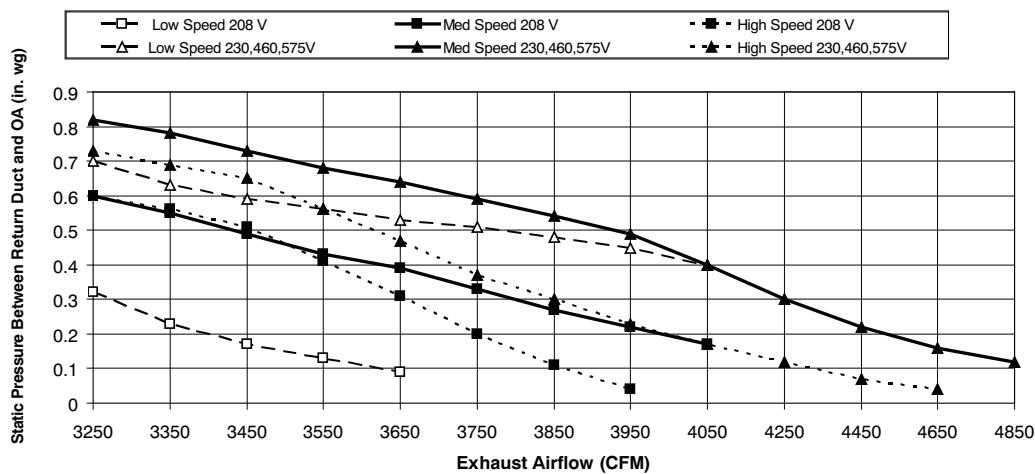


Fig. 11 - Power Exhaust Fan Performance

C11308

GENERAL FAN PERFORMANCE NOTES:

1. Interpolation is permissible. Do not extrapolate.
2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
3. Tabular data accounts for pressure loss due to clean filters, unit casing, and wet coils. Factory options and accessories may add static pressure losses. Selection software is available, through your salesperson, to help you select the best motor/drive combination for your application.
4. The Fan Performance tables offer motor/drive recommendations. In cases when two motor/drive combinations would work, Bryant recommended the lower horsepower option.
5. For information on the electrical properties of Bryant motors, please see the Electrical information section of this book.
6. For more information on the performance limits of Bryant motors, see the application data section of this book.



FAN PERFORMANCE

Table 16 – 558J*18

HORIZONTAL SUPPLY / RETURN

15 TON

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
4500	451	0.84	533	1.21	605	1.63	668	2.12	726	2.67
4900	476	1.01	554	1.40	623	1.84	685	2.34	742	2.89
5250	498	1.18	573	1.60	640	2.05	701	2.55	756	3.11
5600	520	1.37	593	1.82	658	2.28	717	2.79	771	3.35
6000	546	1.61	616	2.10	679	2.58	736	3.10	789	3.67
6400	572	1.88	640	2.41	700	2.91	756	3.45	808	4.03
6750	595	2.13	661	2.70	720	3.23	774	3.79	825	4.38
7100	619	2.41	683	3.02	740	3.59	793	4.16	842	4.76
7500	646	2.75	708	3.42	764	4.02	815	4.62	863	5.23
CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
4500	778	3.25	826	3.86	871	4.49	913	5.15	-	-
4900	794	3.49	842	4.12	887	4.78	-	-	-	-
5250	808	3.72	856	4.36	900	5.04	-	-	-	-
5600	822	3.97	870	4.62	-	-	-	-	-	-
6000	839	4.29	886	4.96	-	-	-	-	-	-
6400	857	4.65	-	-	-	-	-	-	-	-
6750	873	5.01	-	-	-	-	-	-	-	-
7100	-	-	-	-	-	-	-	-	-	-
7500	-	-	-	-	-	-	-	-	-	-
Standard Static Motor and Drive – 514 – 680 RPM, Max BHP 2.2				Medium Static Motor and Drive – 614 – 780 RPM, Max BHP 3.3						
High Static Motor and Drive – 746 – 912 RPM, Max BHP 4.9				– Outside operating range						
Boldface – Field Supplied Drive				<i>ITALIC</i> – Field Supplied Motor and Drive						
<i>ITALIC Boldface</i> – Field Supplied Drive with Medium Static Motor										

Table 17 – 558J*21

HORIZONTAL SUPPLY / RETURN

17.5 TON

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
5250	498	1.18	573	1.60	640	2.05	701	2.55	756	3.11
5700	526	1.43	599	1.89	663	2.35	721	2.86	776	3.43
6100	552	1.67	622	2.17	684	2.66	741	3.18	794	3.76
6500	579	1.95	646	2.49	706	3.00	761	3.54	813	4.12
7000	612	2.33	677	2.93	734	3.48	788	4.05	837	4.64
7500	646	2.75	708	3.42	764	4.02	815	4.62	863	5.23
7900	673	3.13	734	3.86	788	4.50	838	5.12	884	5.75
8300	700	3.53	760	4.33	812	5.01	861	5.66	906	6.32
8750	731	4.03	789	4.90	840	5.63	887	6.33	932	7.02
CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
5250	808	3.72	856	4.36	901	5.04	943	5.75	983	6.48
5700	826	4.05	874	4.71	918	5.40	960	6.13	1000	6.89
6100	843	4.38	890	5.05	934	5.75	976	6.50	1016	7.27
6500	861	4.75	907	5.43	951	6.14	992	6.90	1032	7.69
7000	885	5.28	929	5.96	972	6.69	1013	7.45	-	-
7500	909	5.88	953	6.58	994	7.31	-	-	-	-
7900	929	6.42	972	7.12	-	-	-	-	-	-
8300	950	7.01	992	7.72	-	-	-	-	-	-
8750	-	-	-	-	-	-	-	-	-	-
Standard Static Motor and Drive – 622 – 822 RPM, Max BHP 3.3				Medium Static Motor and Drive – 713 – 879 RPM, Max BHP 4.9						
High Static Motor and Drive – 882 – 1078 RPM, Max BHP 6.5				– Outside operating range						
Boldface – Field Supplied Drive				<i>ITALIC</i> – Field Supplied Motor and Drive						
<i>ITALIC Boldface</i> – Field Supplied Drive with Medium Static Motor				<u>Underscore</u> – Field Supplied Drive with High Static Motor						

FAN PERFORMANCE (cont.)

Table 18 – 558J*25

HORIZONTAL SUPPLY / RETURN

20 TON

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
6000	546	1.57	617	2.10	680	2.67	738	3.29	790	3.93
6500	579	1.90	646	2.46	707	3.07	763	3.71	814	4.39
7000	613	2.28	677	2.87	735	3.51	789	4.19	839	4.89
7500	648	2.71	708	3.34	764	4.01	816	4.72	865	5.46
8000	683	3.20	740	3.86	794	4.57	846	5.30	892	6.08
8500	718	3.76	773	4.45	825	5.18	873	5.95	919	6.75
9000	754	4.37	814	5.10	856	5.87	903	6.67	947	7.50
9500	790	5.06	840	5.82	887	6.51	933	7.45	976	8.31
10000	826	5.82	874	6.50	920	7.44	965	8.30	-	-
CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
6000	839	4.60	885	5.29	928	6.01	969	6.75	1008	7.51
6500	862	5.09	907	5.82	950	6.57	990	7.34	1028	8.13
7000	886	5.63	930	6.39	972	7.17	1012	7.97	1050	8.70
7500	911	6.22	954	7.01	995	7.83	1035	8.66	-	-
8000	936	6.87	979	7.69	1019	8.54	-	-	-	-
8500	965	7.58	1004	8.44	-	-	-	-	-	-
9000	990	8.36	-	-	-	-	-	-	-	-
9500	-	-	-	-	-	-	-	-	-	-
10000	-	-	-	-	-	-	-	-	-	-
Standard Static Motor and Drive – 690 – 680 RPM, Max BHP 4.9					Medium Static Motor and Drive – 835 – 1021 RPM, Max BHP 6.5					
High Static Motor and Drive – 941 – 1176 RPM, Max BHP 8.7					– Outside operating range					
Boldface – Field Supplied Drive					<u>Underscore</u> – Field Supplied Drive with High Static Motor					
<i>ITALIC Boldface</i> – Field Supplied Drive with Medium Static Motor										

Table 19 – 558J*29

HORIZONTAL SUPPLY / RETURN

25 TON

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
7500	553	1.92	621	2.46	683	3.07	741	3.72	795	4.42
8000	575	2.21	639	2.77	700	3.39	756	4.07	809	4.78
8500	596	2.52	658	3.10	716	3.73	771	4.43	823	5.16
9000	616	2.86	675	3.44	732	4.10	786	4.80	836	5.55
9500	636	3.22	693	3.82	747	4.48	800	5.20	849	5.97
10000	656	3.60	710	4.21	763	4.89	813	5.62	862	6.40
10500	675	4.02	727	4.64	778	5.32	827	6.07	874	6.86
11000	694	4.46	744	5.09	793	5.79	841	6.50	887	7.34
11500	713	4.93	761	5.57	808	6.27	854	7.03	899	7.84
CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
7500	845	5.14	892	5.90	936	6.68	978	7.48	1018	8.31
8000	859	5.53	905	6.31	949	7.11	991	7.94	-	-
8500	872	5.93	918	6.73	961	7.56	1003	8.41	-	-
9000	884	6.34	930	7.16	973	8.01	-	-	-	-
9500	896	6.77	941	7.61	984	8.48	-	-	-	-
10000	908	7.22	953	8.08	-	-	-	-	-	-
10500	920	7.69	963	8.56	-	-	-	-	-	-
11000	931	8.18	-	-	-	-	-	-	-	-
11500	943	8.70	-	-	-	-	-	-	-	-
Standard Static Motor and Drive – 647 – 791 RPM, Max BHP 4.9					Medium Static Motor and Drive – 755 – 923 RPM, Max BHP 6.5					
High Static Motor and Drive – 827 – 1010 RPM, Max BHP 8.7					– Outside operating range					
Boldface – Field Supplied Drive					<i>ITALIC Boldface</i> – Field Supplied Drive with Medium Static Motor					

FAN PERFORMANCE (cont.)

Table 20 – PULLEY ADJUSTMENT - HORIZONTAL

UNIT	MOTOR/DRIVE COMBO	MOTOR PULLEY TURNS OPEN										
		0	0.5	1	1.5	2	2.5	3	3.5	4	4.5	5
18	Standard Static	680	663	647	630	614	597	580	564	547	531	514
	Medium Static	780	763	747	730	714	697	680	664	647	631	614
	High Static	912	895	879	862	846	829	812	796	779	763	746
21	Standard Static	822	802	782	762	742	722	702	682	662	642	622
	Medium Static	879	862	846	829	813	796	779	763	746	730	713
	High Static	1078	1058	1039	1019	1000	980	960	941	921	902	882
25	Standard Static	863	846	828	811	794	777	759	742	725	707	690
	Medium Static	1021	1002	984	965	947	928	909	891	872	854	835
	High Static	1176	1153	1129	1106	1082	1059	1035	1012	988	965	941
29	Standard Static	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Medium Static	923	906	889	873	856	839	822	805	789	772	755
	High Static	1010	992	973	955	937	919	900	882	864	845	827

NOTE: Do not adjust pulley further than 5 turns open.

N/A – Not Available

— Factory settings

ELECTRICAL INFORMATION

Legend and Notes

LEGEND:

BRKR	- Circuit breaker
CO	- Convenience outlet
DISC	- Disconnect
FLA	- Full load amps
LRA	- Locked rotor amps
MCA	- Minimum circuit amps
PE	- Power exhaust
PWRD CO	- Powered convenient outlet
UNPWR CO	- Unpowered convenient outlet

NOTES:

1. In compliance with NEC requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or circuit breaker.

2. Unbalanced 3-Phase Supply Voltage

Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance.



$$\% \text{ Voltage Imbalance} = 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 230-3-60



$$\begin{aligned} AB &= 224 \text{ v} \\ BC &= 231 \text{ v} \\ AC &= 226 \text{ v} \end{aligned}$$

$$\begin{aligned} \text{Average Voltage} &= \frac{(224 + 231 + 226)}{3} = \frac{681}{3} \\ &= 227 \end{aligned}$$

Determine maximum deviation from average voltage.

$$(AB) 227 - 224 = 3 \text{ v}$$

$$(BC) 231 - 227 = 4 \text{ v}$$

$$(AC) 227 - 226 = 1 \text{ v}$$

Maximum deviation is 4 v.

Determine percent of voltage imbalance.

$$\begin{aligned} \% \text{ Voltage Imbalance} &= 100 \times \frac{4}{227} \\ &= 1.76\% \end{aligned}$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

ELECTRICAL INFORMATION

Table 21 – 2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

UNIT	V-Ph-Hz	VOLTAGE RANGE		COMP 1		COMP 2		OFM (ea)		IFM		
				RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
		MIN	MAX									
558J*18	208–3–60	187	253	25.0	164	25.0	164	350	1.5	STD	88.6%	8.4
										MED	87.0%	10.6
										HIGH	82.9%	13.6
	230–3–60	187	253	25.0	164	25.0	164	350	1.5	STD	88.6%	8.3
										MED	87.0%	10.6
										HIGH	82.9%	12.7
	460–3–60	414	506	12.8	100	12.8	100	277	0.9	STD	88.6%	4.2
										MED	87.0%	5.3
										HIGH	82.9%	6.4
	575–3–60	518	633	9.6	78	9.6	78	397	0.6	STD	81.1%	2.8
										MED	81.1%	2.8
										HIGH	83.6%	5.6
558J*21	208–3–60	187	253	27.6	191	25.0	164	350	1.5	STD	87.0%	10.6
										MED	82.9%	13.6
										HIGH–High Eff.	89.5%	17.1
	230–3–60	187	253	27.6	191	25.0	164	350	1.5	STD	87.0%	10.6
										MED	82.9%	12.7
										HIGH–High Eff.	89.5%	17.1
	460–3–60	414	506	12.8	100	12.2	100	277	0.9	STD	87.0%	5.3
										MED	82.9%	6.4
										HIGH–High Eff.	89.5%	8.6
	575–3–60	518	633	9.6	78	9.0	78	397	0.6	STD	81.1%	2.8
										MED	83.6%	5.6
										HIGH–High Eff.	89.5%	7.6
558J*25	208–3–60	187	253	30.1	225	30.1	225	350	1.5	STD	82.9%	13.6
										MED–High Eff.	89.5%	17.1
										HIGH–High Eff.	91.7%	28.5
	230–3–60	187	253	30.1	225	30.1	225	350	1.5	STD	82.9%	12.7
										MED–High Eff.	89.5%	17.1
										HIGH–High Eff.	91.7%	28.5
	460–3–60	414	506	16.7	114	16.7	114	277	0.9	STD	82.9%	6.4
										MED–High Eff.	89.5%	8.6
										HIGH–High Eff.	91.7%	14.3
	575–3–60	518	633	12.2	80	12.2	80	397	0.6	STD	83.6%	5.6
										MED–High Eff.	89.5%	7.6
										HIGH–High Eff.	91.7%	9.5

See: "Legend and Notes" on page 38

Size 29 unit is not available with single speed indoor fan motor

ELECTRICAL INFORMATION

Table 22 – 2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR
15 - 25 TONS

UNIT	V-Ph-Hz	VOLTAGE RANGE		COMP 1		COMP 2		OFM (ea)		IFM		
		MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
558J*18	208-3-60	187	253	25.0	164	25.0	164	350	1.5	STD	85.0%	8.6
										MED	81.5%	10.8
										HIGH	83.6%	13.6
	230-3-60	187	253	25.0	164	25.0	164	350	1.5	STD	85.0%	7.8
										MED	81.5%	9.8
										HIGH	83.6%	12.7
	460-3-60	414	506	12.8	100	12.8	100	277	0.9	STD	85.0%	3.8
										MED	81.5%	4.9
										HIGH	83.6%	6.4
558J*21	575-3-60	518	633	9.6	78	9.6	78	397	0.6	STD	81.1%	4.5
										MED	81.1%	4.5
										HIGH	83.6%	6.2
	208-3-60	187	253	27.6	191	25.0	164	350	1.5	STD	81.5%	10.8
										MED	83.6%	13.6
										HIGH	89.5%	17.1
	230-3-60	187	253	27.6	191	25.0	164	350	1.5	STD	81.5%	9.8
										MED	83.6%	12.7
										HIGH	89.5%	17.1
558J*25	460-3-60	414	506	12.8	100	12.2	100	277	0.9	STD	81.5%	4.9
										MED	83.6%	6.4
										HIGH	89.5%	8.6
	575-3-60	518	633	9.6	78	9.0	78	397	0.6	STD	81.1%	4.5
										MED	83.6%	6.2
										HIGH	89.5%	7.6
558J*29	208-3-60	187	253	30.1	225	30.1	225	350	1.5	STD	83.6%	13.6
										MED	89.5%	17.1
										HIGH	91.7%	28.5
	230-3-60	187	253	30.1	225	30.1	225	350	1.5	STD	83.6%	12.7
										MED	89.5%	17.1
										HIGH	91.7%	28.5
	460-3-60	414	506	16.7	114	16.7	114	277	0.9	STD	83.6%	6.4
										MED	89.5%	8.6
										HIGH	91.7%	14.3
558J*29	575-3-60	518	633	12.2	80	12.2	80	397	0.6	STD	83.6%	6.2
										MED	89.5%	7.6
										HIGH	91.7%	9.5
	208-3-60	187	253	48.1	245	33.3	239	350	1.5	STD	83.6%	13.6
										MED	89.5%	17.1
										HIGH	91.7%	28.5
558J*29	230-3-60	187	253	48.1	245	33.3	239	350	1.5	STD	83.6%	12.7
										MED	89.5%	17.1
										HIGH	91.7%	28.5
	460-3-60	414	506	18.6	125	17.9	125	277	0.9	STD	83.6%	6.4
										MED	89.5%	8.6
										HIGH	91.7%	14.3
	575-3-60	518	633	14.7	100	12.8	80	397	0.6	STD	83.6%	6.2
										MED	89.5%	7.6
										HIGH	91.7%	9.5

See: "Legend and Notes" on page 38

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 23 – 558J*18-21

SINGLE SPEED INDOOR FAN MOTOR

Model Number 558J*	NOM. V-Ph-Hz	IFM TYPE	Electric Heater Part Number CRHEATERXXXXXX	Nominal (kW)	Application (kW)	Application Output (MBH)	Single Point or Junction Kit Part Number CRSINGLEXXXXA00			
							NO C.O. Or Unpowered C.O.		w/PWRD C.O.	
							NO P.E.	w/ P.E. (pwrd fr/unit)	NO P.E.	w/ P.E. (pwrd fr/unit)
18	208/230-3-60	STD	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	–	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		MED	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		HIGH	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	–	–	057
			278A00	74.4	68.3	233.1	057	057	057	057
		MED	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	–	–	057
			278A00	74.4	68.3	233.1	057	057	057	057
		HIGH	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	057	–	057
			278A00	74.4	68.3	233.1	057	057	057	057
21	208/230-3-60	STD	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH-High Efficiency	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	R273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		MED	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		HIGH-High Efficiency	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	–	–	057
			278A00	74.4	68.3	233.1	057	057	057	057
		MED	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	057	–	057
			278A00	74.4	68.3	233.1	057	057	057	057
		HIGH-High Efficiency	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	057	057	057
			278A00	74.4	68.3	233.1	057	057	057	057

See: "Legend and Notes" on page 38

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 23 - 558J*25 (CONT.)

SINGLE SPEED INDOOR FAN MOTOR

Model Number 558J*	NOM. V-Ph-Hz	IFM TYPE	Electric Heater Part Number CRHEATERXXXXXX	Nominal (kW)	Application (kW)	Application Output (MBH)	Single Point or Junction Kit Part Number CRSINGLEXXXA00			
							NO C.O. Or Unpowered C.O.		w/PWRD C.O.	
							NO P.E.	w/ P.E. (pwrd fr/unit)	NO P.E.	w/ P.E. (pwrd fr/unit)
25	208/203-3-60	STD	270A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED-High Efficiency	270A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH-High Efficiency	270A00	25.0	18.8/23.0	64.1/78.3	—	056	—	056
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	273A00	25.0	23.0	78.3	—	—	—	—
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		MED-High Efficiency	273A00	25.0	23.0	78.3	—	—	—	—
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		HIGH-High Efficiency	273A00	25.0	23.0	78.3	—	—	—	057
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	276A00	24.8	22.8	77.7	—	—	—	—
			277A00	49.6	45.6	155.4	—	057	—	057
			278A00	74.4	68.3	233.1	057	057	057	057
		MED-High Efficiency	276A00	24.8	22.8	77.7	—	—	—	—
			277A00	49.6	45.6	155.4	—	057	057	057
			278A00	74.4	68.3	233.1	057	057	057	057
		HIGH-High Efficiency	276A00	24.8	22.8	77.7	—	—	—	—
			277A00	49.6	45.6	155.4	057	057	057	057
			278A00	74.4	68.3	233.1	057	057	057	057

See: "Legend and Notes" on page 38

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 24 – 558J*18-21

2-SPEED INDOOR FAN MOTOR

Model Number 558J*	NOM. V-Ph-Hz	IFM TYPE	Electric Heater Part Number CRHEATERXXXXXX	Nominal (kW)	Application (kW)	Application Output (MBH)	Single Point or Junction Kit Part Number CRSINGLEXXXXA00			
							NO C.O. Or Unpowered C.O.		w/PWRD C.O.	
							NO P.E.	w/ P.E. (pwrd fr/unit)	NO P.E.	w/ P.E. (pwrd fr/unit)
18	208/230-3-60	STD	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	–	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		MED	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		HIGH	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	057	–	057
			278A00	74.4	68.3	233.1	057	057	057	057
		MED	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	057	–	057
			278A00	74.4	68.3	233.1	057	057	057	057
		HIGH	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	057	–	057
			278A00	74.4	68.3	233.1	057	057	057	057
21	208/230-3-60	STD	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	270A00	25.0	18.8/23.0	64.1/78.3	–	–	–	–
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		MED	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		HIGH	273A00	25.0	23.0	78.3	–	–	–	–
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	057	–	057
			278A00	74.4	68.3	233.1	057	057	057	057
		MED	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	057	–	057
			278A00	74.4	68.3	233.1	057	057	057	057
		HIGH	276A00	24.8	22.8	77.7	–	–	–	–
			277A00	49.6	45.6	155.4	–	057	–	057
			278A00	74.4	68.3	233.1	057	057	057	057

See: "Legend and Notes" on page 38

ELECTRIC HEAT - ELECTRICAL INFORMATION

Table 24 - 558J*25-29 (CONT.)

2-SPEED INDOOR FAN MOTOR

Model Number 558J*	NOM. V-Ph-Hz	IFM TYPE	Electric Heater Part Number CRHEATERXXXXXX	Nominal (kW)	Application (kW)	Application Output (MBH)	Single Point or Junction Kit Part Number CRSINGLEXXXX00			
							NO C.O. Or Unpowered C.O.		w/PWRD C.O.	
							NO P.E.	w/ P.E. (pwrd fr/unit)	NO P.E.	w/ P.E. (pwrd fr/unit)
25	208/203-3-60	STD	270A00	25.0	18.8/23.0	64.1/78.3	-	-	-	-
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED	270A00	25.0	18.8/23.0	64.1/78.3	-	-	-	-
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	270A00	25.0	18.8/23.0	64.1/78.3	-	056	-	056
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	273A00	25.0	23.0	78.3	-	-	-	-
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		MED	273A00	25.0	23.0	78.3	-	-	-	-
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		HIGH	273A00	25.0	23.0	78.3	-	-	-	057
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	276A00	24.8	22.8	77.7	-	-	-	-
			277A00	49.6	45.6	155.4	-	057	-	057
			278A00	74.4	68.3	233.1	057	057	057	057
		MED	276A00	24.8	22.8	77.7	-	-	-	-
			277A00	49.6	45.6	155.4	-	057	057	057
			278A00	74.4	68.3	233.1	057	057	057	057
		HIGH	276A00	24.8	22.8	77.7	-	-	-	-
			277A00	49.6	45.6	155.4	057	057	057	057
			278A00	74.4	68.3	233.1	057	057	057	057
29	208/230-3-60	STD	270A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED	270A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	270A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			271A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			272A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	273A00	25.0	23.0	78.3	-	-	-	-
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		MED	273A00	25.0	23.0	78.3	-	-	-	057
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
		HIGH	273A00	25.0	23.0	78.3	-	057	057	057
			274A00	50.0	45.9	156.7	057	057	057	057
			275A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	276A00	24.8	22.8	77.7	-	-	-	-
			277A00	49.6	45.6	155.4	-	057	-	057
			278A00	74.4	68.3	233.1	057	057	057	057
		MED	276A00	24.8	22.8	77.7	-	-	-	-
			277A00	49.6	45.6	155.4	-	057	057	057
			278A00	74.4	68.3	233.1	057	057	057	057
		HIGH	276A00	24.8	22.8	77.7	-	-	-	-
			277A00	49.6	45.6	155.4	057	057	057	057
			278A00	74.4	68.3	233.1	057	057	057	057

See: "Legend and Notes" on page 38

ELECTRICAL INFORMATION

Table 25 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA

UNIT #	NO. M.V.-P-HZ	ELEC. HTR		NO PE.		NO C.O. or UNPWR C.O.		NO PE.		w/ PWRD C.O.			
		IFM TYPE	CRHEATER*****	Nom (kW)	FLA	MCA	MAX FUSE or HACR BRKR		MAX FUSE or HACR BRKR		MCA	MAX FUSE or HACR BRKR	
							FLA	LRA	FLA	LRA		FLA	LRA
208/230-3-60	558J*18	STD	NONE	-	69.2/68.1	90/90	72/72	409	81.0/80.9	100/100	86/86	429	74.0/73.9
208/230-3-60	460-3-60	STD	270A00	18.8/25.0	52.1/60.1	90/90	72/79	409	90.4/100.3	100/110	86/92	429/429	81.6/91.5
208/230-3-60	575-3-60	STD	271A00	37.6/50.0	104.2/120.3	140.8/130.7	150/150	128/148	155.5/145.4	175/175	143/161	429/429	146.8/136.7
208/230-3-60	575-3-60	STD	272A00	56.3/75.0	156.4/180.4	166.9/190.8	200/200	190/217	181.7/205.5	200/225	203/231	429/429	172.9/196.8
HIGH	575-3-60	MED	NONE	-	71.4	90	75	423	83.2	100	88	443	76.2
HIGH	460-3-60	MED	270A00	18.8/25.0	52.1/60.1	78.4/88.4	90/90	75/81	423/423	98.1/103.1	100/110	88/95	443/443
HIGH	460-3-60	MED	271A00	37.6/50.0	104.2/120.3	143.5/133.6	150/150	132/151	423/423	158.3/148.3	175/175	149/164	443/443
HIGH	460-3-60	MED	272A00	56.3/75.0	156.4/180.4	169.7/193.7	200/225	192/220	423/423	184.4/208.4	200/225	206/233	443/443
HIGH	558J*18	STD	NONE	-	74.4/73.5	90/90	78/77	425	86.2/85.3	100/100	92/91	445	79.2/78.3
HIGH	558J*18	STD	270A00	18.8/25.0	52.1/60.1	82.1/91.0	90/100	78/84	425/425	96.9/105.8	100/110	92/97	445/445
HIGH	558J*18	STD	271A00	37.6/50.0	104.2/120.3	147.3/136.2	150/150	135/153	425/425	162.0/150.9	175/175	149/167	445/445
HIGH	558J*18	STD	272A00	56.3/75.0	156.4/180.4	173.4/196.3	200/225	196/222	425/425	188.2/211.0	200/225	209/236	445/445
HIGH	558J*18	MED	NONE	-	35.7	45	37	242	41.9	50	45	254	37.9
HIGH	558J*18	MED	273A00	25.0	30.1	42.9	45	39	242	50.6	60	47	254
HIGH	558J*18	MED	274A00	50.0	60.1	65.4	70	74	242	73.1	80	81	254
HIGH	558J*18	MED	275A00	75.0	90.2	95.5	100	109	242	103.2	110	116	254
HIGH	558J*18	STD	NONE	-	36.8	45	39	249	43.0	50	46	261	39.0
HIGH	558J*18	STD	273A00	25.0	30.1	44.3	45	41	249	52.0	60	48	261
HIGH	558J*18	STD	274A00	50.0	60.1	66.7	80	75	249	74.5	80	82	261
HIGH	558J*18	STD	275A00	75.0	90.2	96.8	100	110	249	104.6	110	117	261
HIGH	558J*18	MED	NONE	-	37.9	50	40	250	44.1	50	47	262	40.1
HIGH	558J*18	MED	273A00	25.0	30.1	45.6	50	42	250	53.4	60	49	262
HIGH	558J*18	MED	274A00	50.0	60.1	68.1	80	76	250	75.9	80	84	262
HIGH	558J*18	MED	275A00	75.0	90.2	98.2	100	111	250	106.0	118	125	262
HIGH	558J*18	STD	NONE	-	26.2	30	27	184	31.0	40	33	192	27.9
HIGH	558J*18	STD	276A00	24.8	28.9	33.4	35	31	184	39.4	40	36	192
HIGH	558J*18	STD	277A00	49.6	47.7	63.1	70	58	184	69.1	70	64	192
HIGH	558J*18	STD	278A00	74.4	71.6	75.1	80	86	184	81.1	90	91	192
HIGH	558J*18	MED	NONE	-	29.0	35	31	196	33.8	40	36	206	30.7
HIGH	558J*18	MED	276A00	24.8	28.9	36.9	40	34	196	42.9	45	39	206
HIGH	558J*18	MED	277A00	49.6	47.7	66.6	70	61	196	72.6	80	67	206
HIGH	558J*18	MED	278A00	74.4	71.6	78.6	90	89	196	84.6	90	94	206

See: "Legend and Notes" on page 38

ELECTRICAL INFORMATION

Table 25 - UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (cont)

CUNIT	NO M.V.-Pf-Hz	ELEC. HTR			NO P.E.			NO C.O. or UNPWR C.O.			NO P.E.			w/ PWRD C.O.					
		IFM TYPE	CRHEATER*****	Nom (kW)	FLA	MAX FUSE or HACR BRKR			MAX FUSE or HACR BRKR			MAX FUSE or HACR BRKR			MAX FUSE or HACR BRKR				
						MCA	FLA	LRA	MCA	FLA	LRA	MCA	FLA	LRA	MCA	FLA	LRA		
		NONE	-	87.3/86.4	100/100	92/91	550	99.1/98.2	125/125	105/104	570	92.1/91.2	100/100	97/96	555	103.9/103.0	125/125	111/110	
		270A00	18.8/25.0	52.1/60.1	100/100	92/91	550/550	98.1/105.8	125/125	105/104	570/570	92.1/97.0	100/100	97/96	555/556	103.9/111.8	125/125	111/110	
		271A00	37.6/50.0	104.2/120.3	147.3/136.2	150/150	135/153	550/550	162.0/150.9	175/175	149/167	570/570	153.3/142.2	175/175	141/158	555/556	168.0/156.9	175/175	155/172
		272A00	56.3/75.0	156.4/180.4	173.4/196.3	200/225	196/222	550/550	188.2/211.0	200/225	209/236	570/570	179.4/202.3	200/225	207/228	555/556	194.2/217.0	200/250	215/241
		NONE	-	90.8	100	96	546	102.6	125	109	566	95.6	125	101	551	107.4	125	115	
		270A00	18.8/25.0	52.1/60.1	100/100	96/96	546/546	102.6/111.3	125/125	109/109	566/566	95.6/102.5	125/125	101/101	551/551	107.4/117.3	125/125	111/115	
		271A00	37.6/50.0	104.2/120.3	151.6/141.7	175/175	139/158	546/546	166.4/156.4	175/175	153/172	566/566	157.6/147.7	175/175	145/164	551/551	172.4/162.4	175/175	159/177
		272A00	56.3/75.0	156.4/180.4	177.8/201.8	200/225	200/227	546/546	192.5/216.5	200/250	213/241	566/566	183.8/207.8	200/225	205/233	551/551	198.5/222.5	200/250	219/246
		NONE	-	-	102.2	125	109	625	114.0	125	122	645	107.0	125	114	630	118.8	150	128
		270A00	18.8/25.0	52.1/60.1	102.2/110.8	125/125	115.5/125.5	625/625	115.5/125.5	122/122	645/645	107.0/116.8	125/125	114/114	630/630	121.5/131.5	150/150	128/128	650/650
		271A00	37.6/50.0	104.2/120.3	165.9/155.9	175/175	159/171	625/625	180.6/170.7	200/175	645/645	171.9/161.9	175/175	158/177	630/630	186.6/176.7	200/200	172/190	650/650
		272A00	56.3/75.0	156.4/180.4	192.0/216.0	200/250	213/240	625/625	206.8/230.8	225/250	226/254	645/645	198.0/222.0	225/250	218/246	630/630	212.8/236.8	225/250	232/259
		NONE	-	-	47.6	60	50	280	53.8	60	57	292	49.8	60	52	282	56.0	70	60
		273A00	25.0	30.1	47.6	60	50	280	53.8	60	57	292	49.8	60	52	282	56.1	70	60
		274A00	50.0	60.1	68.1	80	76	280	75.9	80	84	292	70.9	80	79	282	78.6	80	86
		275A00	75.0	90.2	98.2	100	111	280	106.0	125	118	292	101.0	110	114	282	108.7	125	121
		NONE	-	-	49.8	60	52	278	56.0	70	60	290	52.0	60	55	280	58.2	70	62
		273A00	25.0	30.1	49.8	60	52	278	56.1	70	60	290	52.0	60	55	280	58.9	70	62
		274A00	50.0	60.1	70.9	80	79	278	78.6	80	86	290	73.6	80	82	280	81.4	90	89
		275A00	75.0	90.2	101.0	110	114	278	108.7	125	121	290	103.7	125	116	280	111.5	125	123
		NONE	-	-	55.5	60	59	318	61.7	70	66	330	57.7	70	62	320	63.9	80	69
		273A00	25.0	30.1	55.5	60	59	318	63.3	70	66	330	58.3	70	62	320	66.0	80	69
		274A00	50.0	60.1	78.0	90	86	318	85.7	90	93	330	80.7	90	88	320	88.5	100	95
		275A00	75.0	90.2	108.1	120	120	318	115.8	125	127	330	110.8	125	123	320	118.6	125	130
		NONE	-	-	35.5	45	37	204	40.3	50	43	212	37.2	45	39	206	42.0	50	45
		276A00	24.8	23.9	36.9	45	37	204	42.9	50	43	212	39.0	45	39	206	45.0	50	45
		277A00	49.6	47.7	66.6	70	61	204	72.6	80	67	212	68.8	70	63	206	74.8	80	69
		278A00	74.4	71.6	78.6	90	89	204	84.6	90	94	212	80.7	90	91	206	86.7	90	96
		NONE	-	-	37.5	45	40	202	42.3	50	45	210	39.2	50	42	204	44.0	50	47
		276A00	24.8	23.9	39.4	45	40	202	45.4	50	45	210	41.5	50	42	204	47.5	50	45
		277A00	49.6	47.7	69.1	70	64	202	75.1	80	69	210	71.3	80	66	204	77.3	80	71
		278A00	74.4	71.6	81.1	90	91	202	87.1	90	97	210	83.2	90	93	204	89.2	90	99
		NONE	-	-	39.4	50	42	229	44.2	50	47	237	41.1	50	44	231	45.9	50	49
		276A00	24.8	23.9	41.8	50	42	229	47.8	50	47	237	43.9	50	44	231	49.9	50	49
		277A00	49.6	47.7	71.5	80	66	229	77.5	80	71	237	73.6	80	68	231	79.6	80	73
		278A00	74.4	71.6	83.5	90	93	229	89.5	100	99	237	85.6	90	95	231	91.6	100	101

See: "Legend and Notes" on page 38

ELECTRICAL INFORMATION

Table 26 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH FACTORY INSTALLED 2 SPEED INDOOR FAN OPTION

CUNIT NO. M.V.-Pf-HZ	IFM TYPE CRHEATER*****	ELEC. HTR			NO P.E.			NO C.O. or UNPWR C.O.			w/ PWRD C.O.		
		Nom (kW)	FLA	MCA	MAX FUSE or HACR BRKR		DISC. SIZE		MCA	MAX FUSE or HACR BRKR		DISC. SIZE	
					FLA	LRA	FLA	LRA		FLA	LRA	FLA	LRA
					81.2/80.4	100/100	86/85	410	74.2/73.4	90/90	78/77	395	86.0/85.2
208/230-3-60	460-3-60	52.1/60.1	75.9/84.9	90/90	73/72	390	390/390	100/100	81.9/90.9	90/100	78/84	395/395	96.6/105.6
		18.8/25.0	52.1/60.1	141.0/130.1	150/150	130/147	390/390	155.8/144.8	175/150	143/161	410/410	147.0/136.1	161.8/150.8
		37.6/50.0	104.2/120.3	167.2/190.2	200/200	190/216	390/390	181.9/204.9	200/225	203/230	410/410	173.2/196.2	187.9/210.9
MED		NONE	–	71.6/70.6	90/90	75/74	414	83.4/82.4	100/100	89/88	434	76.4/75.4	100/100
		270A00	18.8/25.0	52.1/60.1	78.6/87.4	90/90	75/80	414/414	93.4/102.1	100/110	89/94	434/434	84.6/93.4
		271A00	37.6/50.0	104.2/120.3	143.8/132.6	150/150	132/150	414/414	158.5/147.3	175/175	146/163	434/434	149.8/138.6
		272A00	56.3/75.0	156.4/180.4	169.9/192.7	200/225	192/219	414/414	184.7/207.4	200/225	206/232	434/434	175.9/198.7
HIGH		NONE	–	74.4/73.5	90/90	78/77	425	86.2/85.3	100/100	92/91	445	79.2/78.3	100/100
		270A00	18.8/25.0	52.1/60.1	82.1/91.0	90/100	78/84	425/425	96.9/105.8	100/110	92/97	445/445	88.1/97.0
		271A00	37.6/50.0	104.2/120.3	147.3/136.2	150/150	135/153	425/425	162.0/150.9	175/175	149/167	445/445	153.3/142.2
		272A00	56.3/75.0	156.4/180.4	173.4/196.3	200/225	196/222	425/425	188.2/211.0	200/225	209/236	445/445	179.4/202.3
		NONE	–	35.3	45	37	233	41.5	50	44	245	37.5	50.00
		273A00	25.0	30.1	42.4	45	39	233	50.1	60	46	245	45.1
		274A00	50.0	60.1	64.9	70	73	233	72.6	80	81	245	67.6
		275A00	75.0	90.2	95.0	100	108	233	102.7	110	115	245	97.7
		NONE	–	36.4	45	38	245	42.6	50	45	257	38.6	50.00
		273A00	25.0	30.1	43.8	45	40	245	51.5	60	47	257	46.5
		274A00	50.0	60.1	66.2	80	75	245	74.0	80	82	257	69.0
		275A00	75.0	90.2	96.3	100	109	245	104.1	110	116	257	99.1
		NONE	–	37.9	50	40	250	44.1	50	47	262	40.1	50.00
		273A00	25.0	30.1	45.6	50	42	250	53.4	60	49	262	48.4
		274A00	50.0	60.1	68.1	80	76	250	75.9	80	84	262	70.9
		275A00	75.0	90.2	98.2	100	111	250	106.0	125	118	262	101.0
		NONE	–	27.9	35	29	184	32.7	40	35	192	29.6	35.00
		273A00	25.0	30.1	35.5	40	33	184	41.5	45	38	192	37.6
		274A00	50.0	60.1	65.3	70	60	184	71.3	80	66	192	67.4
		275A00	75.0	90.2	77.2	90	88	184	83.2	90	93	192	79.4
		NONE	–	27.9	35	29	184	32.7	40	35	192	29.6	35.00
		276A00	24.8	23.9	35.5	40	33	184	41.5	45	38	192	37.6
		277A00	49.6	47.7	65.3	70	60	184	71.3	80	66	192	67.4
		278A00	74.4	71.6	77.2	90	88	184	83.2	90	93	192	79.4
		NONE	–	29.6	35	31	198	34.4	40	37	206	31.3	40.00
		276A00	24.8	23.9	37.6	40	35	198	43.6	45	40	206	39.8
		277A00	49.6	47.7	67.4	70	62	198	73.4	80	68	206	69.5
		278A00	74.4	71.6	79.4	90	89	198	85.4	90	95	206	81.5
575-3-60	558J*18												
		STD											
		MED											
		HIGH											

See: "Legend and Notes" on page 38

ELECTRICAL INFORMATION

Table 26 - UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH FACTORY INSTALLED 2 SPEED INDOOR FAN OPTION (cont.)

UNIT	ELEC. HTR				NO C.O. or UNPWR C.O.				w/ PWRD C.O.				
	IFM TYPE	CRHEATER*****	Nom (kW)	FLA	NO RE.				NO RE. (pwrdf/r/unit)				
					MCA	MAX FUSE or HACR BRKR	DISC. SIZE	FLA	LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
206/230-3-60	460-3-60				558J+25	575-3-60	575	125/125	125/125	103/9/103.0	125/125	111/110	
STD	270A00	NONE	-	87.3/86.4	100/100	92/91	550	99.1/98.2	125/125	105/104	570	92.1/91.2	100/100
	271A00	18.8/25.0	52.1/60.1	87.3/91.0	100/100	92/91	550/550	99.1/105.8	125/125	105/104	570/570	92.1/97.0	100/100
MED	272A00	37.6/50.0	104.2/120.3	147.3/136.2	150/150	135/153	550/550	162.0/150.9	175/175	149/167	570/570	153.3/112.2	175/175
HIGH	273A00	56.3/75.0	156.4/180.4	173.4/196.3	200/225	196/222	550/550	188.2/211.0	200/225	209/236	570/570	179.4/202.3	200/225
STD	274A00	NONE	-	90.8	100	96	546	102.6	125	109	566	95.6	125/200
MED	275A00	18.8/25.0	52.1/60.1	90.8/96.5	100/100	96/96	546/546	102.6/111.3	125/125	109/109	566/566	95.6/102.5	125/125
HIGH	276A00	37.6/50.0	104.2/120.3	151.6/141.7	175.1/175	139/158	546/546	166.4/156.4	175/175	153/172	566/566	157.6/147.7	175/175
STD	277A00	NONE	-	102.2	125	109	625	114.0	125	122	645	107.0	125/200
MED	278A00	18.8/25.0	52.1/60.1	102.2/110.8	125/125	109	625/625	115.5/125.5	125/150	122/122	645/645	107.0/116.8	125/125
HIGH	279A00	37.6/50.0	104.2/120.3	165.9/155.9	175/175	153/171	625/625	180.6/170.7	200/175	166/185	645/645	171.9/161.9	175/175
STD	280A00	NONE	-	47.6	60	50	280	53.8	70	57	292	49.8	60/60
MED	281A00	25.0	30.1	47.6	60	50	280	53.8	60	57	292	49.8	60/60
HIGH	282A00	50.0	60.1	68.1	80	76	280	75.9	80	84	292	70.9	80/80
STD	283A00	NONE	-	49.8	60	52	278	56.0	70	60	290	52.0	60/60
MED	284A00	25.0	30.1	49.8	60	52	278	56.1	70	60	290	52.0	60/60
HIGH	285A00	50.0	60.1	70.9	80	79	278	78.6	80	86	290	73.6	80/80
STD	286A00	NONE	-	55.5	60	59	318	61.7	70	66	330	57.7	70/70
MED	287A00	25.0	30.1	55.5	60	59	318	63.3	70	66	330	58.3	70/70
HIGH	288A00	50.0	60.1	78.0	90	86	318	85.7	90	93	330	80.7	90/90
STD	289A00	NONE	-	101.0	110	114	278	108.7	125	121	290	103.7	125
MED	290A00	75.0	90.2	101.0	110	114	278	108.7	125	118	292	101.0	110
HIGH	291A00	75.0	90.2	101.0	110	114	278	108.7	125	118	292	101.0	110
STD	292A00	NONE	-	36.1	45	38	204	40.9	50	43	212	37.8	40/40
MED	293A00	24.8	23.9	37.6	45	38	204	43.6	50	43	212	39.8	40/40
HIGH	294A00	49.6	47.7	67.4	70	62	204	73.4	80	68	212	69.5	70/70
STD	295A00	NONE	-	74.4	71.6	79.4	90	89	204	85.4	90	95	212
MED	296A00	24.8	23.9	39.4	45	40	202	42.3	50	45	210	39.2	40/40
HIGH	297A00	49.6	47.7	69.1	70	64	202	75.1	80	69	210	71.3	40/40
STD	298A00	NONE	-	74.4	71.6	81.1	90	91	202	87.1	90	97	210
MED	299A00	24.8	23.9	41.8	50	42	229	44.2	50	47	237	41.1	50/50
HIGH	300A00	49.6	47.7	71.5	80	66	229	47.8	50	47	237	43.9	50/50
STD	301A00	NONE	-	83.5	90	93	229	77.5	80	71	237	73.6	50/50
MED	302A00	24.8	23.9	41.8	50	42	229	47.8	50	44	231	43.9	50/50
HIGH	303A00	49.6	47.7	71.6	71.6	83.5	90	93	229	89.5	90	95	50/50
STD	304A00	NONE	-	83.5	90	93	229	89.5	100	99	237	85.6	90
MED	305A00	24.8	23.9	41.8	50	42	229	47.8	50	44	237	85.6	90
HIGH	306A00	49.6	47.7	71.5	80	66	229	77.5	80	80	237	79.6	80/80
STD	307A00	NONE	-	83.5	90	93	229	89.5	100	99	237	85.6	90
MED	308A00	24.8	23.9	41.8	50	42	229	47.8	50	44	231	43.9	50/50
HIGH	309A00	49.6	47.7	71.5	80	66	229	77.5	80	80	237	79.6	80/80
STD	310A00	NONE	-	83.5	90	93	229	89.5	100	99	237	85.6	90
MED	311A00	24.8	23.9	41.8	50	42	229	47.8	50	44	231	43.9	50/50
HIGH	312A00	49.6	47.7	71.6	71.6	83.5	90	93	229	89.5	90	95	50/50

See: "Legend and Notes" on page 38

ELECTRICAL INFORMATION

Table 26 - UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH FACTORY INSTALLED 2 SPEED INDOOR FAN OPTION (cont.)

UNIT	IFM TYPE	CRHEATER*****	Nom (kW)	ELEC. HTR		NO RE.		NO C.O. or UNPWR C.O.		NO RE.		w/ PWRD C.O.				
				FLA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE	FLA	LRA	MCA	MAX FUSE or HACR BRKR	DISC. SIZE	FLA	LRA		
208/230-3-60	STD	NONE	-	116.0/115.1	150/150	120/119	590	127.8/126.9	175/175	133/132	610	120.8/119.9	150/150	125/124	595	
		270A00	18.8/25.0	52.1/60.1	116.0/115.1	150/150	120/119	590/590	127.8/126.9	175/175	133/132	610/610	120.8/119.9	150/150	125/124	595/595
		271A00	37.6/50.0	104.2/120.3	147.3/136.2	150/150	135/153	590/590	162.0/150.9	175/175	149/167	610/610	153.3/142.2	175/175	141/158	595/595
		272A00	56.3/75.0	156.4/180.4	173.4/196.3	200/225	196/222	590/590	188.2/211.0	200/225	209/236	610/610	179.4/202.3	200/225	207/228	595/595
460-3-60	STD	NONE	-	119.5	150	124	586	131.3	175	137	606	124.3	150.0	129	591	
		270A00	18.8/25.0	52.1/60.1	119.5/119.5	150/150	124/124	586/586	131.3/131.3	175/175	137/137	606/606	124.3/124.3	150/150	129/129	591/591
		271A00	37.6/50.0	104.2/120.3	151.6/141.7	175/175	139/158	586/586	166.4/156.4	175/175	153/172	606/606	157.6/147.7	175/175	145/164	591/591
		272A00	56.3/75.0	156.4/180.4	177.8/201.8	200/225	200/227	586/586	192.5/216.5	200/250	218/241	606/606	183.8/207.8	200/225	205/233	591/591
575-3-60	STD	NONE	-	130.9	175	137	665	142.7	175	150	685	135.7	175.00	142	670	
		270A00	18.8/25.0	52.1/60.1	130.9/130.9	175/175	137/137	665/665	142.7/142.7	175/175	150/150	685/685	135.7/135.7	175/175	142/142	670/670
		271A00	37.6/50.0	104.2/120.3	165.9/155.9	175/175	159/171	665/665	180.6/161.0	200/175	166/185	685/685	171.9/161.9	175/175	158/177	670/670
		272A00	56.3/75.0	156.4/180.4	192.0/216.0	200/250	213/240	665/665	206.8/230.8	225/250	226/254	685/685	198.0/222.0	225/250	218/246	670/670
558.3+29	STD	NONE	-	53.0	60	56	306	59.2	70	63	318	55.2	60.00	58	308	
		273A00	25.0	30.1	53.0	60	56	306	59.2	70	63	318	55.2	60.00	58	308
		274A00	50.0	60.1	68.1	80	76	306	75.9	80	84	318	70.9	80.00	79	308
		275A00	75.0	90.2	98.2	100	111	306	106.0	125	118	318	101.0	110	114	308
HIGH	MED	NONE	-	55.2	60	58	304	61.4	70	65	316	57.4	70.00	61	306	
		273A00	25.0	30.1	55.2	60	58	304	61.4	70	65	316	57.4	70.00	61	306
		274A00	50.0	60.1	70.9	80	79	304	78.6	80	86	316	73.6	80.00	82	306
		275A00	75.0	90.2	101.0	110	114	304	108.7	125	121	316	103.7	125	116	306
575-3-60	STD	NONE	-	60.9	70	65	344	67.1	80	72	356	63.1	80.00	67	346	
		273A00	25.0	30.1	60.9	70	65	344	67.1	80	72	356	63.1	80.00	67	346
		274A00	50.0	60.1	78.0	90	86	344	85.7	90	93	356	80.7	90.00	88	346
		275A00	75.0	90.2	108.1	120	125	344	115.8	125	127	356	110.8	125	123	346
575-3-60	MED	NONE	-	41.0	50	43	228	45.8	60	48	236	42.7	50.00	45	230	
		273A00	24.8	23.9	41.0	50	43	228	45.8	60	48	236	42.7	50.00	45	230
		277A00	49.6	47.7	67.4	70	62	228	73.4	80	68	236	69.5	70.00	64	230
		278A00	74.4	71.6	79.4	90	89	228	85.4	90	95	236	81.5	90	91	230
575-3-60	MED	NONE	-	42.4	50	45	226	47.2	60	50	234	44.1	50.00	46	228	
		276A00	24.8	23.9	42.4	50	45	226	47.2	60	50	234	44.1	50.00	46	228
		277A00	49.6	47.7	69.1	70	64	226	75.1	80	69	234	71.3	80.00	66	228
		278A00	74.4	71.6	81.1	90	91	226	87.1	90	97	234	83.2	90	93	228
HIGH	MED	NONE	-	44.3	50	47	253	49.1	60	52	261	46.0	60.00	49	255	
		276A00	24.8	23.9	44.3	50	47	253	49.1	60	52	261	46.0	60.00	49	255
		277A00	49.6	47.7	71.5	80	66	253	77.5	80	71	261	73.6	80.00	68	255
		278A00	74.4	71.6	83.5	90	93	253	89.5	100	99	261	85.6	90	95	255

See: "Legend and Notes" on page 38

SEQUENCE OF OPERATION

General

The sequence below describes the sequence of operation for an electro-mechanical unit with and without a factory installed EconoMi\$er™ IV and X (called “economizer” in this sequence). For information regarding a direct digital controller, see the start-up, operations, and troubleshooting manual for the applicable controller.

Electro-mechanical units with no economizer

Cooling (Single speed indoor fan motor) —

When the thermostat calls for cooling, terminals G and Y1 are energized. As a result, the indoor-fan contactor (IFC) and the compressor contactor (C1) are energized, causing the indoor-an motor (IFM), compressor #1, and outdoor fan to start. If the unit has 2 stages of cooling, the thermostat will additionally energize Y2. The Y2 signal will energize compressor contactor #2 (C2), causing compressor #2 to start. Regardless of the number of stages, the outdoor-fan motor runs continuously while unit is cooling.

Cooling (2-speed indoor fan motor) —

Per ASHRAE 90.1 2010 standard section 6.4.3.10.b, during the first stage of cooling operation the VFD will adjust the fan motor to provide 2/3rd of the total cfm established for the unit. When a call for the second stage of cooling is required, the VFD will allow the total cfm for the unit established (100%).

Heating —

NOTE: The 558J is sold as cooling only. If electric heaters are required, use only factory-approved electric heaters. They will operate as described below.

Units have either 1 or 2 stages of electric heat. When the thermostat calls for heating, power is applied to the W1 terminal at the unit. The unit control will energize the indoor fan contactor and the first stage of electric heat. On units with two-stage heating, when additional heating is required, the second stage of electric heat (if equipped) will be energized when power is applied at the W2 terminal on the unit.

Electro-mechanical units with an economizer

Cooling —

When free cooling is not available, the compressors will be controlled by the zone thermostat. When free cooling is available, the outdoor-air damper is modulated by the EconoMi\$er IV and X control to provide a 50°F (10°C) to 55°F (13°C) mixed-air temperature into the zone. As the mixed air temperature fluctuates above 55°F (13°C) or below 50°F (10°C) dampers will be modulated (open or close) to bring the mixed-air temperature back within control. If mechanical cooling is utilized with free cooling, the outdoor-air damper will maintain its current position at

the time the compressor is started. If the increase in cooling capacity causes the mixed-air temperature to drop below 45°F (9°C), then the outdoor-air damper position will be decreased to the minimum position. If the mixed-air temperature continues to fall, the outdoor-air damper will close. Control returns to normal once the mixed-air temperature rises above 48°F (9°C). The power exhaust fans will be energized and de-energized, if installed, as the outdoor-air damper opens and closes.

If field-installed accessory CO₂ sensors are connected to the EconoMi\$er IV and X control, a demand controlled ventilation strategy will begin to operate. As the CO₂ level in the zone increases above the CO₂ setpoint, the minimum position of the damper will be increased proportionally. As the CO₂ level decreases because of the increase in fresh air, the outdoor-air damper will be proportionally closed. For EconoMi\$er IV and X operation, there must be a thermostat call for the fan (G). If the unit is occupied and the fan is on, the damper will operate at minimum position. Otherwise, the damper will be closed.

When the EconoMi\$er IV and X control is in the occupied mode and a call for cooling exists (Y1 on the thermostat), the control will first check for indoor fan operation. If the fan is not on, then cooling will not be activated. If the fan is on, then the control will open the EconoMi\$er IV and X damper to the minimum position.

On the initial power to the EconoMi\$er IV and X control, it will take the damper up to 2 1/2 minutes before it begins to position itself. After the initial power-up, further changes in damper position can take up to 30 seconds to initiate. Damper movement from full closed to full open (or vice versa) will take between 1 1/2 and 2 1/2 minutes. If free cooling can be used as determined from the appropriate changeover command (switch, dry bulb, enthalpy curve, differential dry bulb, or differential enthalpy), then the control will modulate the dampers open to maintain the mixed-air temperature setpoint at 50°F (10°C) to 55°F (13°C). If there is a further demand for cooling (cooling second stage - Y2 is energized), then the control will bring on compressor stage 1 to maintain the mixed-air temperature setpoint. The EconoMi\$er IV and X damper will be open at maximum position. EconoMi\$er IV and X operation is limited to a single compressor.

2-Speed Note: When operating in ventilation mode only, the indoor fan motor will automatically adjust to 2/3rd of the total cfm established.

Heating —

The sequence of operation for the heating is the same as an electromechanical unit with no economizer. The only difference is how the economizer acts. The economizer will stay at the Economizer Minimum Position while the evaporator fan is operating. The outdoor-air damper is closed when the indoor fan is not operating.

Refer to Service and Maintenance Manual for further details.

SEQUENCE OF OPERATION (cont.)

Optional Perfect Humidity System

Units with the factory equipped Perfect Humidity option are capable of providing multiple modes of improved dehumidification as a variation of the normal cooling cycle. The Perfect Humidity option includes additional valves in the liquid line and discharge line of each refrigerant circuit, a small reheat condenser coil downstream of the evaporator, and Motormaster variable-speed control of some or all outdoor fans. Operation of the revised refrigerant circuit for each mode is described below.

The Perfect Humidity system provides three sub-modes of operation: Cool, Reheat1, and Reheat2.


Cool mode - provides a normal ratio of Sensible and Latent Cooling effect from the evaporator coil.

Reheat1 - provides increased Latent Cooling while slightly reducing the Sensible Cooling effect.

Reheat2 - provides normal Latent Cooling but with null or minimum Sensible Cooling effect delivered to the space.


The Reheat1 and Reheat2 modes are available when the unit is not in a Heating mode and when the Low Ambient Lockout switch is closed.

SEQUENCE OF OPERATION (cont.)

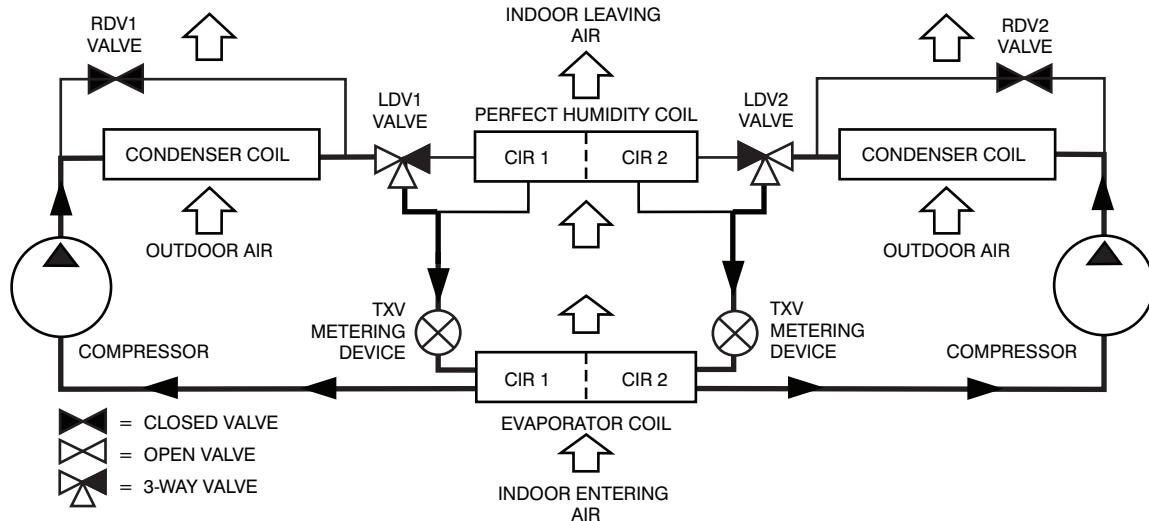


Normal Cooling Mode - Perfect Humidity System

C13851

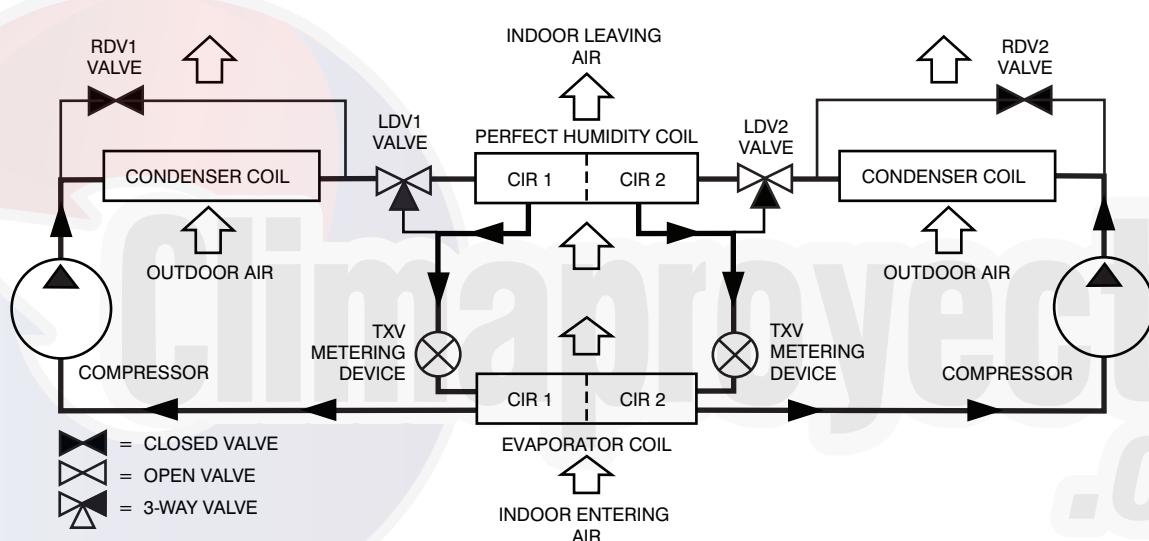

Subcooling Mode (Reheat 1) - Perfect Humidity System

C13852

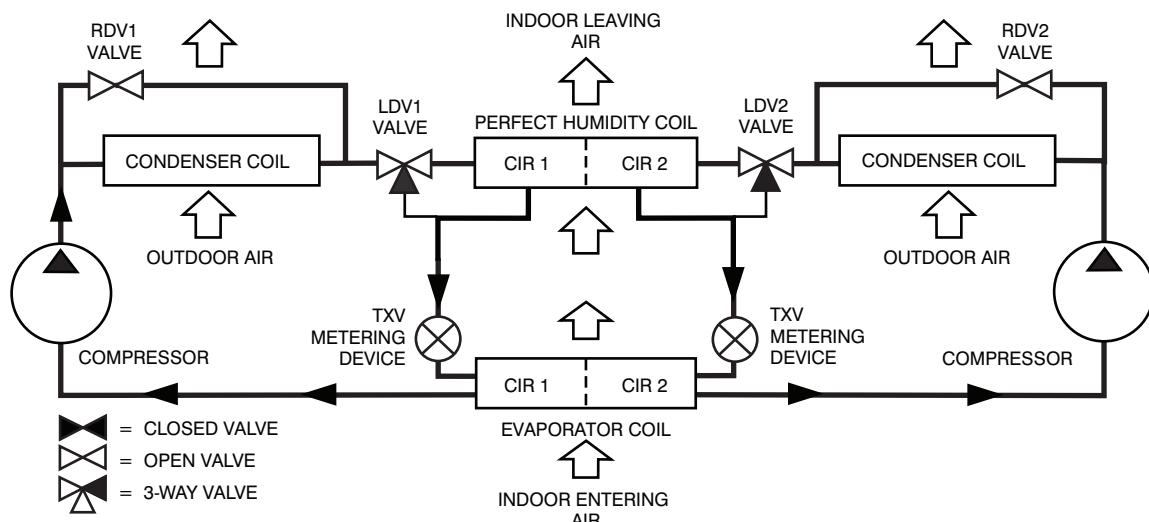

Hot Gas Reheat Mode (Reheat 2) - Perfect Humidity System

C13853

GUIDE SPECIFICATIONS - 558J 18-29

Note about this specification:

These specifications are written in "Masterformat" as published by the Construction Specification Institute. Please feel free to copy this specification directly into your building spec.

Cooling Only/Electric Heat Packaged Rooftop

HVAC Guide Specifications

Size Range: **15 to 25 Nominal Tons**



Section Description

23 06 80 Schedules for Decentralized HVAC Equipment

- 23 06 80.13 Decentralized Unitary HVAC Equipment Schedule
- 23 06 80.13.A. Rooftop unit schedule
 - 1. Schedule is per the project specification requirements.

23 07 16 HVAC Equipment Insulation

- 23 07 16.13 Decentralized, Rooftop Units:
 - 23 07 16.13.A. Evaporator fan compartment:
 - 1. Interior cabinet surfaces shall be insulated with a minimum 1/2-in. thick, minimum 1 1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.
 - 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
 - 23 07 16.13.B. Electric heat compartment:
 - 1. Aluminum foil-faced fiberglass insulation shall be used.
 - 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 09 13 Instrumentation and Control Devices for HVAC

- 23 09 13.23 Sensors and Transmitters
 - 23 09 13.23.A. Thermostats
 - 1. Thermostat must
 - a. energize both "W" and "G" when calling for heat.
 - b. have capability to energize 2 different stages of cooling, and 2 different stages of heating.
 - c. include capability for occupancy scheduling.

23 09 23 Direct-digital Control system for HVAC

- 23 09 23.13 Decentralized, Rooftop Units:
 - 23 09 23.13.A. N/A
 - 23 09 23.13.B. RTU Open protocol, direct digital controller:
 - 1. Shall be ASHRAE 62-2001 compliant.
 - 2. Shall accept 18-30VAC, 50-60Hz, and consumer 15VA or less power.
 - 3. Shall have an operating temperature range from -40°F (-40°C) to 130°F (54°C), 10% - 90% RH (non-condensing).
 - 4. Shall include built-in protocol for BACNET (MS/TP and PTP modes), Modbus (RTU and ASCII), Johnson N2 and LonWorks. LonWorks Echelon processor required for all Lon applications shall be contained in separate communication board.
 - 5. Shall allow access of up to 62 network variables (SNVT). Shall be compatible with all open controllers
 - 6. Baud rate Controller shall be selectable using a dipswitch.
 - 7. Shall have an LED display independently showing the status of serial communication, running, errors, power, all digital outputs, and all analog inputs.
 - 8. Shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air quality, compressor lock-out, fire shutdown, enthalpy switch, and fan status/filter status/humidity/ remote occupancy.

9. Shall provide the following outputs: economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, heat stage 3/ exhaust/ reversing valve.
10. Shall have built-in surge protection circuitry through solid state polyswitches. Polyswitches shall be used on incoming power and network connections. Polyswitches will return to normal when the “trip” condition clears.
11. Shall have a battery back-up capable of a minimum of 10,000 hours of data and time clock retention during power outages.
12. Shall have built-in support for Bryant technician tool.
13. Shall include an EIA-485 protocol communication port, an access port for connection of either a computer or a Bryant technician tool, an EIA-485 port for network communication to intelligent space sensors and displays, and a port to connect an optional LonWorks communications card.
14. Software upgrades will be accomplished by either local or remote download. No software upgrades through chip replacements are allowed.

23 09 33 Electric and Electronic Control System for HVAC

23 09 33.13 Decentralized, Rooftop Units:

23 09 33.13.A. General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 75VA capability.
2. Shall utilize color-coded wiring.
3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, DDC control options, and low and high pressure switches.
4. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.

23 09 33.23.B. Safeties:

1. Compressor over-temperature, over current.
2. Low-pressure switch.
 - a. Units shall have different sized connectors for the circuit 1 and circuit 2 low and high pressure switches. They shall physically prevent the cross-wiring of the safety switches between circuits 1 and 2.
 - b. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
3. High-pressure switch.
 - a. Units compressors shall have different sized connectors for the circuit 1 and circuit 2 low and high pressure switches. They shall physically prevent the cross-wiring of the safety switches between circuits 1 and 2.
 - b. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
4. Automatic reset, motor thermal overload protector.

23 09 93 Sequence of Operations for HVAC Controls

23 09 93.13 Decentralized, Rooftop Units:

23 09 93.13 INSERT SEQUENCE OF OPERATION

23 40 13 Panel Air Filters

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section

1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
2. Unit shall use only one filter size. Multiple sizes are not acceptable.
3. Filters shall be accessible through a dedicated, weather tight panel.
4. 4-in filter capabilities shall be capable with pre-engineered and approved Bryant filter track field installed accessory. This kit requires field furnished filters.

23 81 19 Self-Contained Air Conditioners

23 81 19.13 Medium-Capacity Self-Contained Air Conditioners (558J*18-29)

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing hermetic scroll compressor(s) for cooling duty and with optional electrical heating accessories for heating duty.
2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.

3. Unit shall use environmentally safe, Puron refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1 minimum efficiency requirements.
2. Unit shall be rated in accordance with AHRI Standard 340/360.
3. Unit shall be designed to conform to ASHRAE 15.
4. Unit shall be ETL-tested and certified in accordance with ANSI Z21.47 Standards and ETL-listed and certified under Canadian standards as a total package for safety requirements.
5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
6. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
7. Unit casing shall be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 5000-hour salt spray.
8. Unit shall be designed and manufactured in accordance with ISO 9001.
9. Roof curb shall be designed to conform to NRCA Standards.
10. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
11. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
12. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
13. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.
14. High Efficient Motors listed shall meet section 313 of the Energy Independence and Security Act of 2007 (EISA 2007)

23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Lifted by crane requires either shipping top panel or spreader bars.
3. Unit shall only be stored or positioned in the upright position.

23 81 19.13.D. Project Conditions

1. As specified in the contract.

23 81 19.13.E. Operating Characteristics

1. Unit shall be capable of starting and running at 115°F (46°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 340/360 at ± 10% voltage.
2. Compressor with standard controls shall be capable of operation from 35°F (2°C), ambient outdoor temperatures. Accessory kits are necessary if mechanically cooling at ambient temperatures below 35°F (2°C).
3. Unit shall discharge supply air horizontally as shown on contract drawings.
4. Unit shall be factory furnished for horizontal configuration. No field conversion is required.

23 81 19.13.F. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

23 81 19.13.G. Unit Cabinet

1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a pre-painted baked enamel finish on all externally exposed surfaces.
2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F / 16°C): 60, Hardness: H-2H Pencil hardness.
3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2-in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the heat compartment.
4. Base of unit shall have a minimum of four locations for factory thru-the-base electrical connections. Connections shall be internal to the cabinet to protect from environmental issues.

5. Base Rail

- a. Unit shall have base rails on a minimum of 2 sides.
- b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
- c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
- d. Base rail shall be a minimum of 16 gauge thickness.

6. Condensate pan and connections:
 - a. Shall be a sloped condensate drain pan made of a non-corrosive material.
 - b. Shall comply with ASHRAE Standard 62.
 - c. Shall use a 3/4-in -14 NPT drain connection at the end of the drain pan. Connection shall be made per manufacturer's recommendations.
7. Top panel:
 - a. Shall be a multi-piece top panel linked with water tight flanges and interlocking systems.
8. Electrical Connections
 - a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
 - b. Thru-the-base capability
 - (1) Thru-the-base provisions/connections are available as standard with every unit. When bottom connections are required, field furnished couplings are required.
 - (2) No basepan penetration, other than those authorized by the manufacturer, is permitted.
9. Component access panels (standard)
 - a. Cabinet panels shall be easily removable for servicing.
 - b. Unit shall have one factory installed, removable, filter access panel.
 - c. Panels covering control box and filters shall have molded composite handles while the blower access door shall have an integrated flange for easy removal.
 - d. Handles shall be UV modified, composite. They shall be permanently attached, and recessed into the panel.
 - e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
 - f. Collars shall be removable and easily replaceable using manufacturer recommended parts.

23 81 19.13.H. N/A

23 81 19.13.I. Coils

1. Standard Aluminum Fin/Copper Tube Coils:
 - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 - b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 1995 burst test at 1775 psig.
 - c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 1995 burst test at 1980 psig.
2. Optional Pre-coated aluminum-fin condenser coils:
 - a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.
 - b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
 - c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
3. Optional Copper-fin evaporator and condenser coils:
 - a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
 - b. Galvanized steel tube sheets shall not be acceptable.
 - c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.
4. Optional E-coated aluminum-fin evaporator and condenser coils:
 - a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
 - b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.
 - c. Color shall be high gloss black with gloss per ASTM D523-89.
 - d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
 - e. Superior hardness characteristics of 2H per ASTM D3363-92A and cross-hatch adhesion of 4B-5B per ASTM D3359-93.
 - f. Impact resistance shall be up to 160 in.-lb (ASTM D2794-93).
 - g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247-92 and ASTM D870-92).
 - h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.

23 81 19.13.J. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:
 - a. Thermostatic Expansion Valve (TXV) shall help provide optimum performance across the entire operating range. Shall contain removable power element to allow change out of power element and bulb without removing the valve body.
 - b. Refrigerant filter drier - Solid core design.
 - c. Service gauge connections on suction and discharge lines.
 - d. Pressure gauge access through a specially designed screen on the side of the unit.
2. Compressors
 - a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
 - b. Models shall be available with 2 compressor/2-stage cooling.
 - c. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
 - d. Compressors shall be internally protected from high discharge temperature conditions.
 - e. Compressors shall be protected from an over-temperature and over-amperage conditions by an internal, motor overload device.
 - f. Compressor shall be factory mounted on rubber grommets.
 - g. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
 - h. Crankcase heaters shall not be required for normal operating range, unless provided by the factory.

23 81 19.13.K. Filter Section

1. Filters access is specified in the unit cabinet section of this specification.
2. Filters shall be held in place by a preformed slide out filter tray, facilitating easy removal and installation.
3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
4. Filters shall be standard, commercially available sizes.
5. Only one size filter per unit is allowed.
6. 4-in filter capability is possible with a field installed pre-engineered slide out filter track accessory. 4-in filters are field furnished.

23 81 19.13.L. Evaporator Fan and Motor

1. Evaporator fan motor:
 - a. Shall have inherent automatic-reset thermal overload protection or circuit breaker.
 - b. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
2. Belt-driven Evaporator Fan:
 - a. Belt drive shall include an adjustable-pitch motor pulley and belt break protection system.
 - b. Shall use rigid pillow block bearing system with lubricate fittings at are accessible or lubrication line.
 - c. Blower fan shall be double-inlet type with forward-curved blades.
 - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

23 81 19.13.M. Condenser Fans and Motors

1. Condenser fan motors:
 - a. Shall be a totally enclosed motor.
 - b. Shall use permanently lubricated bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. Shall use a shaft-down design.
2. Condenser Fans:
 - a. Shall be a direct-driven propeller type fan.
 - b. Shall have galvalum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

23 81 19.13.N. Special Features, Options and Accessories

1. 2-Speed Indoor Fan Motor System for 2-stage cooling models only:
 - a. Evaporator fan motor:
 - (1.) Shall have permanently lubricated bearings.
 - (2.) Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating.
 - (3.) Shall be Variable Frequency duty and 2-speed control.

- (4.) Shall contain motor shaft grounding ring to prevent electrical bearing fluting damage by safely diverting harmful shaft voltages and bearing currents to ground.
2. Variable Frequency Drive (VFD). Only available on 2-speed indoor fan motor option:
- Shall be installed inside the unit cabinet, mounted, wired and tested.
 - Shall contain Electromagnetic Interference (EMI) frequency protection.
 - Insulated Gate Bi-Polar Transistors (IGBT) used to produce the output pulse width modulated (PWM) waveform, allowing for quiet motor operation.
 - Self diagnostics with fault and power code LED indicator. Field accessory Display Kit available for further diagnostics and special setup applications.
 - RS485 capability standard.
 - Electronic thermal overload protection.
 - 5% swinging chokes for harmonic reduction and improved power factor.
 - All printed circuit boards shall be conformal coated.
3. Standard Integrated Economizers:
- Integrated, gear-driven opposing blade design type capable of simultaneous economizer and compressor operation.
 - Independent modules for horizontal return configuration shall be available. Shall be available as a factory installed option or field installed accessory.
 - Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
 - Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
 - Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - Standard models shall be equipped with low-leakage dampers, not to exceed 2% leakage at 1 in. wg pressure differential. Economizer controller on electromechanical units shall be Honeywell W7212 that provides:
 - Combined minimum and DCV maximum damper position potentiometers with compressor staging relay.
 - Functions with solid state analog enthalpy or dry bulb changeover control sensing.
 - Contain LED indicates for:
 - when free cooling is available
 - when module is in DCV mode
 - when exhaust fan contact is closed
 - Ultra low leak EconoMi\$er X system shall be available on models with 2-speed indoor fan motor 2-speed Variable Frequency Drive (VFD) systems. Only available on 2-speed indoor fan motor systems with electromechanical controls or RTU Open.
 - Maximum damper leakage rate to be equal to or less than 4.0 cfm/sq. ft. at 1.0 in. w.g., meeting or exceeding ASHRAE 90.1 requirements. Economizer controller on electromechanical units shall be Honeywell W7220 that provides:
 - 2-line LCD interface screen for setup, configuration and troubleshooting
 - On-board fault detection and diagnostics
 - Sensor failure loss of communication identification
 - Automatic sensor detection
 - Capabilities for use with multiple-speed indoor fan systems
 - Utilize digital sensors: Dry bulb and Enthalpy
 - Shall be capable of introducing up to 100% outdoor air.
 - Shall be equipped with a barometric relief damper capable of relieving up to 100% return air.
 - Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
 - Dry bulb outdoor air temperature sensor shall be provided as standard. Outdoor air sensor setpoint shall be adjustable and shall range from 40 to 100°F / 4 to 38°C. Additional sensor options shall be available as accessories.
 - The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.

- m. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper setpoint.
 - n. Dampers shall be completely closed when the unit is in the unoccupied mode.
 - o. Economizer controller shall accept a 2-10 Vdc CO₂ sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
 - p. Compressor lockout sensor shall open at 35°F (2°C) and close at 50°F (10°C).
 - q. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 - r. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
4. Two-Position Damper
- a. Damper shall be a 2-position damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
 - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
 - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
 - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
 - e. Damper will admit up to 100% outdoor air for applicable rooftop units.
 - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
 - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
 - h. Outside air hood shall include aluminum water entrainment filter
5. Manual damper
- a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 25% outdoor air for year round ventilation.
6. Perfect Humidity System.
- a. The Perfect Humidity System shall be factory-installed and shall provide greater dehumidification of the occupied space by two modes of dehumidification operations beside its normal design cooling mode:
 - (1.) Subcooling mode further subcools the hot liquid refrigerant leaving the condenser coil when both temperature and humidity in the space are not satisfied.
 - (2.) Hot gas reheat mode shall mix a portion of the hot gas from the discharge of the compressor with the hot liquid refrigerant leaving the condenser coil to create a two-phase heat transfer in the system, resulting in a neutral leaving-air temperature when only humidity in the space is not satisfied.
 - (3.) Includes Head Pressure Controller.
7. Head Pressure Control Package (MotorMaster)
- a. Controller shall control coil head pressure by condenser-fan speed modulation or condenser-fan cycling and wind baffles.
 - b. Shall consist of solid-state control and condenser-coil temperature sensor to maintain condensing temperature between 90°F (32°C) and 110°F (43°C) at outdoor ambient temperatures down to -20°F (-29°C).
8. Condenser Coil Hail Guard Assembly
- a. Shall protect against damage from hail.
 - b. Shall be louvered style design.
9. Unit-Mounted, Non-Fused Disconnect Switch:
- a. Switch shall be factory-installed, internally mounted.
 - b. National Electric Code (NEC) and ETL approved non-fused switch shall provide unit power shutoff.
 - c. Shall be accessible from outside the unit
 - d. Shall provide local shutdown and lockout capability.
10. Convenience Outlet:
- a. Powered convenience outlet.
 - (1.) Outlet shall be powered from main line power to the rooftop unit.
 - (2.) Outlet shall be powered from line side of disconnect by installing contractor, as required by code. If outlet is powered from load side of disconnect, unit electrical ratings shall be ETL certified and rated for additional outlet amperage.
 - (3.) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.

- (4.) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
 - (5.) Voltage required to operate convenience outlet shall be provided by a factory-installed step-down transformer.
 - (6.) Outlet shall be accessible from outside the unit.
 - (7.) Outlet shall include a field-installed "Wet in Use" cover.
- b. Non-Powered convenience outlet.
- (1.) Outlet shall be powered from a separate 115/120v power source.
 - (2.) A transformer shall not be included.
 - (3.) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
 - (4.) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
 - (5.) Outlet shall be accessible from outside the unit.
 - (6.) Outlet shall include a field-installed "Wet in Use" cover.
11. Fan/Filter Status Switch:
- a. Switch shall provide status of indoor evaporator fan (ON/OFF) or filter (CLEAN/DIRTY).
 - b. Status shall be displayed either over communication bus (when used with direct digital controls) or with an indicator light at the thermostat.
12. Centrifugal Power Exhaust:
- a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for horizontal return configurations shall be available.
 - c. Horizontal power exhaust shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
13. High-Static Indoor Fan Motor(s) and Drive(s):
- a. High-static motor(s) and drive(s) shall be factory-installed to provide additional performance range.
14. Outdoor Air Enthalpy Sensor:
- a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
15. Return Air Enthalpy Sensor:
- a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
16. Indoor Air Quality (CO₂) Sensor:
- a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The setpoint shall have adjustment capability.
17. Smoke detectors:
- a. Shall be a Four-Wire Controller and Detector.
 - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
 - c. Shall use magnet-activated test/reset sensor switches.
 - d. Shall have tool-less connection terminal access.
 - e. Shall have a recessed momentary switch for testing and resetting the detector.
 - f. Controller shall include:
 - (1.) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
 - (2.) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
 - (3.) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
 - (4.) Capable of direct connection to two individual detector modules.
 - (5.) Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.
18. Winter start kit
- a. Shall contain a bypass device around the low pressure switch.
 - b. Shall be required when mechanical cooling is required down to 25°F (-4°C).
 - c. Shall not be required to operate on an economizer when below an outdoor ambient of 40°F (4°C).

19. Time Guard
 - a. Shall prevent compressor short cycling by providing a 5-minute delay (± 2 minutes) before restarting a compressor after shutdown for any reason.
 - b. One device shall be required per compressor.
20. Electric Heat:
 - a. Heating Section
 - (1.) Heater element open coil resistance wire, nickel-chrome alloy, 0.29 inches inside diameter, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.
 - (2.) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24 v coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.
21. Barometric Hood (Horizontal Economizer Applications)
 - a. Shall be required when a horizontal economizer and barometric relief are required. Barometric relief damper must be installed in the return air (horizontal) duct work. This hood provides weather protection.
22. Display Kit for Variable Frequency Drive
 - a. Kit allows the ability to access the VFD controller programs to provide special setup capabilities and diagnostics.
 - b. Kit contains display module and communication cable.
 - c. Display Kit can be permanently installed in the unit or used on any 2-Speed Indoor Fan Motor System VFD controller as needed.
23. Hinged Access Panels
 - a. Shall provide easy access through hinged access doors with vinyl coated door retainers.
 - b. Shall be on major panels of – filter, control box, and fan motor.

