

COOLING CAPACITY: 17,400 TO 57,000 BTU/H
HEATING CAPACITY: 17,000 TO 58,000 BTU/H

ENERGY-EFFICIENT SPLIT SYSTEM HEAT PUMP 1½ TO 5 TONS



Contents

Nomenclature.....	2
Product Specifications.....	3
Expanded Cooling Data.....	4
Expanded Heating Data.....	18
AHRI Ratings	20
Dimensions	21
Wiring Diagram.....	22
Accessories	23

Standard Features


- Energy-efficient scroll compressor
- SmartShift® technology to ensure quiet reliable defrost
- Factory-installed bi-flow liquid-line filter drier
- Factory-installed suction-line accumulator
- Factory-installed compressor crankcase heater
- Factory-installed high-capacity muffler
- High- and low-pressure switches
- Service valves with sweat connections and easy access to gauge ports
- Copper tube/enhanced aluminum fin coil
- Fully charged for 15' of tubing length
- Contactor with lug connection
- Ground lug connection
- AHRI Certified; ETL Listed

Cabinet Features

- Amana® Distinctions® brand sound control top design
- Steel louver coil guard
- Heavy-gauge galvanized-steel cabinet
- Attractive Architectural Gray powder-paint finish with 500-hour salt-spray approval
- Top and side maintenance access
- Service ports and controls are accessible while unit is operating
- When properly anchored, meets the 2010 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



* Complete warranty details available from your local dealer or at www.amana-hac.com. To receive the 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Quebec.

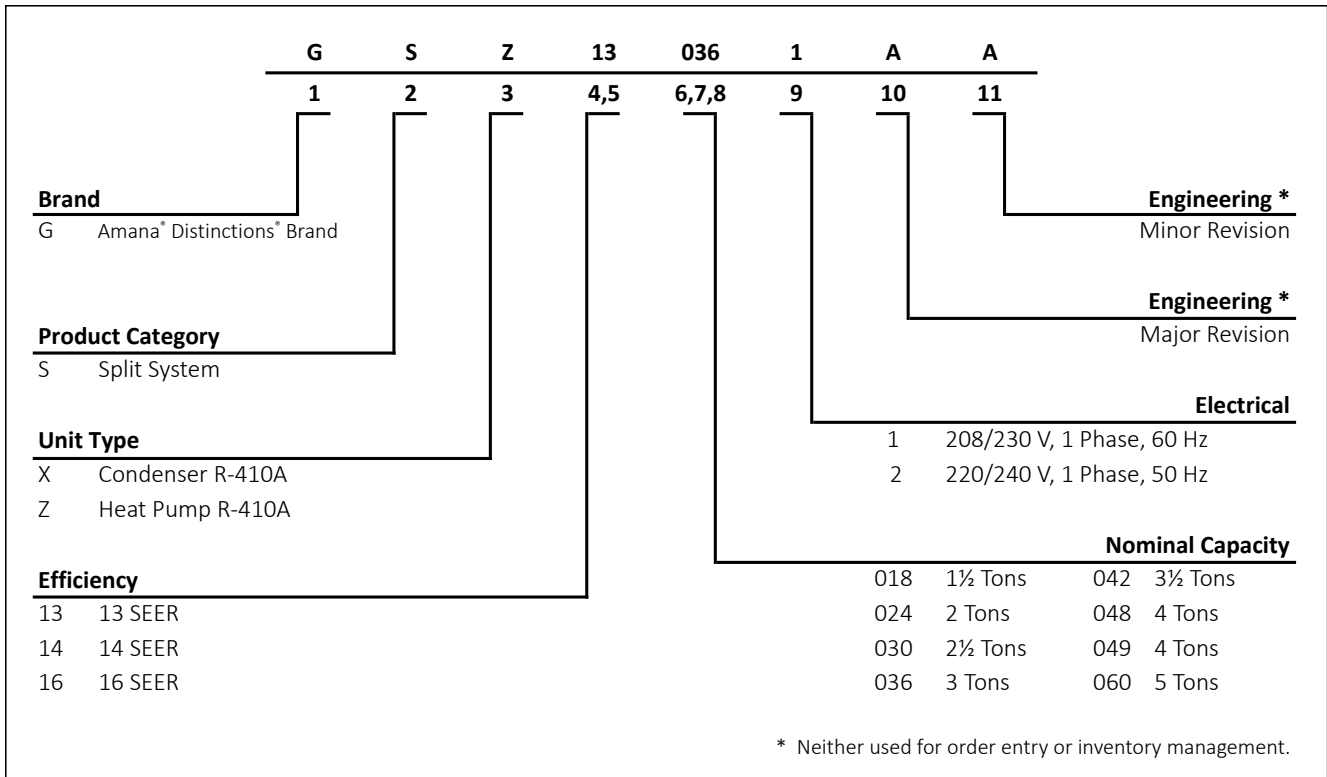

	GSZ13 0181A*	GSZ13 0241B*	GSZ13 0301A*	GSZ13 0361B*	GSZ13 0421A*	GSZ13 0481A*	GSZ13 0601A*
NOMINAL CAPACITIES							
Cooling (BTU/h)	18,000	24,000	30,000	36,000	42,000	48,000	60,000
Heating (BTU/h)	18,000	24,000	30,000	36,000	42,000	48,000	60,000
Decibels	71	73	72	74	74	76	75
COMPRESSOR							
RLA	9.0	13.5	14.1	16.7	17.9	19.9	26.4
LRA	48.0	58.3	73.0	79.0	112.0	109.0	134.0
Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
CONDENSER FAN MOTOR							
Horsepower	1/6	1/8	1/6	1/4	1/4	1/4	1/4
FLA	0.70	0.70	1.10	1.50	1.50	1.50	1.50
REFRIGERATION SYSTEM							
Refrigerant Line Size ¹							
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	3/4"	3/4"	7/8"	1 1/8"	1 1/8"	1 1/8"
Refrigerant Connection Size							
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.)	3/4"	3/4"	3/4"	3/4"	7/8"	7/8"	7/8"
Valve Connection Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	109	99	124	128	149	204	231
Shipped with Orifice Size	0.051	0.057	0.065	0.071	0.074	0.078	0.088
ELECTRICAL DATA							
Volts-Hz	208/230-60	208/230-60	208/230-60	208/230-60	208/230-60	208/230-60	208/230-60
Minimum Circuit Ampacity ²	12.4	17.5	18.7	22.4	23.9	26.4	34.5
Max. Overcurrent Protection ³	20	25	30	35	40	45	60
Min / Max Volts	197 / 253	197 / 253	197 / 253	197 / 253	197 / 253	197 / 253	197 / 253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
EQUIPMENT WEIGHT (LBS)							
	145	136	142	156	202	219	268
SHIP WEIGHT (LBS)							
	162	153	159	174	220	237	290

¹ Tested and rated in accordance with ARI Standard 210/240

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- Installer will need to supply 3/8" to 1 1/8" adapters for suction line connections.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.
- Installation of these units requires the specified TXV Kit to be installed on the indoor coil. THE SPECIFIED TXV IS DETERMINED BY THE OUTDOOR UNIT NOT THE INDOOR COIL.

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
900	MBh	22.5	23.4	25.6	-	22.0	22.8	25.0	-	21.5	22.3	24.4	-	21.0	21.7	23.8	-	19.9	20.6	22.6	-	18.4	19.1	21.0	-
	S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-
	ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	17	15	11	-	16	14	11	-
	KW	1.63	1.66	1.71	-	1.75	1.78	1.84	-	1.85	1.89	1.95	-	1.95	1.99	2.05	-	2.03	2.07	2.14	-	2.10	2.14	2.21	-
	Amps	6.1	6.2	6.4	-	6.5	6.7	6.9	-	7.1	7.3	7.5	-	7.6	7.8	8.0	-	8.1	8.3	8.5	-	8.5	8.8	9.0	-
800	Hi Pr	228	246	259	-	256	276	291	-	291	314	331	-	332	357	377	-	373	402	424	-	413	444	469	-
	Lo Pr	103	110	120	-	109	116	127	-	114	121	132	-	119	127	139	-	125	133	145	-	129	138	150	-
	MBh	21.9	22.7	24.8	-	21.4	22.2	24.3	-	20.9	21.6	23.7	-	20.4	21.1	23.1	-	19.3	20.0	22.0	-	17.9	18.6	20.3	-
	S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-
700	KW	1.62	1.65	1.70	-	1.74	1.77	1.83	-	1.84	1.88	1.94	-	1.93	1.97	2.04	-	2.01	2.05	2.12	-	2.08	2.12	2.19	-
	Amps	6.0	6.2	6.3	-	6.5	6.6	6.9	-	7.0	7.2	7.4	-	7.5	7.7	8.0	-	8.0	8.2	8.5	-	8.5	8.7	9.0	-
	Hi Pr	226	243	257	-	254	273	288	-	288	310	328	-	329	354	373	-	370	398	420	-	408	440	464	-
	Lo Pr	102	109	119	-	108	115	126	-	112	120	131	-	118	126	137	-	124	132	144	-	128	136	149	-
	MBh	20.2	20.9	22.9	-	19.7	20.4	22.4	-	19.3	20.0	21.9	-	18.8	19.5	21.3	-	17.8	18.5	20.3	-	16.5	17.1	18.8	-

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
900	MBh	22.92	23.60	25.54	27.41	22.39	23.05	24.95	26.78	21.85	22.50	24.36	26.14	21.32	21.95	23.76	25.50	20.25	20.85	22.57	24.23	18.76	19.32	20.91	22.44
	S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43
	ΔT	20	18	15	10	20	19	15	11	20	19	15	11	20	19	15	11	20	19	15	11	19	17	14	10
	KW	1.64	1.67	1.73	1.78	1.76	1.80	1.85	1.91	1.87	1.91	1.97	2.03	1.96	2.01	2.07	2.14	2.04	2.09	2.16	2.23	2.11	2.16	2.23	2.30
	Amps	6.1	6.3	6.5	6.7	6.6	6.8	7.0	7.2	7.2	7.3	7.6	7.9	7.7	7.8	8.1	8.4	8.1	8.3	8.6	8.9	8.6	8.8	9.1	9.5
800	Hi Pr	231	248	262	273	259	279	294	307	294	317	334	349	335	361	381	397	377	406	429	447	417	448	474	494
	Lo Pr	104	111	121	129	110	117	128	137	115	122	133	142	121	128	140	149	126	134	147	156	131	139	152	162
	MBh	22.3	22.9	24.8	26.6	21.7	22.4	24.2	26.0	21.2	21.8	23.6	25.4	20.7	21.3	23.1	24.8	19.7	20.2	21.9	23.5	18.2	18.8	20.3	21.8
	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
	ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	20	18	15	10
700	KW	1.63	1.66	1.71	1.77	1.75	1.79	1.84	1.90	1.85	1.89	1.95	2.02	1.95	1.99	2.05	2.12	2.03	2.07	2.14	2.21	2.10	2.14	2.21	2.28
	Amps	6.1	6.2	6.4	6.6	6.5	6.7	6.9	7.2	7.1	7.3	7.5	7.8	7.6	7.8	8.0	8.3	8.1	8.3	8.5	8.9	8.5	8.8	9.0	9.4
	Hi Pr	228	246	260	271	256	276	291	304	291	314	331	345	332	357	377	393	373	402	424	443	413	444	469	489
	Lo Pr	103	110	120	128	109	116	127	135	114	121	132	141	119	127	139	148	125	133	145	155	129	138	150	160
	MBh	20.5	21.1	22.9	24.6	20.1	20.7	22.4	24.0	19.6	20.2	21.8	23.4	19.1	19.7	21.3	22.9	18.2	18.7	20.2	21.7	16.8	17.3	18.7	20.1

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) Rating Conditions
 KW = Total system power
 Amps = Outdoor unit amps (compressor + fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	1173	MBh	27.4	28.4	31.1	-	26.8	27.8	30.4	-	26.1	27.1	29.7	-	25.5	26.4	29.0	-	24.2	25.1	27.5	-	22.4	23.3	25.5	-
		S/T	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.81	0.67	0.47	-	0.83	0.70	0.48	-	0.87	0.72	0.50	-	0.87	0.73	0.51	-
		ΔT	16	14	11	-	17	14	11	-	17	14	11	-	17	14	11	-	16	14	11	-	15	13	10	-
		kW	1.98	2.02	2.08	-	2.13	2.17	2.24	-	2.25	2.30	2.37	-	2.37	2.42	2.49	-	2.46	2.52	2.60	-	2.55	2.60	2.68	-
	Amps	Hi PR	7.8	7.9	8.2	-	8.3	8.5	8.8	-	9.0	9.2	9.5	-	9.6	9.8	10.2	-	10.2	10.5	10.8	-	10.8	11.1	11.4	-
		Lo PR	107	114	124	-	113	120	131	-	117	125	136	-	123	131	143	-	129	137	150	-	134	142	155	-
		MBh	27.0	28.0	30.7	-	26.4	27.4	30.0	-	25.8	26.7	29.3	-	25.1	26.1	28.5	-	23.9	24.7	27.1	-	22.1	22.9	25.1	-
		S/T	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.84	0.70	0.48	-
	Amps	Hi PR	17	15	11	-	17	15	11	-	17	15	11	-	18	15	12	-	18	15	11	-	16	14	11	-
		Lo PR	106	113	123	-	112	119	130	-	116	124	135	-	122	130	142	-	128	136	149	-	133	141	154	-
		MBh	25.7	26.6	29.1	-	25.1	26.0	28.5	-	24.5	25.4	27.8	-	23.9	24.7	27.1	-	22.7	23.5	25.8	-	21.0	21.8	23.9	-
		S/T	0.70	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.80	0.67	0.46	-
Amps	Hi PR	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	15	12	-	17	14	11	-	
	Lo PR	104	111	121	-	110	117	128	-	114	121	133	-	120	128	139	-	126	134	146	-	130	138	151	-	
	MBh	27.8	28.7	31.08	33.36	27.24	28.05	30.36	32.58	26.59	27.38	29.64	31.81	25.94	26.71	28.91	31.03	24.65	25.38	27.47	29.48	22.83	23.51	25.44	27.31	
	S/T	0.86	0.77	0.59	0.38	0.90	0.80	0.61	0.39	0.92	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.98	0.88	0.67	0.43	0.99	0.89	0.67	0.43	
Amps	Hi PR	19	17	14	10	19	18	14	10	19	18	14	10	19	18	15	10	19	18	14	10	18	16	13	9	
	Lo PR	200	204	210	216	214	219	225	233	227	232	239	247	239	244	251	259	248	254	262	270	257	262	271	279	
	MBh	27.5	28.3	30.6	32.9	26.8	27.6	29.9	32.1	26.2	27.0	29.2	31.3	25.6	26.3	28.5	30.6	24.3	25.0	27.1	29.0	22.5	23.2	25.1	26.9	
	S/T	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.91	0.81	0.61	0.40	0.94	0.84	0.64	0.41	0.95	0.85	0.64	0.41	
Amps	Hi PR	20	18	15	10	20	19	15	10	20	19	15	11	20	19	15	11	20	18	15	10	19	17	14	10	
	Lo PR	199	203	209	215	213	218	224	231	226	231	238	245	237	2.42	2.50	2.58	2.47	2.52	2.60	2.69	2.55	2.61	2.69	2.78	
	MBh	7.8	8.0	8.2	8.5	8.4	8.6	8.8	9.1	9.1	9.3	9.6	9.9	9.6	9.9	10.2	10.6	10.2	10.5	10.8	11.2	10.8	11.1	11.4	11.9	
	S/T	230	247	261	272	258	277	293	305	293	315	333	347	334	359	379	395	375	404	427	445	415	446	471	492	
Amps	Hi PR	107	114	124	133	113	120	131	140	118	125	137	146	124	131	144	153	130	138	150	160	134	143	156	166	
	Lo PR	26.1	26.9	29.1	31.2	25.5	26.3	28.4	30.5	24.9	25.6	27.7	29.8	24.3	25.0	27.1	29.0	23.1	23.8	25.7	27.6	21.4	22.0	23.8	25.6	
	MBh	0.79	0.71	0.54	0.35	0.82	0.73	0.56	0.36	0.84	0.75	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.91	0.81	0.62	0.40	
	S/T	21	19	15	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10	
Amps	Hi PR	1.96	2.00	2.06	2.12	2.10	2.14	2.21	2.28	2.22	2.27	2.34	2.42	2.34	2.38	2.46	2.54	2.43	2.48	2.56	2.64	2.51	2.56	2.65	2.73	
	Lo PR	7.6	7.8	8.1	8.3	8.2	8.4	8.7	9.0	8.9	9.1	9.4	9.7	9.5	9.7	10.0	10.4	10.1	10.3	10.6	11.0	10.6	10.9	11.2	11.6	
	MBh	22.5	24.2	25.6	26.7	25.2	27.2	28.7	29.9	28.7	30.9	32.6	34.0	32.7	35.2	37.2	38.8	36.8	39.6	41.8	43.6	40.6	43.7	46.2	48.2	
	S/T	105	112	122	130	111	118	129	137	115	123	134	143	121	129	141	150	127	135	147	157	131	140	152	162	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) Rating Conditions
 kW = Total system power
 Amps = Outdoor unit amps (compressor + fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																				
		65°F				75°F				85°F				95°F				105°F				115°F												
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71									
70	1350	MBh	34.3	35.5	38.9	-	32.7	33.9	37.1	-	31.9	33.1	36.2	-	30.3	31.4	34.4	-	28.1	29.1	31.9	-	28.1	29.1	31.9	-								
		S/T	0.75	0.63	0.44	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-								
		ΔT	18	15	12	-	18	15	12	-	18	16	12	-	18	15	12	-	17	14	11	-	17	14	11	-								
		KW	2.49	2.54	2.62	-	2.68	2.74	2.82	-	2.99	3.06	3.16	-	3.12	3.18	3.29	-	3.22	3.30	3.40	-	3.22	3.30	3.40	-								
	Amps	Hi Pr	8.6	8.8	9.1	-	9.3	9.5	9.8	-	10.1	10.3	10.7	-	10.8	11.0	11.4	-	11.5	11.7	12.1	-	12.1	12.4	12.8	-	12.1	12.4	12.8	-				
		Lo Pr	238	256	270	-	267	287	303	-	304	327	345	-	346	372	393	-	389	419	442	-	430	463	488	-	430	463	488	-				
		MBh	107	114	124	-	113	120	131	-	118	125	137	-	124	131	144	-	130	138	150	-	134	143	156	-	134	143	156	-				
		S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-	0.82	0.69	0.48	-				
	Amps	Hi Pr	8.5	8.7	9.0	-	9.2	9.4	9.7	-	10.0	10.2	10.6	-	10.7	10.9	11.3	-	11.3	11.6	12.0	-	12.0	12.3	12.7	-	12.0	12.3	12.7	-	12.0	12.3	12.7	-
		Lo Pr	236	253	268	-	264	284	300	-	301	323	342	-	342	368	389	-	385	414	438	-	426	458	484	-	426	458	484	-				
MBh		106	113	123	-	112	119	130	-	116	124	135	-	122	130	142	-	128	136	149	-	133	141	154	-	133	141	154	-					
S/T		0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-	0.80	0.66	0.46	-					
Amps	Hi Pr	2.41	2.46	2.54	-	2.59	2.65	2.73	-	2.75	2.81	2.90	-	2.89	2.96	3.05	-	3.01	3.08	3.18	-	3.12	3.19	3.29	-	3.12	3.19	3.29	-	3.12	3.19	3.29	-	
	Lo Pr	8.3	8.5	8.8	-	9.0	9.2	9.5	-	9.7	10.0	10.3	-	10.4	10.6	11.0	-	11.0	11.3	11.7	-	11.7	12.0	12.4	-	11.7	12.0	12.4	-					
	MBh	30.7	31.9	34.9	-	30.0	31.1	34.1	-	29.3	30.4	33.3	-	28.6	29.6	32.5	-	27.2	28.2	30.8	-	25.2	26.1	28.6	-	25.2	26.1	28.6	-					
	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-	0.80	0.66	0.46	-					
75	1350	MBh	34.88	35.91	38.87	41.72	34.07	35.08	37.97	40.75	33.26	34.24	37.06	39.78	32.45	33.41	36.16	38.81	30.82	31.74	34.35	36.87	28.55	29.40	31.82	34.15								
		S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43								
		ΔT	20	19	15	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	15	11	19	18	14	10								
		KW	2.51	2.56	2.64	2.73	2.70	2.76	2.84	2.94	2.87	2.93	3.02	3.12	3.02	3.08	3.18	3.29	3.14	3.21	3.32	3.43	3.25	3.32	3.43	3.55								
	Amps	Hi Pr	8.7	8.9	9.2	9.5	9.4	9.6	9.9	10.3	10.2	10.4	10.8	11.2	10.9	11.1	11.5	11.9	11.6	11.8	12.2	12.7	12.2	12.5	13.0	13.4								
		Lo Pr	240	259	273	285	270	290	306	320	307	330	349	364	349	376	397	414	393	423	447	466	434	467	493	515								
		MBh	108	115	126	134	114	122	133	141	119	126	138	147	125	133	145	154	131	139	152	162	135	144	157	167								
		S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41								
	Amps	Hi Pr	2.49	2.54	2.62	2.70	2.68	2.74	2.82	2.91	2.85	2.91	3.00	3.10	2.99	3.06	3.16	3.26	3.12	3.19	3.29	3.40	3.22	3.30	3.40	3.52								
		Lo Pr	8.6	8.8	9.1	9.4	9.3	9.5	9.8	10.2	10.1	10.3	10.7	11.1	10.8	11.0	11.4	11.8	11.5	11.7	12.1	12.6	12.1	12.4	12.8	13.3								
MBh		238	256	270	282	267	287	303	316	304	327	345	360	346	372	393	410	389	419	442	461	430	463	489	510									
S/T		0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39									
Amps	Hi Pr	2.43	2.48	2.56	2.64	2.61	2.67	2.75	2.84	2.78	2.84	2.93	3.02	2.92	2.98	3.08	3.18	3.04	3.11	3.21	3.31	3.14	3.21	3.32	3.43									
	Lo Pr	8.4	8.6	8.9	9.2	9.0	9.3	9.6	9.9	9.8	10.0	10.4	10.8	10.5	10.7	11.1	11.5	11.1	11.4	11.8	12.2	11.8	12.1	12.5	13.0									
	MBh	104	111	121	129	110	117	128	136	114	121	133	141	120	128	139	148	126	134	146	155	130	138	151	161									
	S/T	0.75	0.66	0.48	0.29	0.78	0.68	0.49	0.29	0.80	0.70	0.51	0.30	0.83	0.73	0.54	0.30	0.85	0.75	0.56	0.31	0.88	0.78	0.59	0.31									

Shaded area reflects ACCA (TVA) Rating Conditions

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.

kW = Total system power
 Amps = Outdoor unit amps (compressor + fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	2025	MBh	55.9	57.9	63.4	-	54.6	56.5	62.0	-	53.3	55.2	60.5	-	52.0	53.9	59.0	-	49.4	51.2	56.1	-	45.7	47.4	51.9	-
		S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-
		ΔT	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	16	12	-
	1800	KW	4.11	4.19	4.31	-	4.40	4.49	4.62	-	4.66	4.75	4.90	-	4.88	4.99	5.14	-	5.08	5.18	5.34	-	5.24	5.35	5.52	-
		Amps	14.5	14.8	15.3	-	15.7	16.1	16.6	-	17.1	17.5	18.1	-	18.3	18.7	19.3	-	19.4	19.9	20.6	-	20.6	21.1	21.9	-
		Hi PR	225	242	255	-	252	271	287	-	287	309	326	-	327	352	371	-	367	395	418	-	406	437	461	-
	1575	Lo PR	102	108	118	-	108	115	125	-	112	119	130	-	118	125	137	-	123	131	143	-	127	136	148	-
		MBh	54.2	56.2	61.6	-	53.0	54.9	60.1	-	51.7	53.6	58.7	-	50.4	52.3	57.3	-	47.9	49.7	54.4	-	44.4	46.0	50.4	-
		S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	1575	ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	18	13	-	20	17	13	-	19	16	12	-
		KW	3.99	4.07	4.18	-	4.27	4.35	4.48	-	4.52	4.61	4.75	-	4.73	4.83	4.98	-	4.92	5.02	5.18	-	5.08	5.19	5.35	-
		Amps	14.0	14.3	14.8	-	15.1	15.5	16.0	-	16.4	16.8	17.4	-	17.6	18.0	18.6	-	18.7	19.2	19.8	-	19.9	20.4	21.0	-
1575	Hi PR	216	232	245	-	242	261	275	-	275	296	313	-	314	338	356	-	353	380	401	-	390	420	443	-	
	Lo PR	98	104	114	-	103	110	120	-	108	114	125	-	113	120	131	-	118	126	137	-	122	130	142	-	
	MBh	50.1	51.9	56.8	-	48.9	50.7	55.5	-	47.7	49.5	54.2	-	46.5	48.3	52.9	-	44.2	45.8	50.2	-	41.0	42.5	46.5	-	
2025	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-	
	ΔT	20	18	13	-	20	18	13	-	21	18	13	-	21	18	14	-	20	18	13	-	19	16	12	-	
	KW	4.14	4.22	4.34	4.47	4.43	4.52	4.66	4.80	4.69	4.79	4.94	5.09	4.92	5.02	5.18	5.34	5.12	5.22	5.39	5.56	5.29	5.40	5.57	5.75	
1800	Amps	14.6	15.0	15.5	16.1	15.8	16.2	16.8	17.4	17.2	17.7	18.2	18.9	18.4	18.9	19.5	20.3	19.6	20.1	20.8	21.6	20.8	21.3	22.1	22.9	
	Hi PR	227	244	258	269	255	274	289	302	290	312	329	343	330	355	375	391	371	399	422	440	410	441	466	486	
	Lo PR	103	110	120	127	109	116	126	135	113	120	131	140	119	126	138	147	125	132	145	154	129	137	150	159	
75	MBh	55.1	56.8	61.5	66.0	53.9	55.5	60.0	64.4	52.6	54.1	58.6	62.9	51.3	52.8	57.2	61.4	48.7	50.2	54.3	58.3	45.1	46.5	50.3	54.0	
	S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41	
	ΔT	23	21	17	12	23	21	18	12	23	21	18	12	23	21	18	12	23	21	17	12	22	20	16	11	
1800	KW	4.11	4.19	4.31	4.44	4.40	4.49	4.62	4.76	4.66	4.75	4.90	5.05	4.89	4.99	5.14	5.30	5.08	5.18	5.34	5.51	5.24	5.35	5.52	5.70	
	Amps	14.5	14.8	15.3	15.9	15.7	16.1	16.6	17.2	17.1	17.5	18.1	18.8	18.3	18.7	19.3	20.1	19.5	19.9	20.6	21.4	20.6	21.1	21.9	22.7	
	Hi PR	225	242	255	266	252	271	287	299	287	309	326	340	327	352	371	387	368	396	418	436	406	437	461	481	
1575	Lo PR	102	108	118	126	108	115	125	133	112	119	130	139	118	125	137	146	123	131	143	152	128	136	148	158	
	MBh	50.9	52.4	56.7	60.9	49.7	51.2	55.4	59.5	48.5	50.0	54.1	58.1	47.3	48.75	52.8	56.6	45.0	46.3	50.1	53.8	41.7	42.9	46.4	49.8	
	S/T	0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39	
1575	ΔT	23	22	18	12	24	22	18	12	24	22	18	12	24	22	18	12	24	22	18	12	22	20	17	11	
	KW	4.02	4.10	4.22	4.34	4.30	4.39	4.52	4.65	4.55	4.64	4.78	4.93	4.77	4.87	5.02	5.17	4.96	5.06	5.22	5.38	5.12	5.23	5.39	5.56	
	Amps	14.1	14.4	14.9	15.5	15.3	15.6	16.1	16.8	16.6	17.0	17.6	18.2	17.7	18.2	18.8	19.5	18.9	19.4	20.0	20.8	20.0	20.5	21.2	22.1	
1575	Hi PR	218	235	248	258	245	263	278	290	278	299	316	330	317	341	360	376	317	341	360	376	357	384	405	423	
	Lo PR	99	105	115	122	105	111	121	129	109	116	126	134	114	121	133	141	120	127	139	148	124	132	144	153	

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) Rating Conditions
 kW = Total system power
 Amps = Outdoor unit amps (compressor + fan)

GSZ130181A* / AR*F182416**

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	21.4	20.2	19.0	17.8	17.0	16.5	15.3	14.1	13.3	12.3	11.3	10.7	10.3	9.2	8.2	7.2	6.1	5.0
ΔT	33.0	31.2	29.4	27.5	26.2	25.4	23.6	21.8	20.6	19.0	17.5	16.5	15.9	14.3	12.7	11.0	9.4	7.7
kW	1.68	1.64	1.61	1.58	1.6	1.54	1.51	1.48	1.46	1.42	1.39	1.37	1.36	1.32	1.29	1.26	1.23	1.19
Amps	7.3	6.7	6.3	5.9	5.7	5.6	5.3	5.0	4.8	4.6	4.3	4.2	4.2	4.0	3.7	3.5	3.2	2.9
COP	3.73	3.60	3.46	3.30	3.19	3.12	2.96	2.79	2.68	2.53	2.39	2.29	2.22	2.04	1.86	1.66	1.46	1.22
EER	12.8	12.3	11.8	11.3	10.9	10.7	10.1	9.5	9.2	8.7	8.2	7.8	7.6	7.0	6.3	5.7	5.0	4.2
Hi PR	392	375	361	345	337	331	318	305	292	279	268	262	257	247	238	228	220	212
Lo PR	145	134	126	115	109	105	96	86	77	69	61	57	55	46	40	34	29	23

GSZ130241B* / AR*F182416**

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	28.9	27.4	25.8	24.1	23.0	22.3	20.7	19.1	16.9	15.6	14.3	13.6	13.0	11.7	10.4	9.1	7.7	6.3
ΔT	33.5	31.7	29.8	27.9	26.6	25.8	24.0	22.1	19.5	18.0	16.6	15.7	15.1	13.6	12.0	10.5	8.9	7.3
kW	2.17	2.12	2.08	2.04	2.0	2.00	1.96	1.91	1.80	1.76	1.72	1.70	1.68	1.64	1.60	1.57	1.52	1.49
Amps	10.1	9.3	8.7	8.2	7.9	7.7	7.3	6.9	6.6	6.3	6.0	5.9	5.8	5.5	5.2	4.9	4.5	4.0
COP	3.91	3.77	3.62	3.46	3.34	3.27	3.10	2.92	2.74	2.59	2.44	2.33	2.27	2.08	1.89	1.69	1.48	1.25
EER	13.3	12.9	12.4	11.8	11.4	11.2	10.6	10.0	9.4	8.8	8.3	8.0	7.7	7.1	6.5	5.8	5.1	4.3
Hi PR	413	395	380	364	355	348	335	321	308	294	282	275	271	260	250	240	231	223
Lo PR	131	122	114	105	99	95	88	78	70	63	55	51	50	42	36	30	27	21

GSZ130301A* / AR*F30301**

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	33.2	31.4	29.6	27.6	26.4	25.6	23.8	21.9	19.9	18.4	16.9	16.0	15.4	13.8	12.3	10.7	9.1	7.5
ΔT	29.3	27.7	26.1	24.4	23.3	22.6	21.0	19.3	17.6	16.2	14.9	14.1	13.6	12.2	10.8	9.4	8.0	6.6
kW	2.52	2.47	2.42	2.37	2.3	2.32	2.28	2.23	2.37	2.32	2.26	2.23	2.21	2.16	2.11	2.05	2.00	1.95
Amps	9.7	9.0	8.5	8.0	7.7	7.6	7.2	6.9	6.6	6.3	6.0	5.9	5.8	5.6	5.2	5.0	4.6	4.2
COP	3.86	3.72	3.57	3.41	3.29	3.22	3.05	2.88	2.46	2.32	2.19	2.10	2.04	1.88	1.70	1.52	1.34	1.12
EER	13.2	12.7	12.2	11.6	11.3	11.0	10.4	9.8	8.4	7.9	7.5	7.2	7.0	6.4	5.8	5.2	4.6	3.8
Hi PR	366	351	337	323	315	309	297	285	273	261	250	244	240	231	222	213	205	198
Lo PR	129	119	112	103	97	93	86	76	69	62	54	50	49	41	35	30	26	20

GSZ130361B* / AR*F364216**

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	42.0	39.7	37.4	35.0	33.4	32.4	30.1	27.7	24.8	22.9	21.1	19.9	19.2	17.2	15.3	13.3	11.4	9.3
ΔT	38.4	36.4	34.2	32.0	30.6	29.6	27.5	25.4	22.7	21.0	19.3	18.2	17.6	15.8	14.0	12.2	10.4	8.5
kW	2.72	2.68	2.63	2.58	2.55	2.53	2.48	2.43	2.31	2.26	2.21	2.19	2.17	2.12	2.08	2.03	1.98	1.94
Amps	14.7	13.7	12.8	12.1	11.7	11.5	10.8	10.3	9.9	9.5	9.0	8.8	8.7	8.3	7.8	7.3	6.8	6.2
COP	4.01	3.86	3.69	3.51	3.38	3.30	3.12	2.93	2.75	2.58	2.42	2.31	2.24	2.05	1.85	1.64	1.43	1.20
EER	13.64	13.12	12.55	11.93	11.51	11.23	10.60	9.95	9.34	8.78	8.23	7.85	7.62	6.97	6.29	5.59	4.87	4.07
Hi PR	413	396	381	364	355	349	335	322	308	294	283	276	271	261	251	240	232	224
Lo PR	135	125	118	108	102	98	90	80	72	65	57	53	51	43	37	31	27	22

High pressure is measured at the suction service valve (the larger valve).
 Low pressure is measured at the gauge port connection.
 Calculations are based on nominal CFM and 70 °F indoor dry bulb.

Amps = Outdoor unit amps (comp.+fan)
 kW = Total system power

GSZ130421A* / AR*F36421**

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	50.3	47.6	44.8	41.9	40.0	38.8	36.0	33.2	29.9	27.6	25.4	24.0	23.1	20.7	18.4	16.0	13.7	11.2
ΔT	34.5	32.6	30.7	28.7	27.4	26.6	24.7	22.8	20.5	18.9	17.4	16.5	15.9	14.2	12.6	11.0	9.4	7.7
kW	3.60	3.53	3.46	3.39	3.4	3.32	3.25	3.18	3.24	3.16	3.09	3.05	3.02	2.95	2.88	2.80	2.73	2.66
Amps	16.9	15.6	14.5	13.6	13.1	12.9	12.1	11.5	10.9	10.4	9.9	9.7	9.5	9.0	8.4	7.9	7.2	6.4
COP	4.09	3.95	3.79	3.62	3.49	3.42	3.24	3.05	2.70	2.55	2.40	2.30	2.24	2.06	1.87	1.67	1.47	1.23
EER	14.0	13.5	12.9	12.4	11.9	11.7	11.1	10.4	9.2	8.7	8.2	7.9	7.6	7.0	6.4	5.7	5.0	4.2
Hi PR	368	353	340	325	317	311	299	287	275	262	252	246	242	232	223	214	207	199
Lo PR	129	119	112	103	97	93	86	76	69	62	54	50	49	41	35	30	26	20

GSZ130481A* / AR*F48601**

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	55.3	52.4	49.3	46.1	44.0	42.6	39.6	36.5	33.6	31.1	28.6	27.0	26.0	23.3	20.7	18.0	15.4	12.6
ΔT	32.0	30.3	28.5	26.7	25.5	24.7	22.9	21.1	19.5	18.0	16.5	15.6	15.0	13.5	12.0	10.4	8.9	7.3
kW	3.93	3.87	3.80	3.73	3.7	3.66	3.59	3.52	3.37	3.30	3.23	3.19	3.17	3.10	3.04	2.97	2.90	2.84
Amps	18.2	16.8	15.7	14.8	14.3	14.0	13.2	12.5	12.0	11.4	10.9	10.6	10.5	9.9	9.3	8.7	8.1	7.3
COP	4.11	3.96	3.80	3.62	3.49	3.41	3.23	3.03	2.93	2.76	2.59	2.47	2.40	2.20	1.99	1.78	1.55	1.30
EER	14.1	13.5	13.0	12.4	11.9	11.7	11.0	10.4	10.0	9.4	8.8	8.5	8.2	7.5	6.8	6.1	5.3	4.4
Hi PR	380	364	350	335	327	321	308	296	284	271	260	254	249	240	231	221	213	206
Lo PR	129	119	112	103	97	93	86	76	69	62	54	50	49	41	35	30	26	20

GSZ130601A* / AR*F48601**

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	72.9	69.0	65.0	60.7	58.0	56.2	52.2	48.1	44.9	41.4	38.1	36.0	34.7	31.1	27.6	24.0	20.5	16.8
ΔT	37.5	35.5	33.4	31.2	29.8	28.9	26.9	24.8	23.1	21.3	19.6	18.5	17.8	16.0	14.2	12.4	10.6	8.6
kW	5.21	5.11	5.01	4.92	4.9	4.82	4.72	4.63	4.66	4.56	4.46	4.40	4.36	4.26	4.16	4.06	3.96	3.86
Amps	24.0	22.2	20.7	19.5	18.8	18.4	17.3	16.4	15.7	15.0	14.2	13.9	13.7	13.0	12.1	11.3	10.5	9.4
COP	4.10	3.95	3.79	3.62	3.49	3.41	3.23	3.05	2.82	2.66	2.50	2.40	2.33	2.14	1.94	1.73	1.52	1.28
EER	14.0	13.5	13.0	12.4	11.9	11.7	11.1	10.4	9.6	9.1	8.6	8.2	8.0	7.3	6.6	5.9	5.2	4.4
Hi PR	416	399	383	367	358	351	338	324	310	296	285	278	273	262	252	242	233	225
Lo PR	133	123	115	106	100	96	89	79	71	64	56	52	50	42	37	31	27	21

High pressure is measured at the suction service valve (the larger valve).

Low pressure is measured at the gauge port connection.

Calculations are based on nominal CFM and 70 °F indoor dry bulb.

Amps = Outdoor unit amps (comp.+fan)

kW = Total system power

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS [^]				TVA RATINGS ³		HEATING RATINGS [^]			CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL	SENS.	SEER ¹	EER ²	TOTAL	SENS.	HI ⁴	HSPF ⁵	LOW ⁶		
GSZ13 0181A*	AWUF31XX16A*		17,400	12,900	14.0	11.3	16,100	12,700	17,500	8.2	10,000	600	3629336
GSZ13 0241B*	AWUF31XX16A*		24,000	18,100	14.0	12.0	22,200	17,800	22,800	8.2	13,400	800	3842473
	AWUF32XX16A*		24,000	18,100	14.0	12.0	22,200	17,800	22,800	8.2	13,400	800	3842474
	CA*F1824*6D*+MBVC1200**-1A*		23,800	17,900	14.0	12.0	22,000	17,600	22,800	8.2	13,200	800	4150316
	CHPF2430B6C*+MBVC1200**-1A*		24,000	18,100	14.0	12.0	22,200	17,800	23,000	8.2	13,200	800	3842493
GSZ13 0301A*	CHPF2430B6C*+MBVC1200**-1A*		28,400	21,400	14.0	11.3	26,200	21,400	26,400	8.2	16,000	1,050	3610003
GSZ13 0361B*	ASPT42D14A*		35,200	26,800	14.0	12.0	32,600	26,000	33,000	8.2	21,200	1,280	6497875
	CA*F3642*6D*+MBVC1600**-1A*		35,200	26,800	14.0	11.5	32,600	26,000	32,000	8.2	20,000	1,200	3880695
	CA*F3743*6D*+MBVC1600**-1A*		35,000	26,600	14.0	11.3	32,400	26,000	34,000	8.2	20,000	1,200	6497888
	CHPF3642C6C*+MBVC1600**-1A*		34,800	26,400	14.0	11.5	32,200	25,800	32,600	8.2	20,000	1,200	3850501
	CHPF3642D6C*+MBVC2000**-1A*		35,200	26,800	14.0	12.0	32,600	26,000	32,000	8.5	20,000	1,150	3850543
GSZ13 0421A*	CA*F4860*6D*+TXV	G*E80805C*B*	41,000	29,000	14.0	11.3	38,000	30,000	40,500	8.2	24,000	1,350	5038613
	CA*F4860*6D*+TXV	G*E81005C*B*	41,000	29,000	14.0	11.3	38,000	30,000	40,500	8.2	24,000	1,420	5038685
	CA*F4860*6D*+TXV	A*EH800805C*A*	41,000	29,000	14.0	11.3	38,000	30,000	40,500	8.2	24,000	1,350	6844561
	CA*F4860*6D*+TXV	A*EH801005C*A*	41,000	29,000	14.0	11.3	38,000	30,000	40,500	8.2	24,000	1,420	6844623
	CHPF4860D6D*+MBVC1600**-1A*		41,000	29,000	14.0	11.3	38,000	30,000	40,500	8.2	24,000	1,350	3610032
	CHPF4860D6D*+TXV	G*E80805C*B*	41,000	29,000	14.0	11.3	38,000	30,000	40,500	8.2	24,000	1,350	5038639
	CHPF4860D6D*+TXV	G*E81005C*B*	41,000	29,000	14.0	11.3	38,000	30,000	40,500	8.2	24,000	1,420	5038686
	CHPF4860D6D*+TXV	A*EH800805C*A*	41,000	29,000	14.0	11.3	38,000	30,000	40,500	8.2	24,000	1,350	6844578
	CHPF4860D6D*+TXV	A*EH801005C*A*	41,000	29,000	14.0	11.3	38,000	30,000	40,500	8.2	24,000	1,420	6844625
GSZ13 0481A*	ASPT48D14A*		46,000	36,000	14.0	12.0	42,500	34,600	44,000	8.2	26,400	1,600	5796518
	ASPT60D14A*		46,000	36,000	14.0	12.0	42,500	34,600	44,000	8.2	26,400	1,600	5722661
	AVPTC48D14A*		46,000	36,000	14.0	12.0	42,500	34,600	44,000	8.2	26,400	1,615	5924426
	CA*F4860*6D*+MBVC2000**-1A*+TXV		46,000	36,000	14.0	11.3	42,500	34,600	44,000	8.2	27,000	1,600	3880758
	CAPT4961*4A*+MBVC2000**-1A*		45,500	35,600	14.0	12.0	42,000	34,200	41,500	8.5	26,200	1,550	5611343
	CHPF4860D6D*+MBVC2000**-1A*+TXV		46,000	36,000	14.0	11.3	42,500	34,600	44,000	8.2	27,000	1,600	3610053

[^] Rated in accordance with ANSI/AHRI Standard 210/240

¹ Seasonal Energy Efficiency Ratio

² Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

³ TVA Rating: BTU/h @ 75°F/ 63°F - 95°F

⁴ Rated heating capacity at 47°F outdoor per AHRI 210/240

⁵ HSPF = Heating Seasonal Performance Factor

⁶ Heating capacity at 17°F outdoor


⁷ CFM at High stage

⁸ CFM at Intermediate and low stage

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When matching outdoor unit to indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Goodman brand gas furnace contains the EEP cooling time delay.

8	7	6	5	4	3	2	1																																			
<p>ECN: XXXXXX REV: A ZONE: A DESCRIPTION: INITIAL RELEASE EHK ID: - DATE: GL</p>																																										
<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="2">MODEL</th> <th colspan="3">DIMENSIONS</th> </tr> <tr> <th>W"</th> <th>D"</th> <th>H"</th> </tr> </thead> <tbody> <tr> <td>GSZ130181**</td> <td>26</td> <td>26</td> <td>32 3/4</td> </tr> <tr> <td>GSZ130241**</td> <td>26</td> <td>26</td> <td>32 3/4</td> </tr> <tr> <td>GSZ130301**</td> <td>26</td> <td>26</td> <td>32 3/4</td> </tr> <tr> <td>GSZ130361**</td> <td>29</td> <td>29</td> <td>32 3/4</td> </tr> <tr> <td>GSZ130421**</td> <td>29</td> <td>29</td> <td>38 3/4</td> </tr> <tr> <td>GSZ130481**</td> <td>29</td> <td>29</td> <td>34 3/4</td> </tr> <tr> <td>GSZ130601**</td> <td>35 3/4</td> <td>35 3/4</td> <td>34 3/4</td> </tr> </tbody> </table>								MODEL	DIMENSIONS			W"	D"	H"	GSZ130181**	26	26	32 3/4	GSZ130241**	26	26	32 3/4	GSZ130301**	26	26	32 3/4	GSZ130361**	29	29	32 3/4	GSZ130421**	29	29	38 3/4	GSZ130481**	29	29	34 3/4	GSZ130601**	35 3/4	35 3/4	34 3/4
MODEL	DIMENSIONS																																									
	W"	D"	H"																																							
GSZ130181**	26	26	32 3/4																																							
GSZ130241**	26	26	32 3/4																																							
GSZ130301**	26	26	32 3/4																																							
GSZ130361**	29	29	32 3/4																																							
GSZ130421**	29	29	38 3/4																																							
GSZ130481**	29	29	34 3/4																																							
GSZ130601**	35 3/4	35 3/4	34 3/4																																							
<p>SPECIAL CHARACTERISTICS:</p> <ul style="list-style-type: none"> ⊕ = 6SIGMA ⊕ = CRITICAL CHARACTERISTIC ⊕ = SIGNIFICANT CHARACTERISTIC 																																										
<p>COMPONENTS AND MATERIALS SPECIFIED HEREIN WILL ALSO CONFORM TO THE APPLICABLE SECTION OF GOODMAN MSP 824.01 WORKMANSHIP STANDARD FOR FIT, FEEL AND FINISH.</p> <p>CONFIDENTIAL PROPERTY OF THE GOODMAN MANUFACTURING COMPANY, LP. NOT TO BE DISCLOSED TO OTHERS, COPIED, OR USED FOR ANY PURPOSE EXCEPT AS AUTHORIZED IN WRITING. MUST BE RETURNED UPON DEMAND, ON COMPLETION OF ORDER, OR OTHER PURPOSE FOR WHICH IT WAS LENT.</p>																																										
<p>Goodman Manufacturing Co. LP</p> <p>GSZ13</p> <p>ENGINEERING</p> <p>DATE: BY: CHECKED: APPROVED: DOWNSHIFT LEARNING</p>																																										
8	7	6	5	4	3	2	1																																			

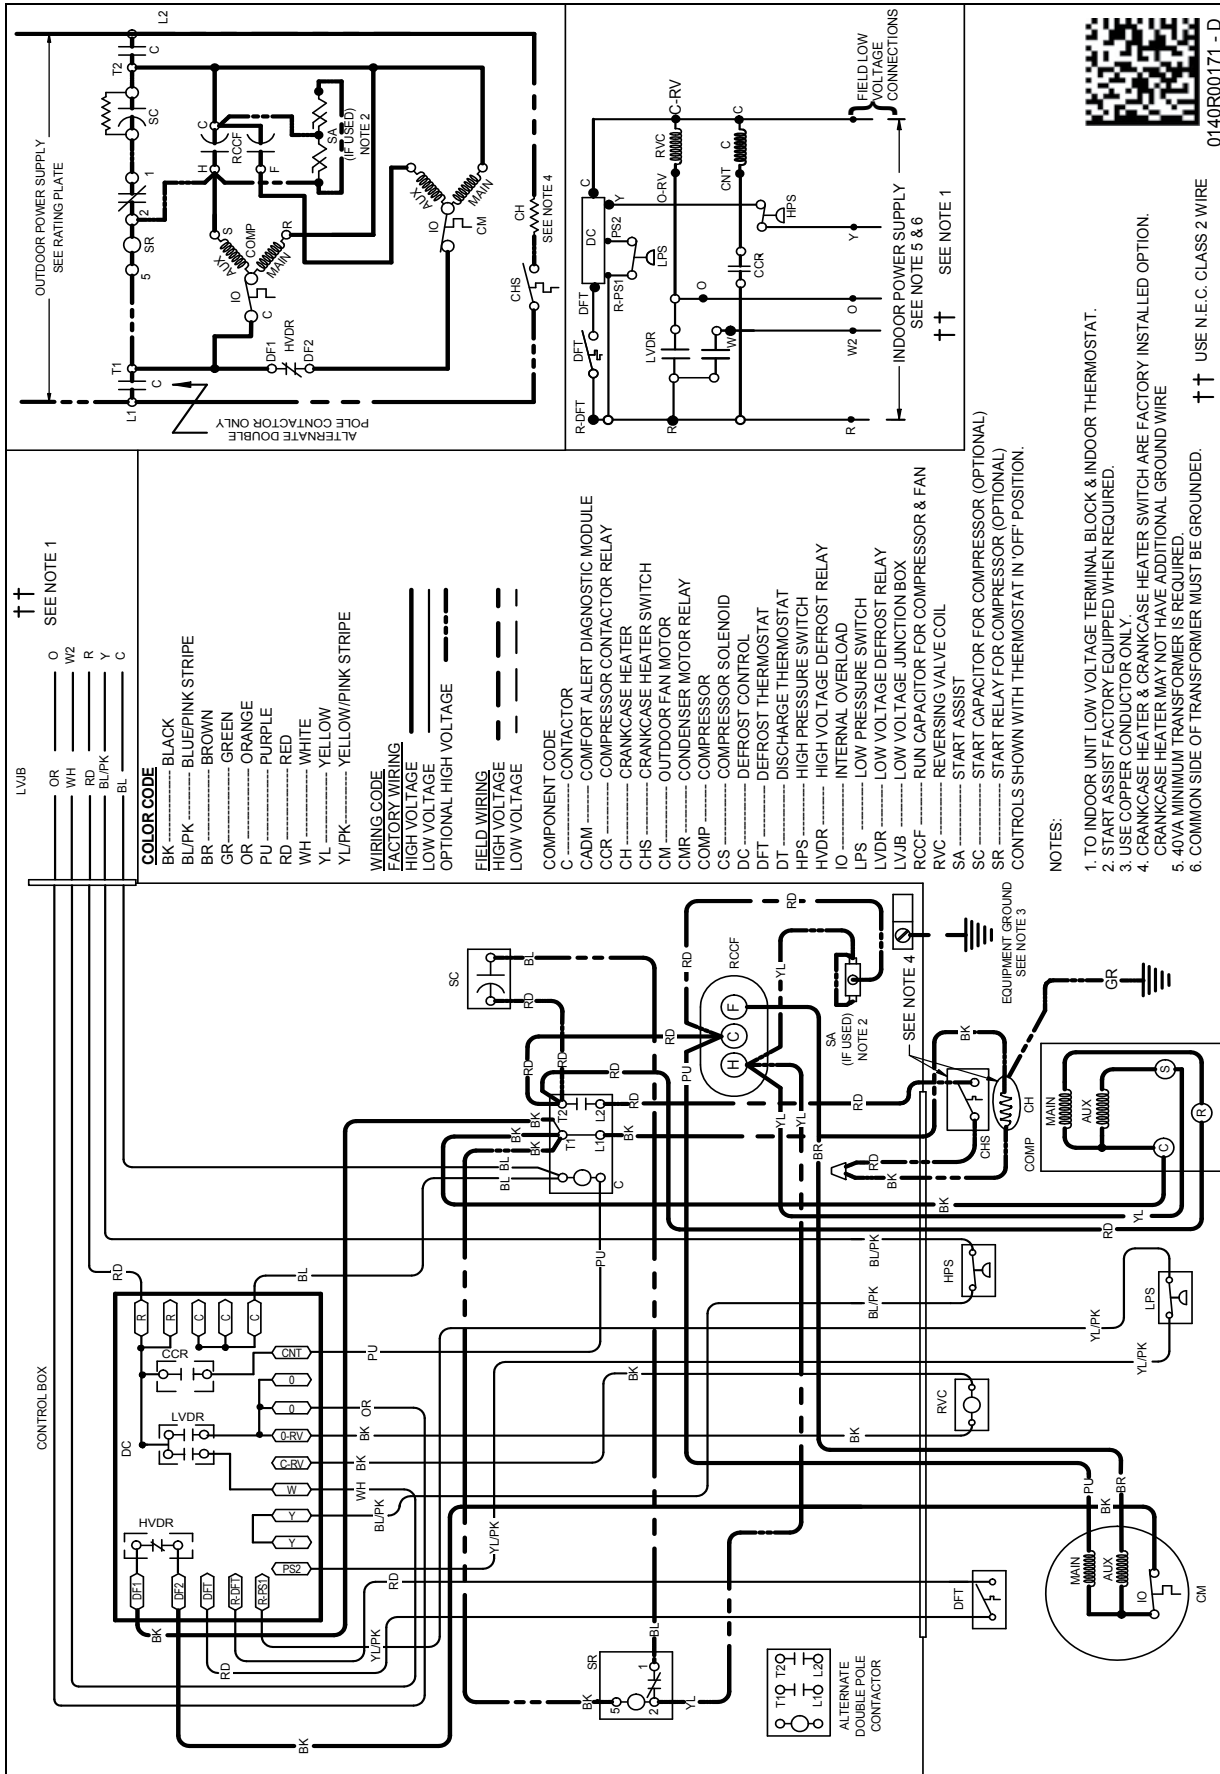

0140R00171 - D

WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

ACCESSORIES

MODEL #	DESCRIPTION	GSZ13 018	GSZ13 024	GSZ13 030	GSZ13 036	GSZ13 042	GSZ13 048	GSZ13 060
0130R00000S	Low-pressure Switch Kit	X	X	X	X	X	X	X
ABK-20	Anchor Bracket Kit ⁰	X	X	X	X	X	X	X
ASC-01	Anti-Short Cycle Kit	X	X	X	X	X	X	X
AFE18-60A	All-fuel Kit	X	X	X	X	X	X	X
CSR-U-1	Hard-start Kit	X	X	X	X	X	X	X
FSK01A ¹	Freeze Protection Kit	X	X	X	X	X	X	X
OT18-60A ²	Outdoor Thermostat	X	X	X	X	X	X	X
OT/EHR18-60	Emergency Heat Relay kit	X	X	X	X	X	X	X
TX2N4 ³	TXV Kit	X						
TX2N4A ³	TXV Kit	X	X					
TX3N4 ³	TXV Kit			X	X			
TX5N4 ³	TXV Kit					X	X	X

⁰ Contains 20 brackets; four brackets needed to anchor unit to pad

¹ Installed on indoor coil

² Required for heat pump applications where ambient temperatures fall below 0°F with 50% or higher relative humidity.

³ Condensing units and heat pumps with reciprocating compressors require the use of start-assist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device or liquid line solenoid kit. The TXV should always be sized based on the tonnage of the outdoor unit.

