VRF Atom Indoor Unit

MDV-D28DL/VN1-C(At) - Ceiling & Floor

1-phase, 220-240V, 60Hz



| | Submittal Data | | |
|-----------|---|--|--|
| Job name: | Location: | | |
| Tag: | Date: | | |
| | MDV-D28DL/VN1-C(At) Features: Flexible installation: floor standing or ceiling Two direction auto swing (vertical and horizontal) Wide-angle airflow 3-speed fan control Built-in EXV Quiet operation | | |

Specifications:

| Model | | | MDV-D28DL/VN1-C(At) | |
|-------------------------------------|-----------------|--------|---------------------|--|
| | Capacity | kBtu/h | 27 | |
| | Power input | W | 183 | |
| Heating ² | Capacity | kBtu/h | 30 | |
| | Power input | W | 183 | |
| Air flow rate ³ | | m³/h | 1200/900/700 | |
| Sound pressure level ^₄ | | dB(A) | 45/43/40 | |
| Net dimensions ⁵ (W×H×D) | | mm | 1280×203×660 | |
| Packed dimensions (W×H×D) | | mm | 1379×296×744 | |
| Net/Gross weight | | kg | 34.5/41 | |
| Pipe connections | Liquid/Gas pipe | mm | Ф9.53/Ф15.9 | |
| | Drain pipe | mm | ODФ25 | |
| Minimum Circuit Amps (MCA) | | А | 1.3 | |
| Recommended Fuse Size (MFA) | | А | 15 | |

Notes:

1. Indoor temperature 27°CDB, 19°CWB; outdoor temperature 35°CDB; equivalent refrigerant piping length 7.5m with zero level difference.

2. Indoor temperature 20°CDB; outdoor temperature 7°CDB, 6°CWB; equivalent refrigerant piping length 7.5m with zero level difference.


3. Air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.

4. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 1m in front and 1m above the floor in a semi-anechoic chamber for floor standing installation, and 1m in front and 1m below the unit for ceiling installation.

5. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.

Dimensional Drawing:

Unit (mm)

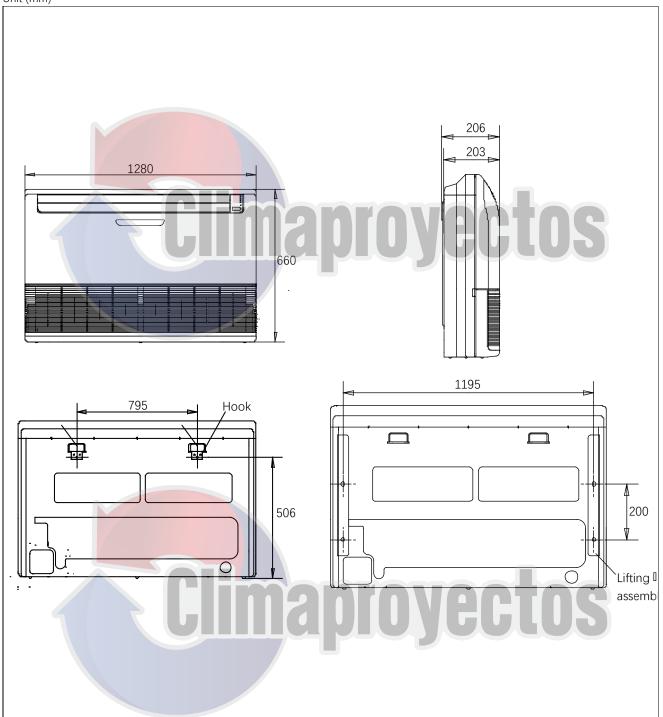

Product specifications change from time to time as product improvements and developments are released and may vary from those in this document.